







SITE PLANNING DATA


Power Xpert 9395P 250-300 kVA UPS

Page 1	Dimensional Drawings
Page 2	Customer Connections
Page 3	Isometric View of Customer Connections
Page 4	Electrical Wiring of single unit
Page 5	Electrical & Signal Wiring of Parallel Units
Page 6	Product Specifications

METRIC		THIRD ANGLE PROJECTION		EATON CORPORATION			
DIMENSIONS ARE IN MILLIMETERS AFTER PLATING, DIMENSIONS AND TOLERANCES IN ACCORDANCE WITH ASME Y14.5M-1994. SEE NOTES FOR TOLERANCES.							
DESCRIPTION: Power Xpert 9395P 250-300 kVA UPS							
ORIGINATED: ATIF RASHEED	27.04.2015	ECO:	NAME:	REVISION: 006	SIZE: A2		
MODIFIED: Tuomas Avellan	23.03.2022				SCALE: N/A		
CHECKED:		DOCUMENT TYPE:	P-110000417		STATE: RELEASED	SHEET: OF	
SAFETY:		AUTOCAD DRAWING					
APPROVED:							
<small>EATON CORPORATION - CONFIDENTIAL AND PROPRIETARY NOTICE TO PERSONS RECEIVING THIS DOCUMENT AND/OR TECHNICAL INFORMATION THIS DOCUMENT, INCLUDING THE DRAWING AND INFORMATION CONTAINED THEREON, IS CONFIDENTIAL AND IS THE EXCLUSIVE PROPERTY OF EATON CORPORATION, AND IS LOANED AND SUBJECT TO RECALL BY EATON AT ANY TIME. BY TAKING POSSESSION OF THIS DOCUMENT, THE RECIPIENT ACKNOWLEDGES AND AGREES THAT THIS DOCUMENT CANNOT BE USED IN ANY MANNER ADVERSE TO THE INTERESTS OF EATON AND THAT NO PORTION OF THIS DOCUMENT MAY BE COPIED OR OTHERWISE REPRODUCED WITHOUT THE PRIOR WRITTEN CONSENT OF EATON. IN THE CASE OF CONFLICTING CONTRACTUAL PROVISIONS, THIS NOTICE SHALL GOVERN THE STATUS OF THIS DOCUMENT. © 2018 Eaton Corporation - All Rights Reserved.</small>							

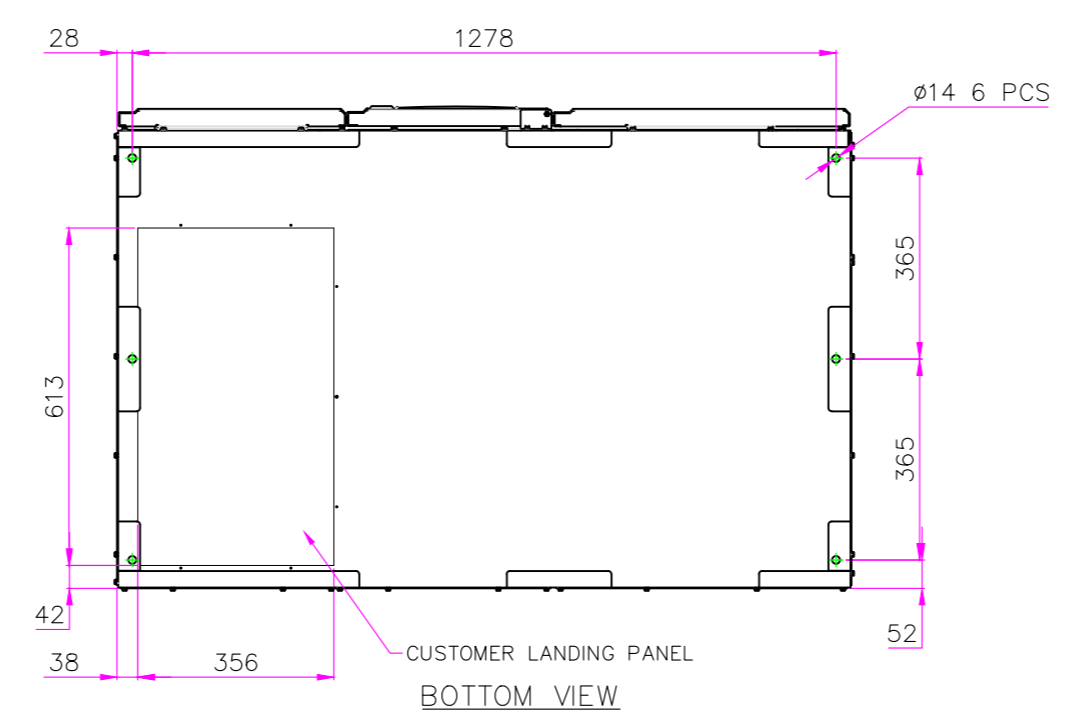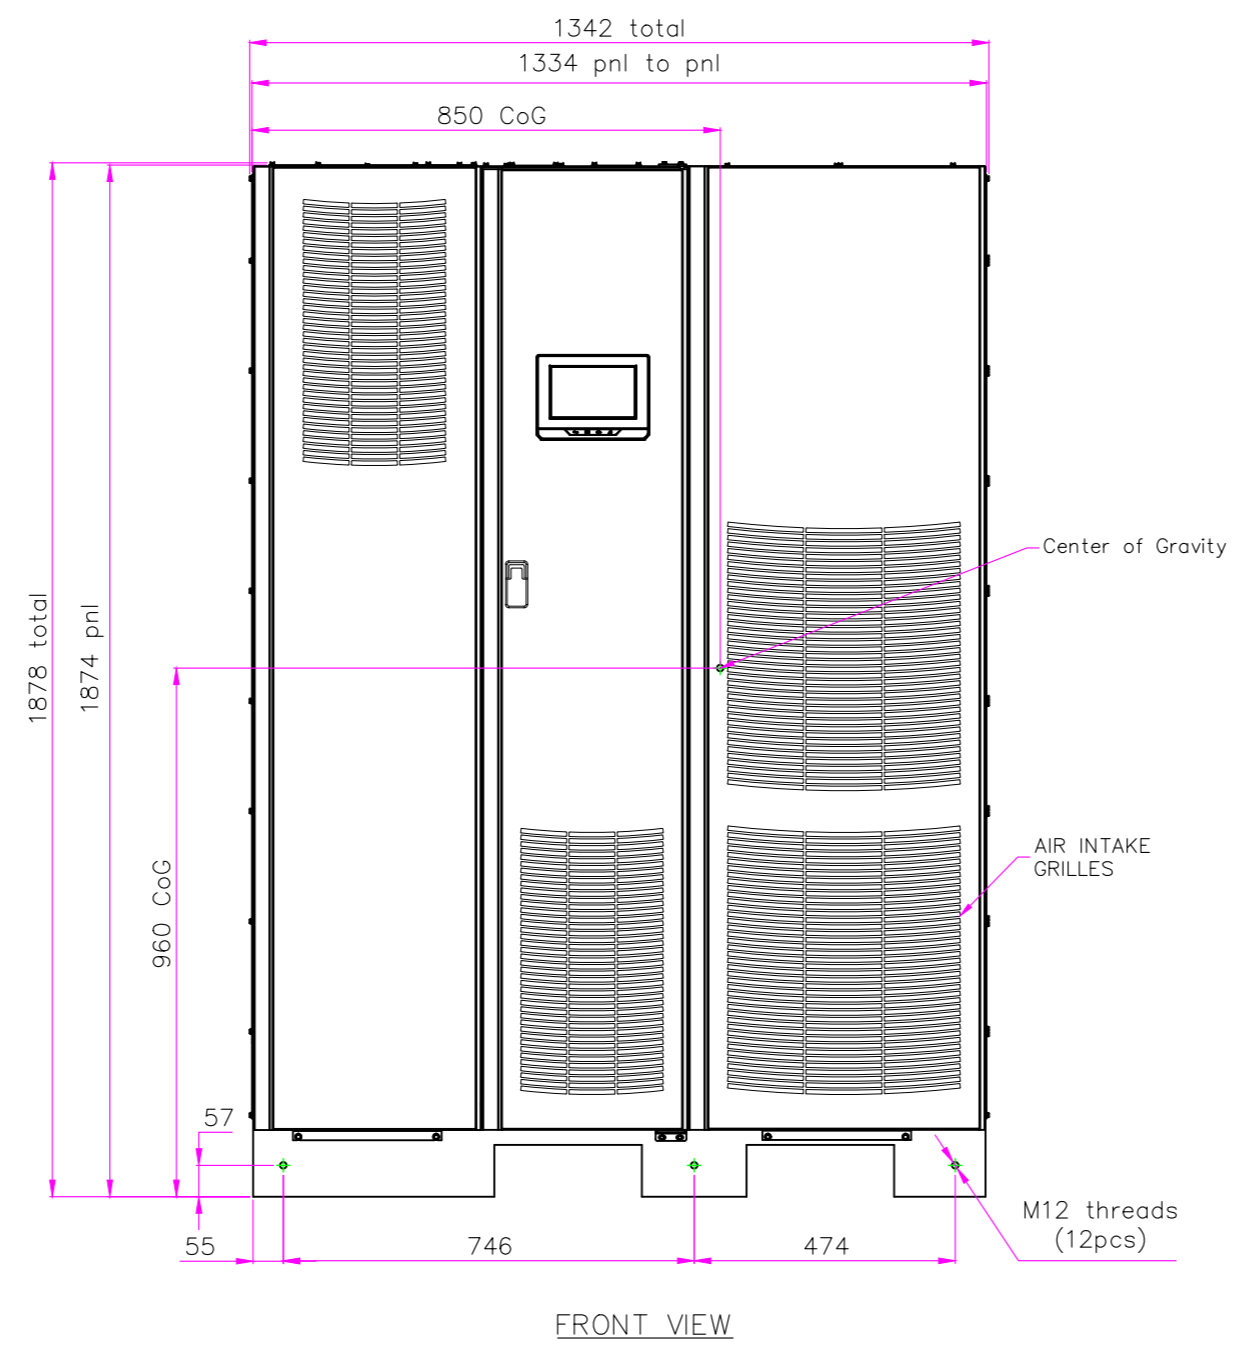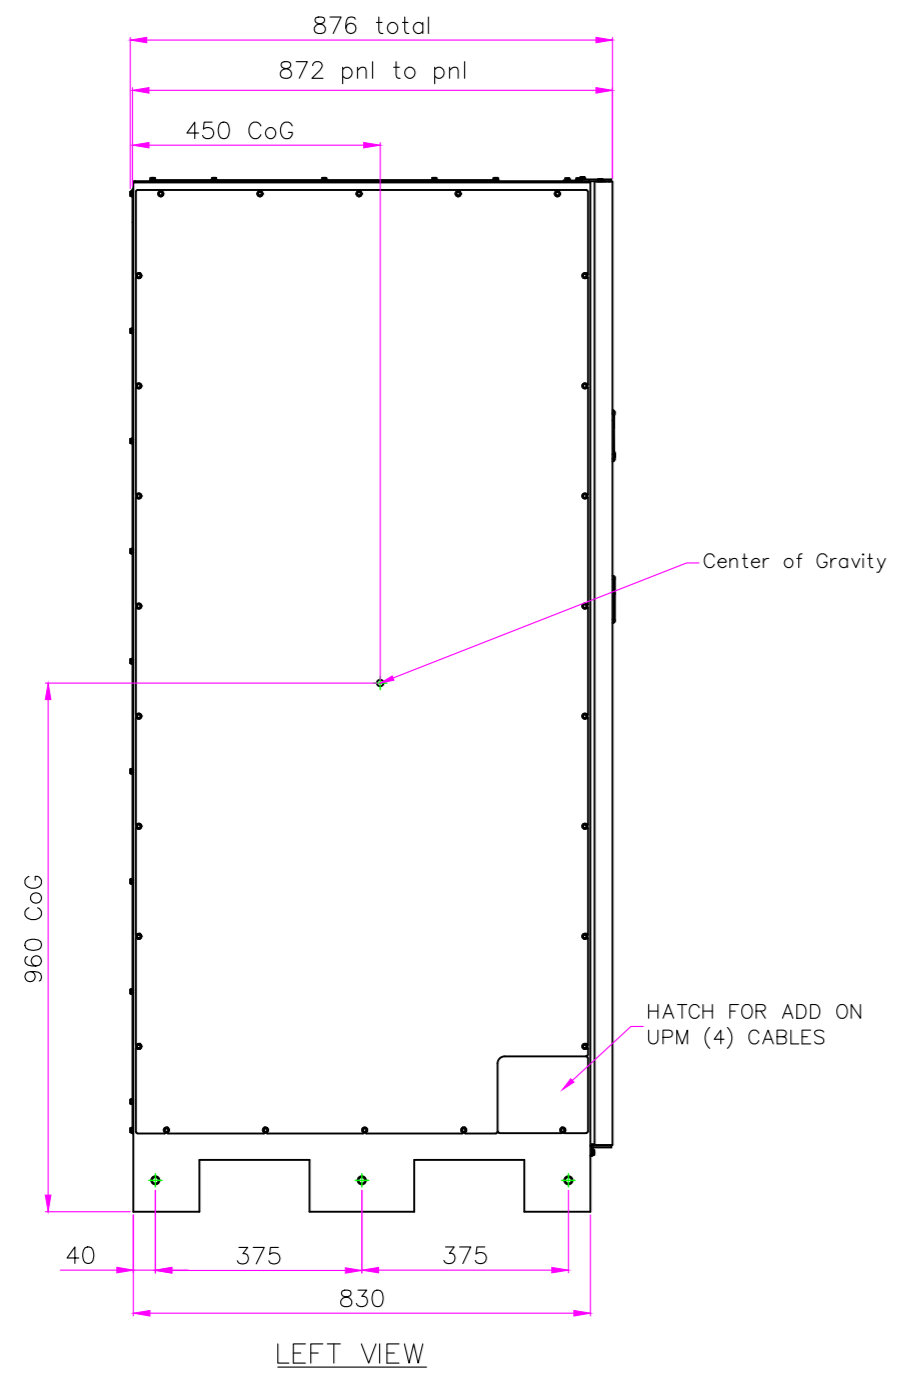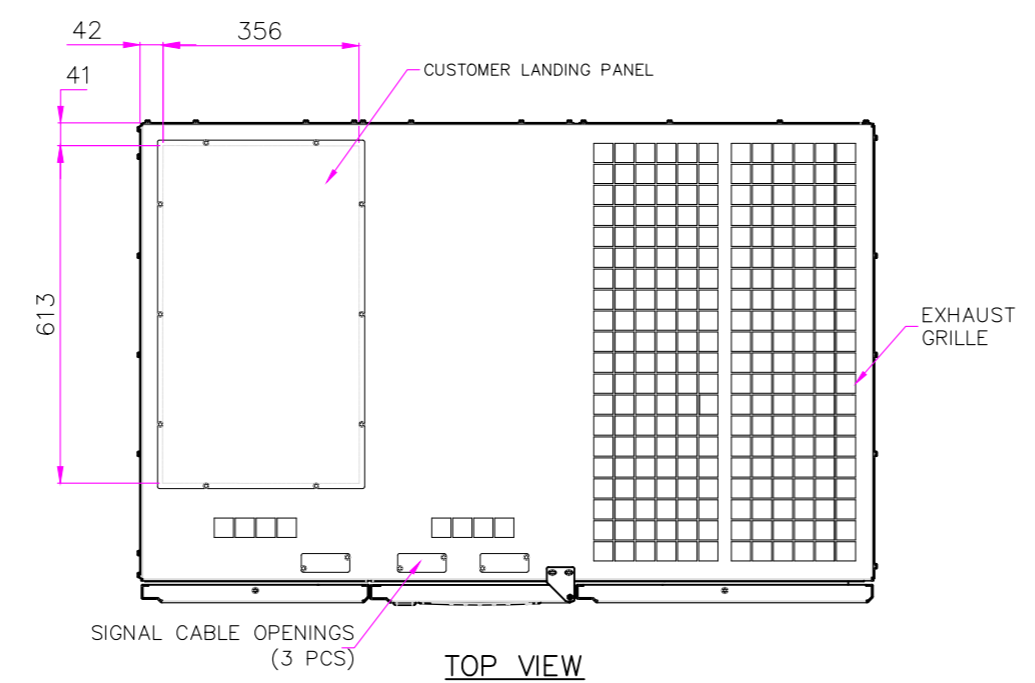


Product Specifications						
UPS Rating		Max Heat Dissipation at 100% Load	Dimensions WxDxH	Approx. Weight Unpacked	Floor Loading	Cooling Air
kVA	kW	kW	mm	kg	kg/m ²	l/s
250	250	11.2	1342x880x1880	860	754	985
300	275	12.7	1342x880x1880	860	754	985
300	300	14.8	1342x880x1880	860	754	985

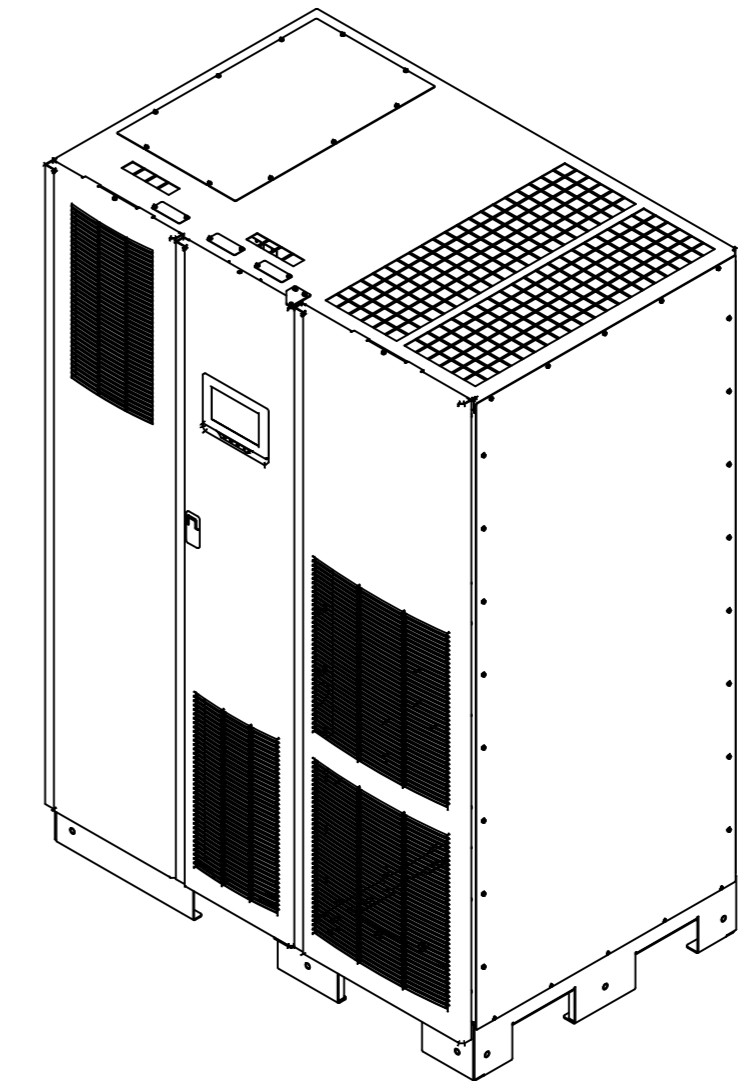



- Notes:
- The system must be installed in a temperature and humidity controlled indoor area free of conductive contaminants.
 - Do not expose to overly aggressive environments like salt mist and/or corrosive gases. UPS should be installed in a G1 environment (based on ANSI/ISA S-71.04 classifications). Do not place near a source of dust or sand.
 - Continuous ambient temperature range: 0–40°C (32–104F) for 250 kVA/kW and 300 kVA/275 kW; Maximum relative humidity: 95% non-condensing. Recommended range 20–60%.
 - Continuous ambient temperature range: 0–35°C (32–95F) for 300 kVA/kW; Maximum relative humidity: 95% non-condensing. Recommended range 20–60%.
 - Minimum overhead clearance for ventilation above the UPS cabinet is 457mm (18in.).
 - Minimum 915mm (36in.) clearance is required in front of the UPS cabinet for cooling air intake and servicing space.
 - Top and bottom cable entries through removable access plates are standard for all configurations. Access plates shall be custom-modified to suit conduit sizes.

METRIC	THIRD ANGLE PROJECTION	EATON CORPORATION		EATON	
DIMENSIONS ARE IN MILLIMETERS AFTER PLATING, DIMENSIONS AND TOLERANCES IN ACCORDANCE WITH ASME Y14.5M-1994. SEE NOTES FOR TOLERANCES.					
DESCRIPTION: Power Xpert 9395P 250–300 kVA UPS Dimensional Drawings					
ORIGINATED: ATIF RASHEED	27.04.2015	ECO:	NAME:	REVISION: 006	SIZE: A2
MODIFIED: Tuomas Avellan	23.03.2022	DOCUMENT TYPE: P-110000417	STATE: RELEASED	SCALE: 1:14	SHEET: 1 OF 6
CHECKED:		APPROVED:			

EATON CORPORATION - CONFIDENTIAL AND PROPRIETARY
 NOTICE TO PERSONS RECEIVING THIS DOCUMENT AND/OR TECHNICAL INFORMATION
 THIS DOCUMENT, INCLUDING THE DRAWING AND INFORMATION CONTAINED THEREON, IS CONFIDENTIAL AND IS THE EXCLUSIVE PROPERTY OF EATON CORPORATION, AND IS HEREBY ON LOAN AND SUBJECT TO RECALL BY EATON AT ANY TIME.
 BY TAKING POSSESSION OF THIS DOCUMENT, THE RECIPIENT ACKNOWLEDGES AND AGREES THAT THIS DOCUMENT CANNOT BE USED IN ANY MANNER ADVERSE TO THE INTERESTS OF EATON AND THAT NO PORTION OF THIS DOCUMENT MAY BE COPIED OR OTHERWISE REPRODUCED WITHOUT THE PRIOR WRITTEN CONSENT OF EATON. IN THE CASE OF CONFLICTING CONTRACTUAL PROVISIONS, THIS NOTICE SHALL GOVERN THE STATUS OF THIS DOCUMENT.
 © 2018 Eaton Corporation - All Rights Reserved.

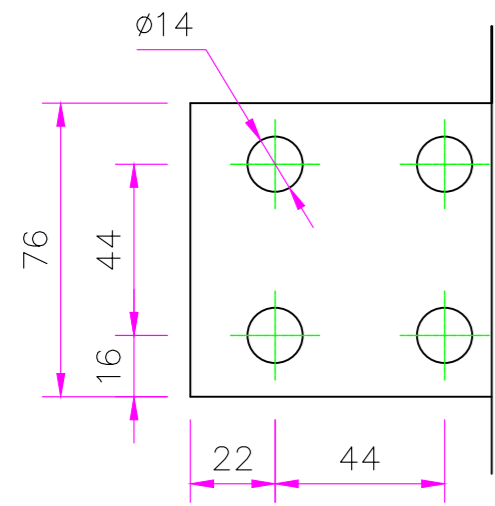

Detail View A
Scale 2:1

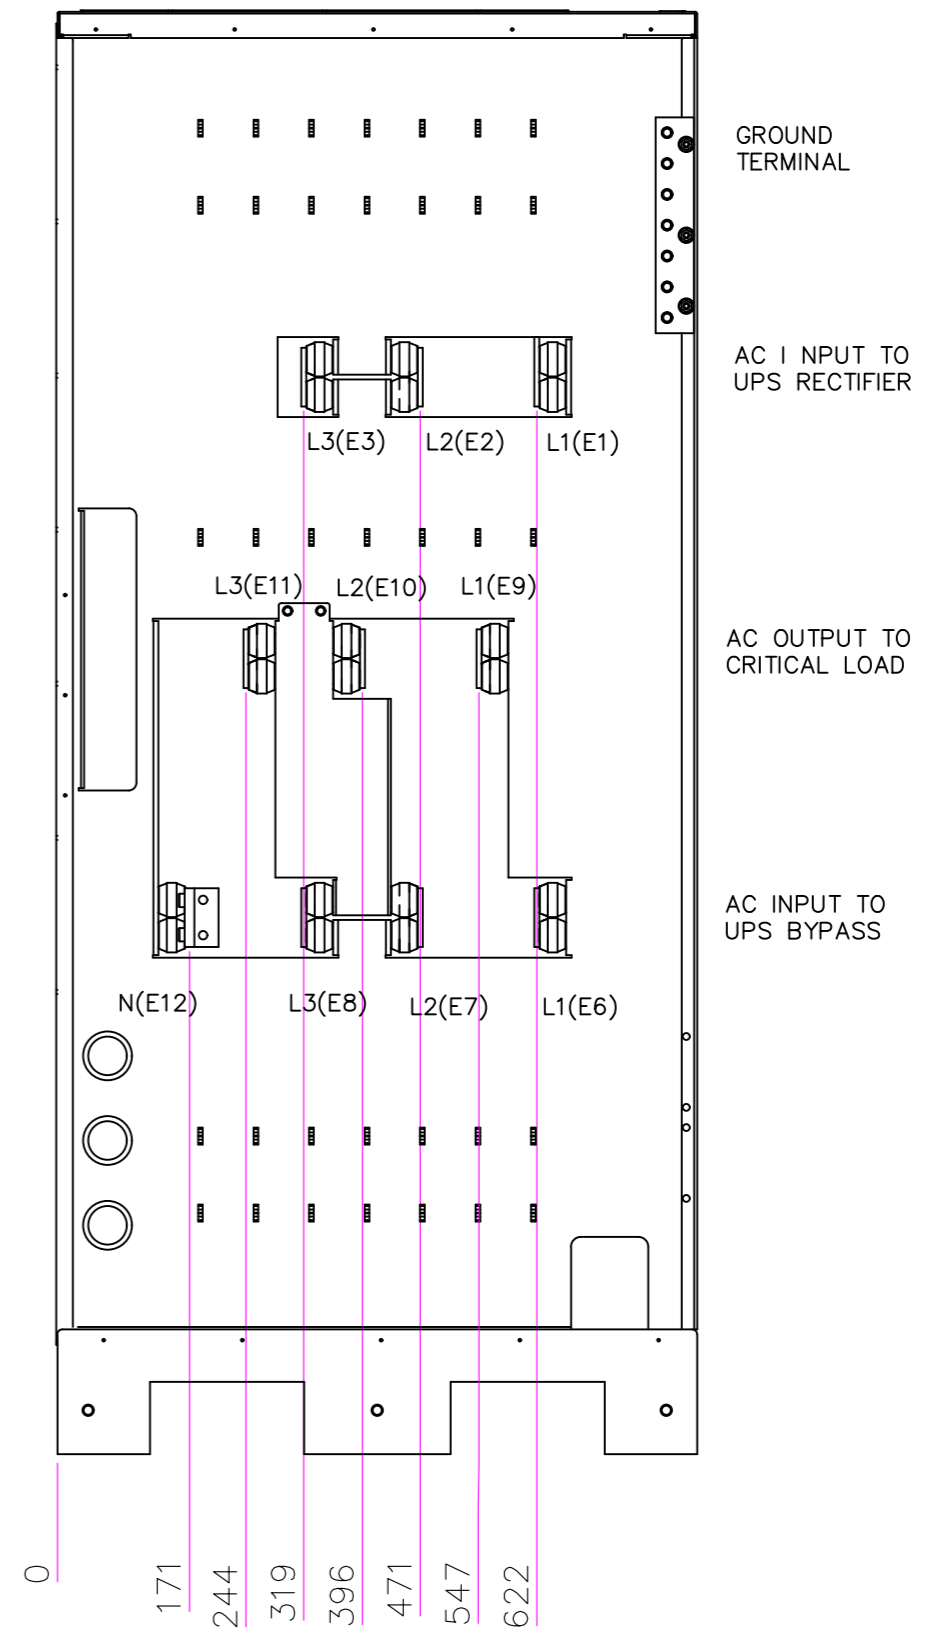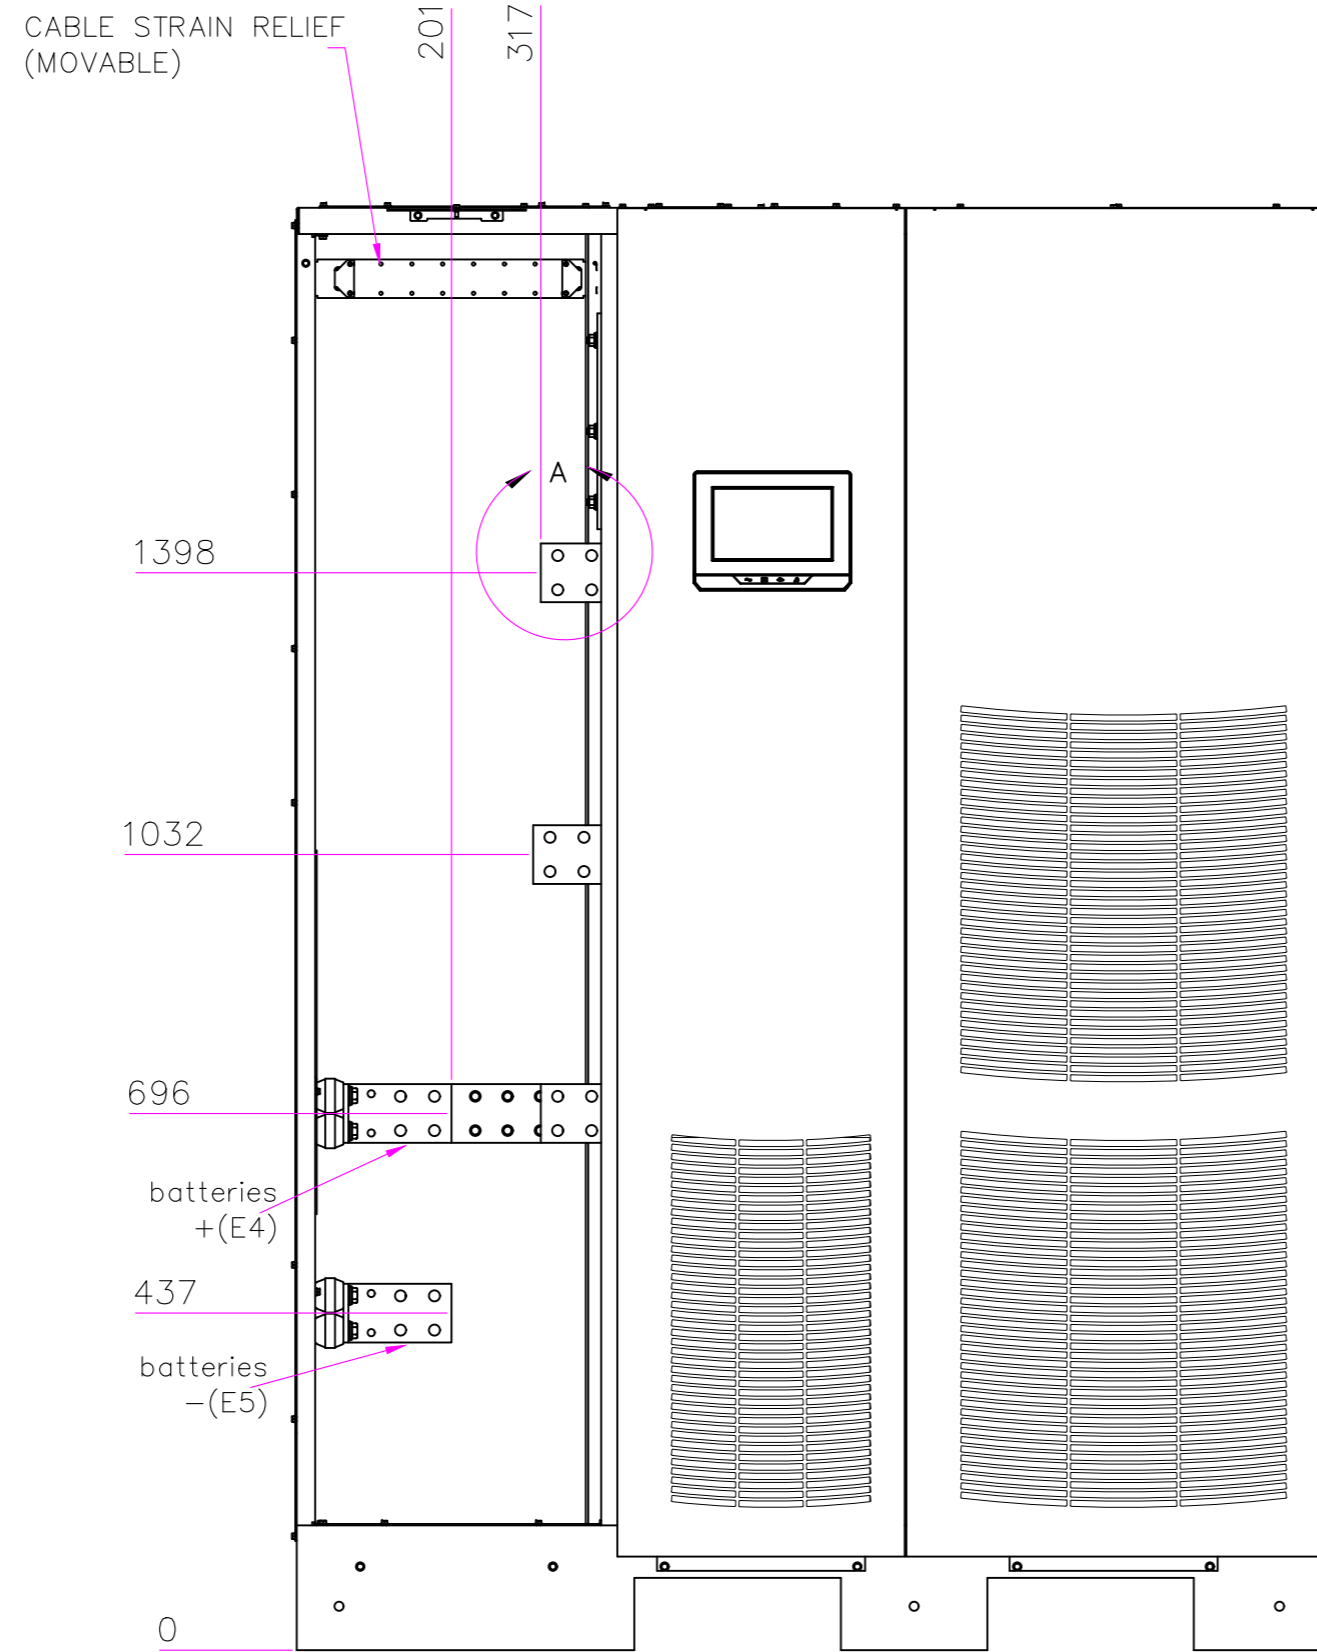


Note:
1. The Bus Bars are Tin coated and suitable for both Cu and Al connections.

METRIC		THIRD ANGLE PROJECTION		EATON CORPORATION		EATON	
DIMENSIONS ARE IN MILLIMETERS AFTER PLATING, DIMENSIONS AND TOLERANCES IN ACCORDANCE WITH ASME Y14.5M-1994. SEE NOTES FOR TOLERANCES.							
DESCRIPTION: Power Xpert 9395P 250-300 kVA UPS Customer Connections							
ORIGINATED: ATIF RASHEED	27.04.2015	ECO:	NAME:	REVISION: 006	SIZE: A2		
MODIFIED: Tuomas Avellan	23.03.2022	DOCUMENT TYPE: P-110000417	STATE: RELEASED	SCALE: 1:10			
CHECKED:		AUTOCAD DRAWING		SHEET: 2 OF 6			
SAFETY:							
APPROVED:							

EATON CORPORATION - CONFIDENTIAL AND PROPRIETARY
NOTICE TO PERSONS RECEIVING THIS DOCUMENT AND/OR TECHNICAL INFORMATION
THIS DOCUMENT, INCLUDING THE DRAWING AND INFORMATION CONTAINED THEREON, IS CONFIDENTIAL AND IS THE EXCLUSIVE PROPERTY OF EATON CORPORATION, AND IS HEREBY ON LOAN AND SUBJECT TO RECALL BY EATON AT ANY TIME.
BY TAKING POSSESSION OF THIS DOCUMENT, THE RECIPIENT ACKNOWLEDGES AND AGREES THAT THIS DOCUMENT CANNOT BE USED IN ANY MANNER ADVERSE TO THE INTERESTS OF EATON AND THAT NO PORTION OF THIS DOCUMENT MAY BE COPIED OR OTHERWISE REPRODUCED WITHOUT THE PRIOR WRITTEN CONSENT OF EATON. IN THE CASE OF CONFLICTING CONTRACTUAL PROVISIONS, THIS NOTICE SHALL GOVERN THE STATUS OF THIS DOCUMENT.
© 2018 Eaton Corporation - All Rights Reserved.

BEHIND COVERS

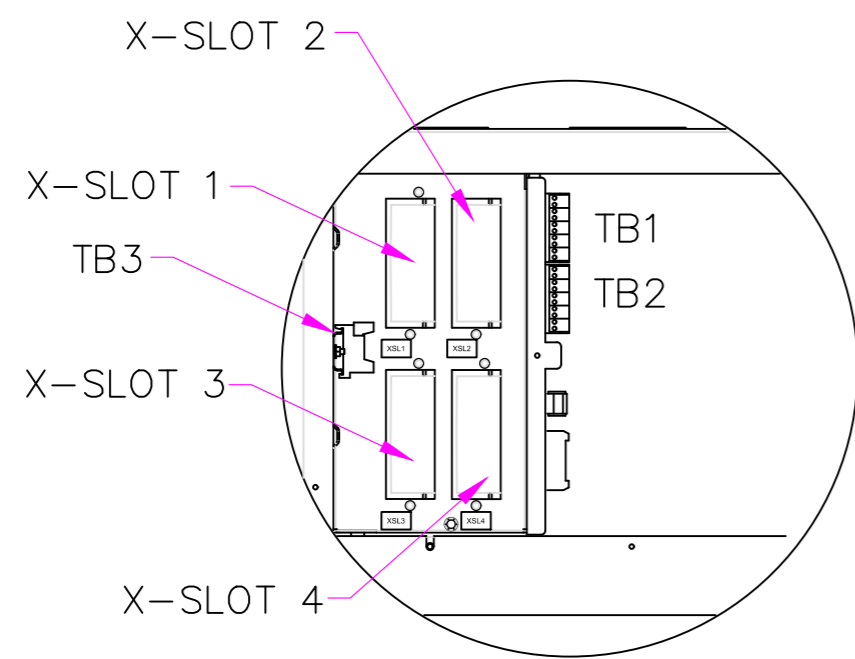

AC INPUT

- L1(E3)
- L2(E2)
- L3(E1)

UPS OUTPUT


- L1(E11)
- L2(E10)
- L3(E9)

BYPASS INPUT

- L1(E8)
- L2(E7)
- L3(E6)
- N(E12)

BATTERY CONNECTIONS

- +(E4)
- (E5)

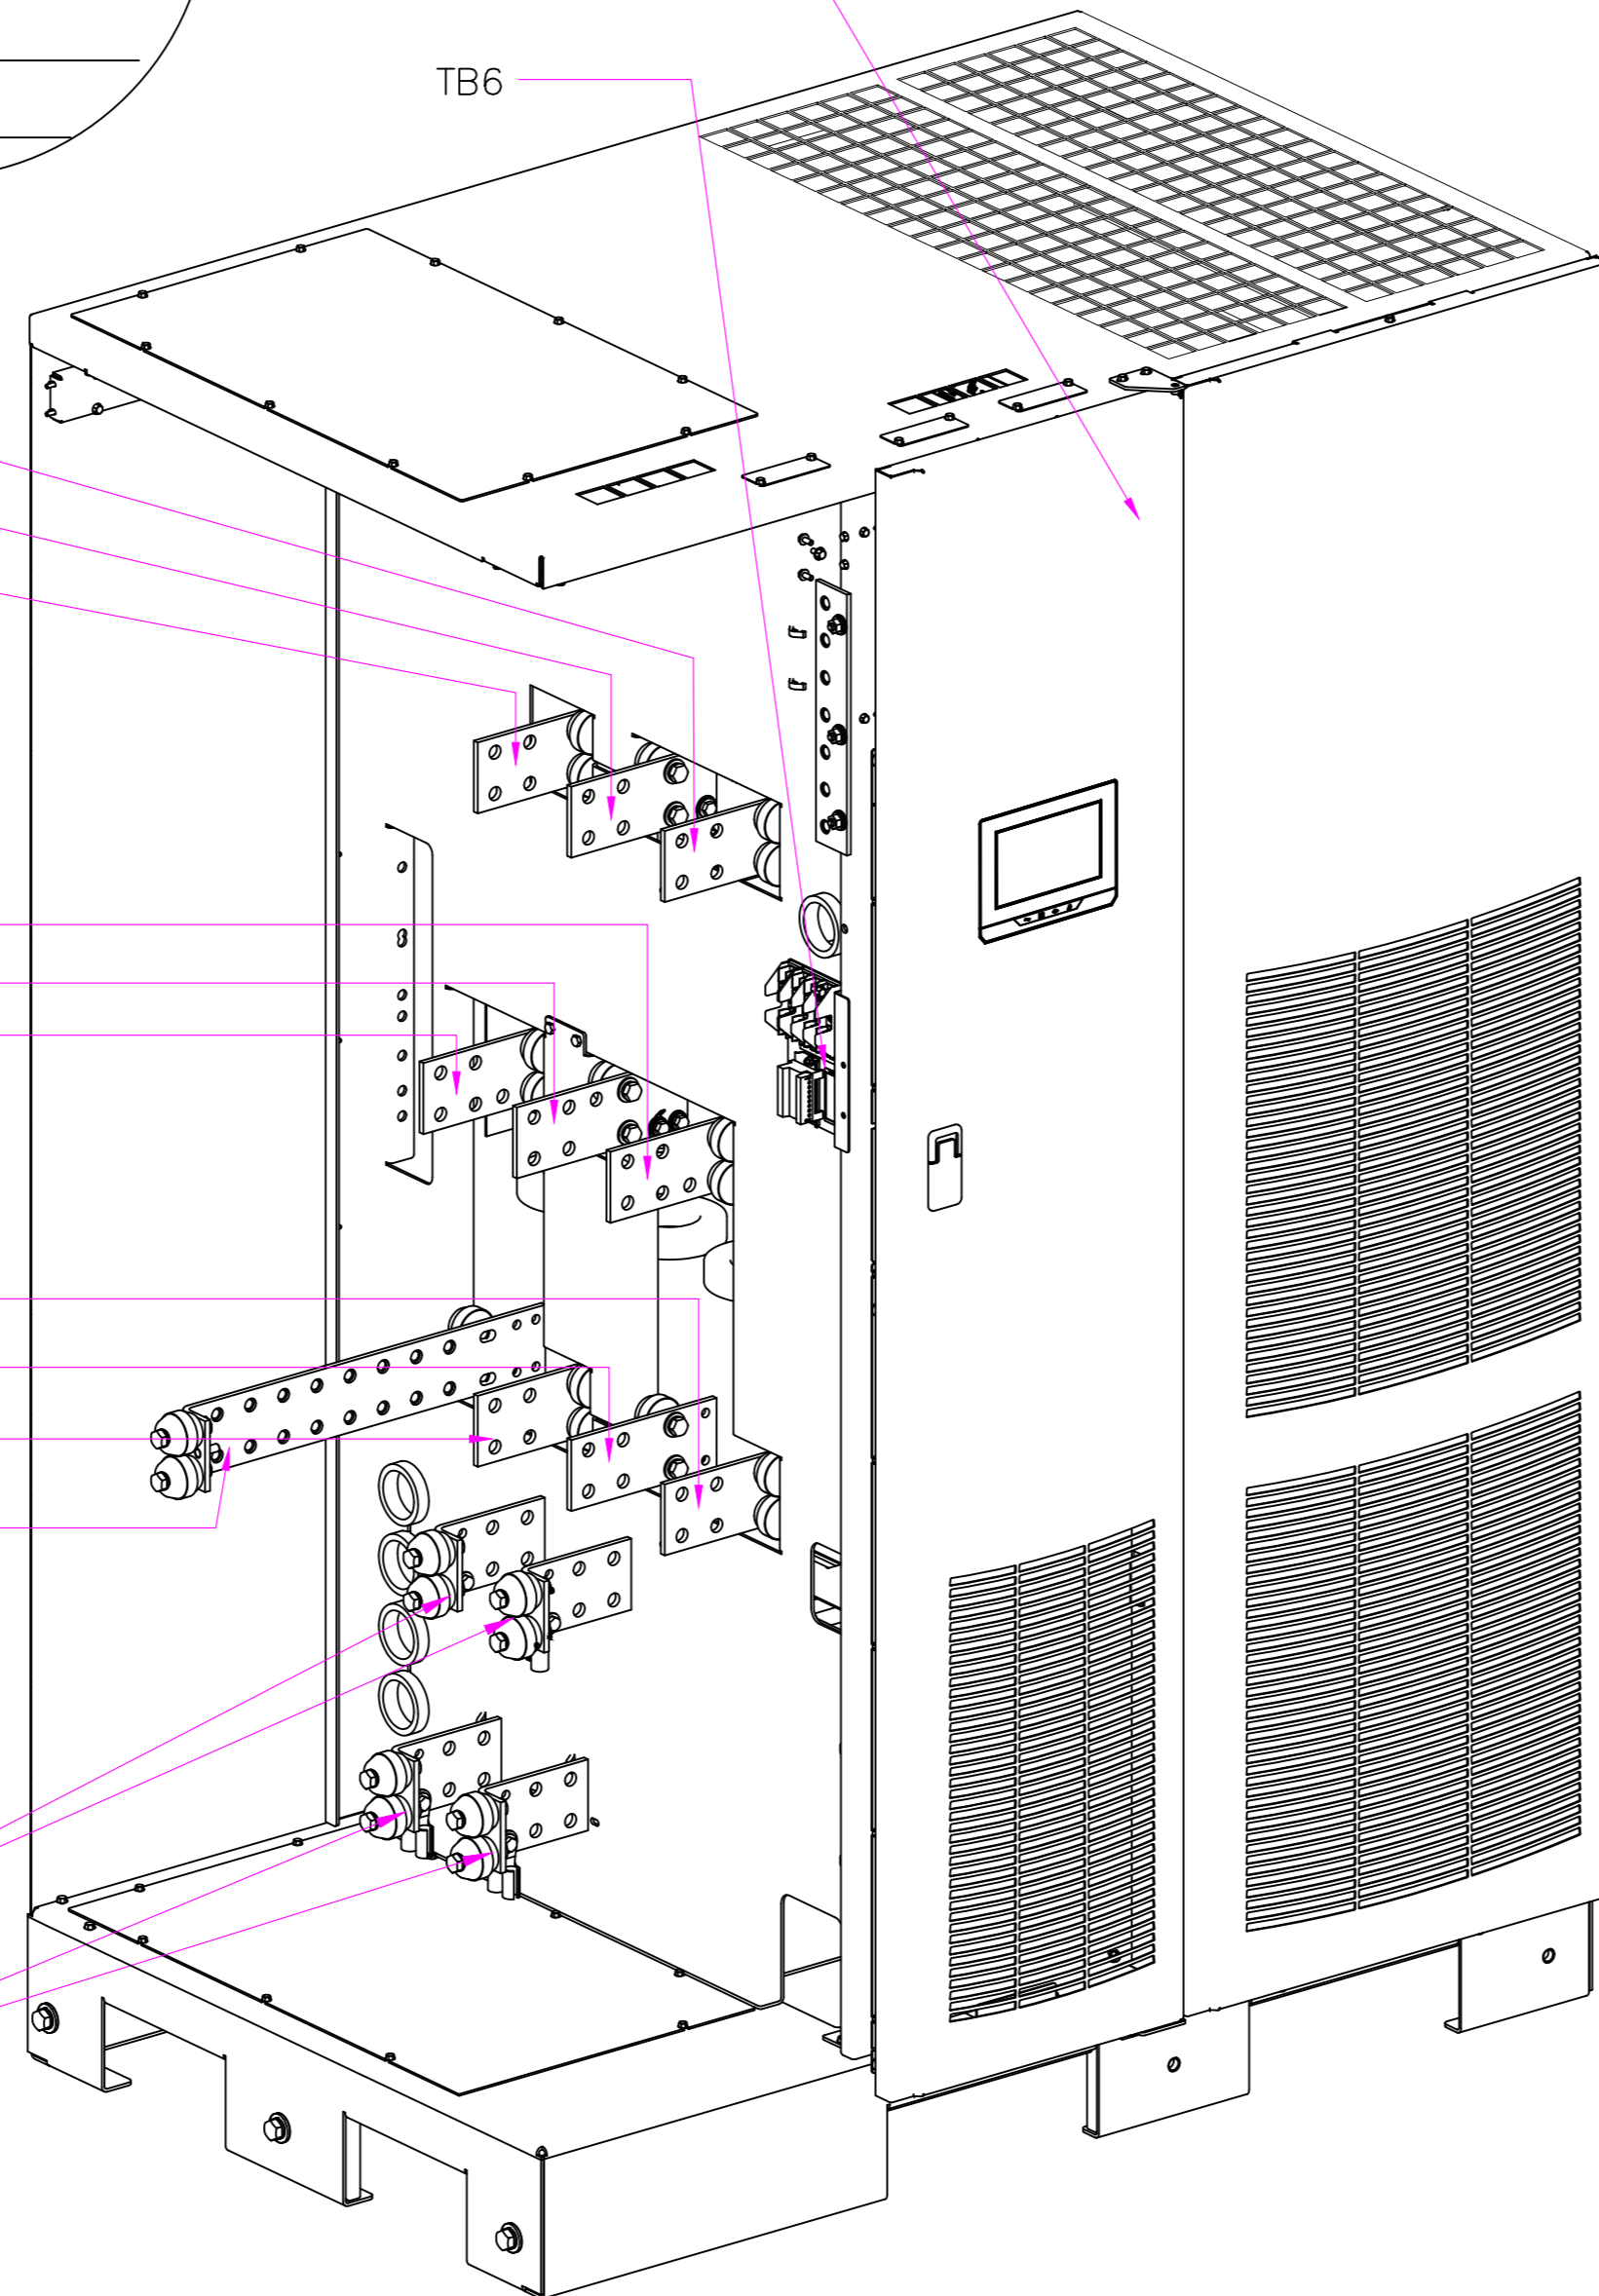

- TB1
- 1 REMOTE EPO NC
 - 2 REMOTE EPO NO RTN
 - 3 REMOTE EPO NO
 - 4 REMOTE EPO NO RTN
 - 5 BATT AUX
 - 6 BATT AUX RTN
 - 7 BATT SHUNT +
 - 8 BATT SHUNT -
 - 9 K3 NC AUX
 - 10 K3 NC AUX



- TB2
- 1 PULL CHAIN
 - 2 PULL CHAIN RTN
 - 3 ALRM RELAY NC
 - 4 ALRM RELAY RTN
 - 5 ALRM RELAY NO
 - 6 ALRM RELAY RTN

- TB3
- 1 BLDG ALARM 1
 - 2 BLDG ALARM 1 RTN
 - 3 BLDG ALARM 2
 - 4 BLDG ALARM 2 RTN
 - 5 BLDG ALARM 3
 - 6 BLDG ALARM 3 RTN
 - 7 BLDG ALARM 4
 - 8 BLDG ALARM 4 RTN
 - 9 BLDG ALARM 5
 - 10 BLDG ALARM 5 RTN

- TB6
- 1 BYP ϕ L1
 - 2 BYP ϕ L2
 - 3 BYP ϕ L3
 - 4 BYP ϕ N
 - 5 OUT ϕ L1
 - 6 OUT ϕ L2
 - 7 OUT ϕ L3
 - 8 SYNC ϕ L1
 - 9 SYNC ϕ L2
 - 10 SYNC ϕ L3



METRIC		EATON CORPORATION			
DIMENSIONS ARE IN MILLIMETERS AFTER PLATING, DIMENSIONS AND TOLERANCES IN ACCORDANCE WITH ASME Y14.5M-1994. SEE NOTES FOR TOLERANCES.					
DESCRIPTION: Power Xpert 9395P 250-300 kVA UPS Customer Connections					
ORIGINATED: ATIF RASHEED	27.04.2015	ECO:	NAME:	REVISION: 006	SIZE: A2
MODIFIED: Tuomas Avellan	23.03.2022	DOCUMENT TYPE: P-110000417	STATE: RELEASED	SHEET: 3 OF 6	SCALE: 1:16
CHECKED:		AUTOCAD DRAWING			
SAFETY:					
APPROVED:					

EATON CORPORATION - CONFIDENTIAL AND PROPRIETARY
 NOTICE TO PERSONS RECEIVING THIS DOCUMENT AND/OR TECHNICAL INFORMATION
 THIS DOCUMENT, INCLUDING THE DRAWING AND INFORMATION CONTAINED THEREIN, IS CONFIDENTIAL AND IS THE EXCLUSIVE PROPERTY OF EATON CORPORATION, AND IS SUBJECT TO RECALL BY EATON AT ANY TIME.
 BY TAKING POSSESSION OF THIS DOCUMENT, THE RECIENT ACKNOWLEDGES AND AGREES THAT THIS DOCUMENT CANNOT BE USED IN ANY MANNER ADVERSE TO THE INTERESTS OF EATON AND THAT NO PORTION OF THIS DOCUMENT MAY BE COPIED OR OTHERWISE REPRODUCED WITHOUT THE PRIOR WRITTEN CONSENT OF EATON. IN THE CASE OF CONFLICTING CONTRACTUAL PROVISIONS, THIS NOTICE SHALL GOVERN THE STATUS OF THIS DOCUMENT.
 © 2018 Eaton Corporation - All Rights Reserved.

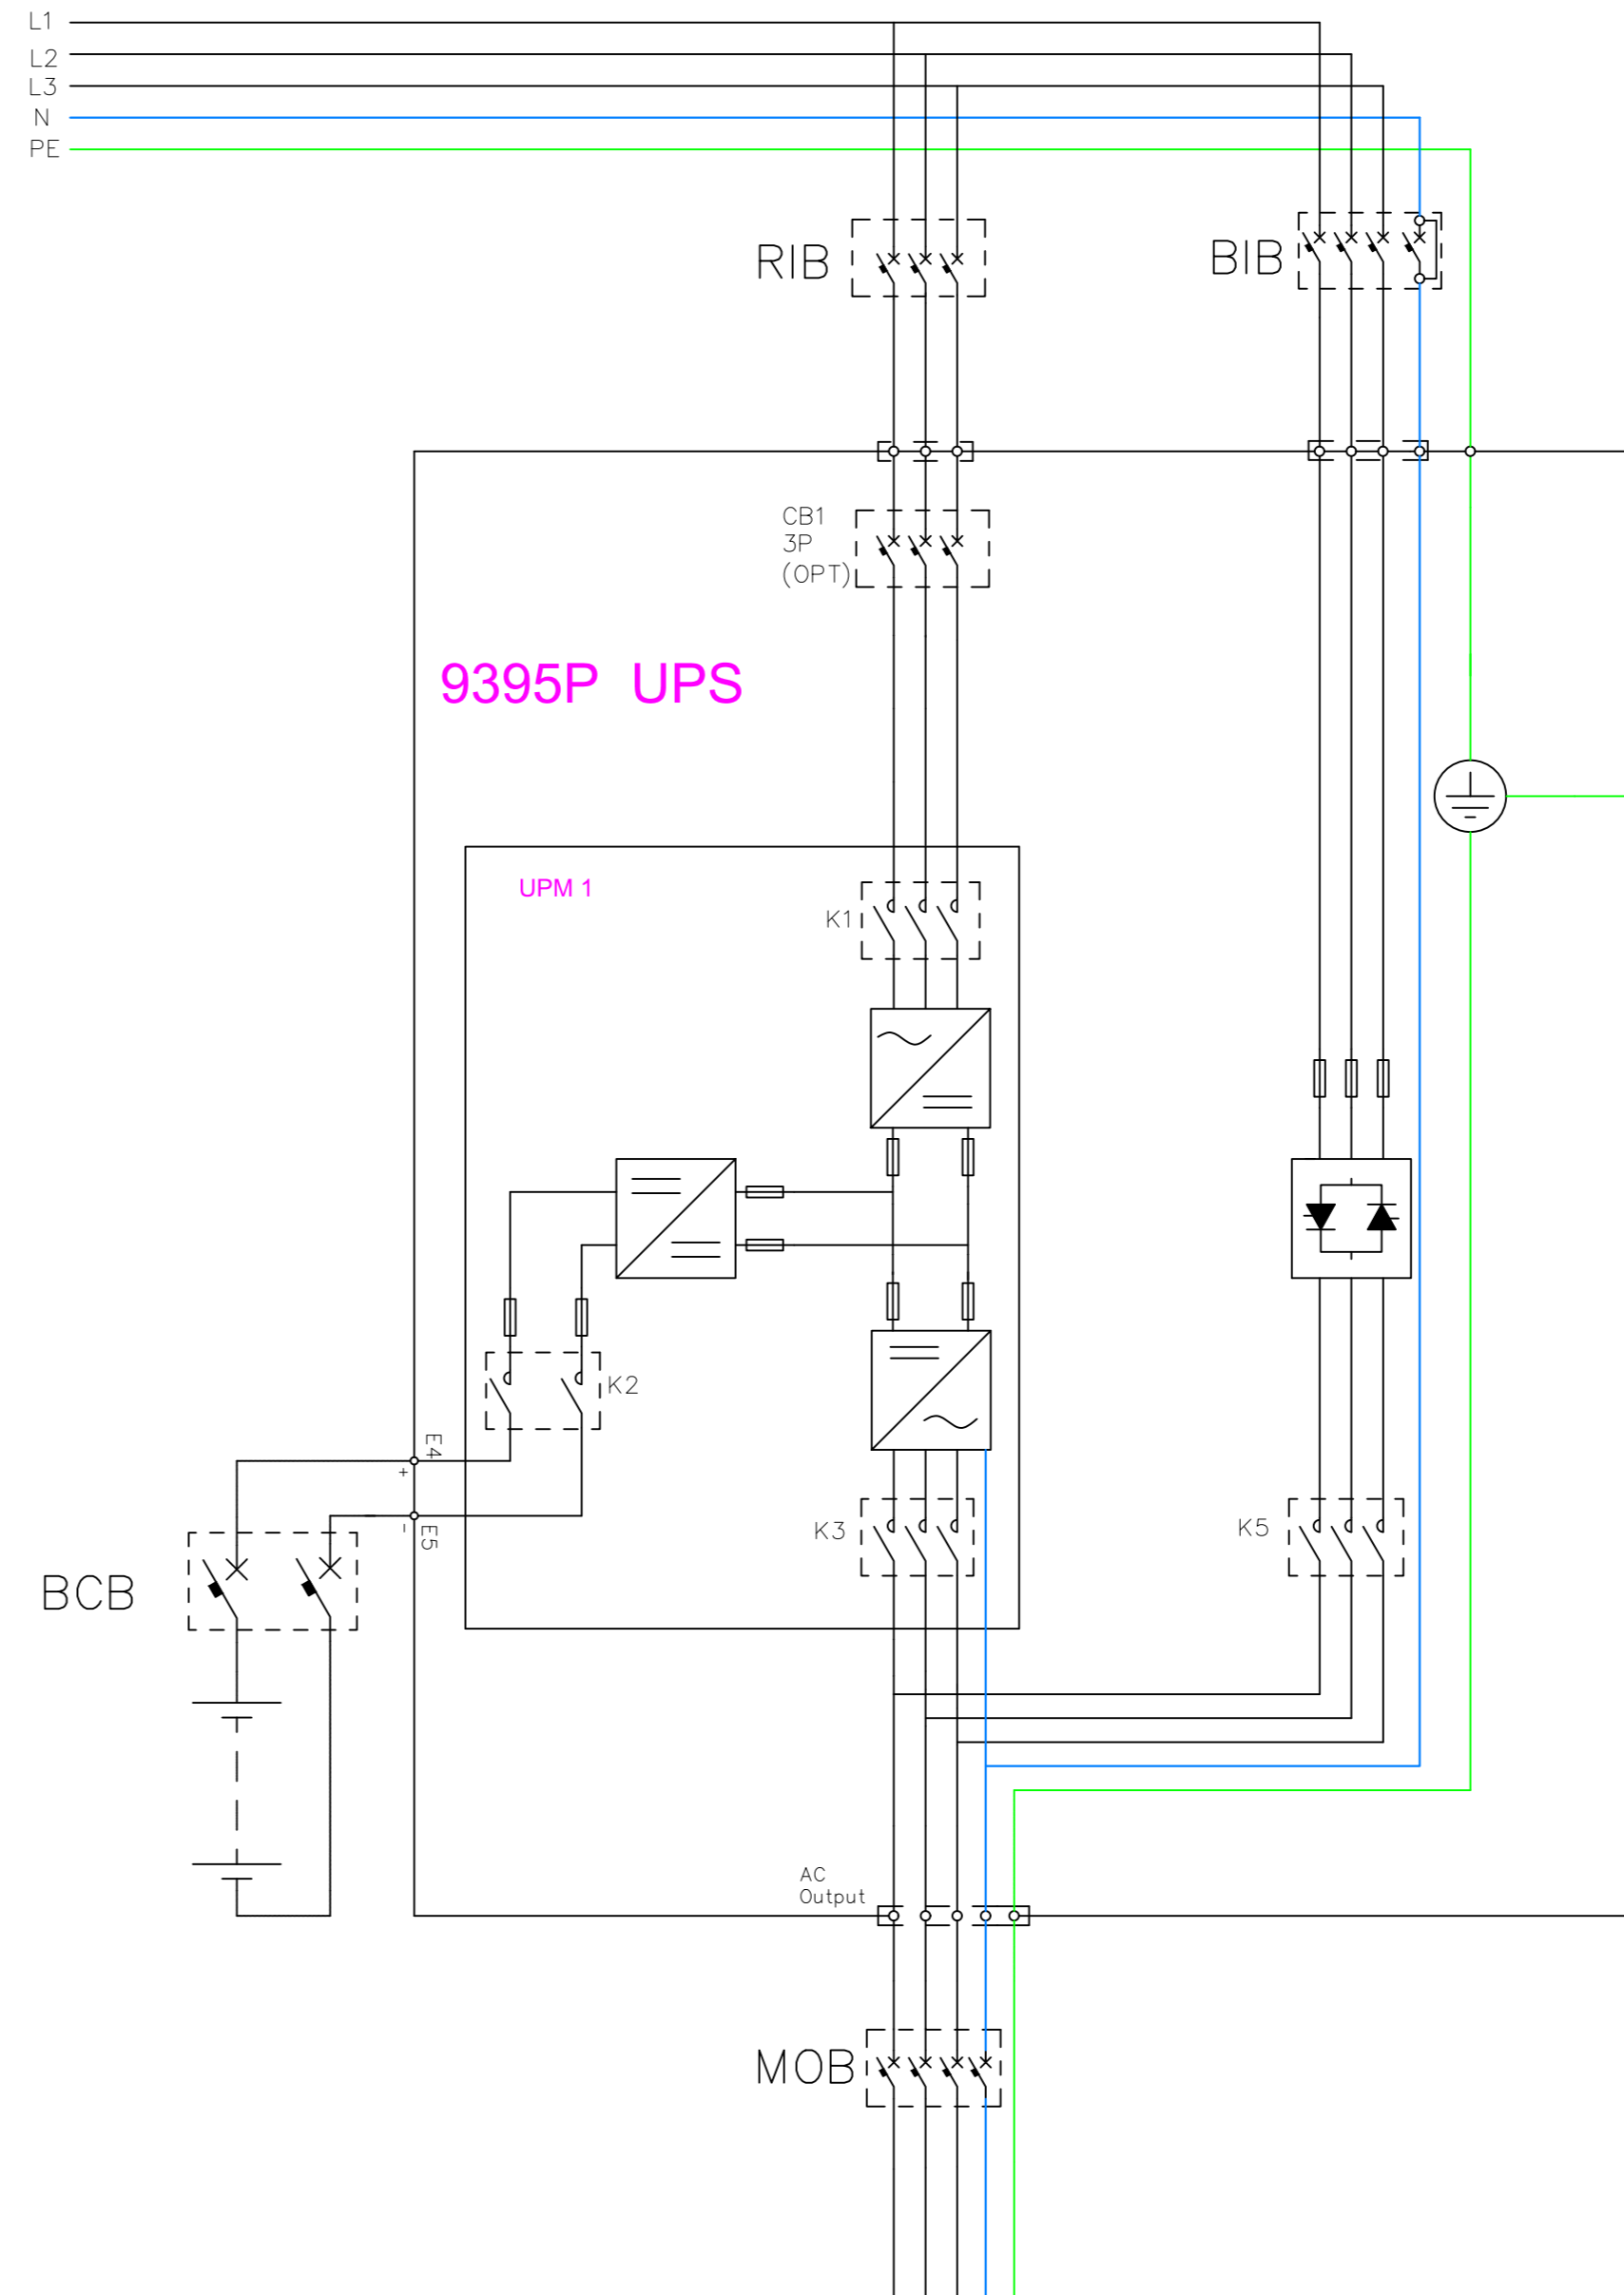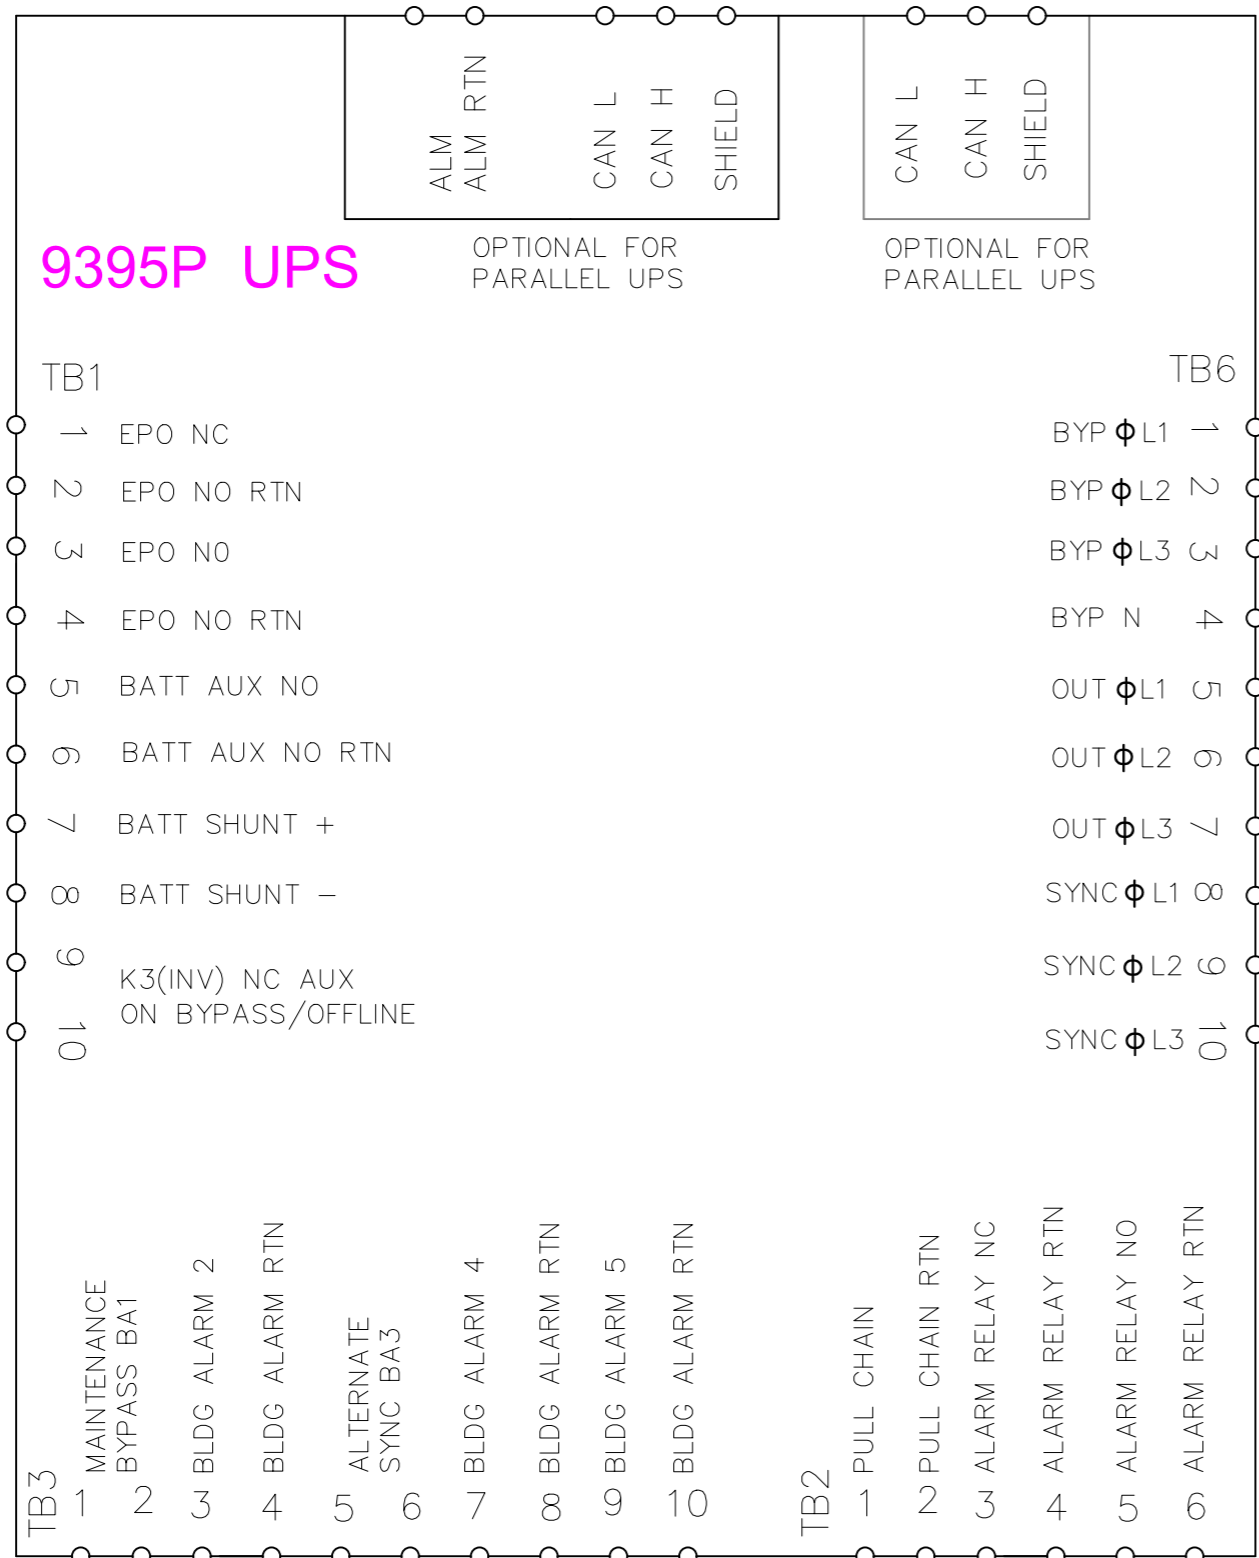

METRIC		THIRD ANGLE PROJECTION		EATON CORPORATION		EATON	
DIMENSIONS ARE IN MILLIMETERS AFTER PLATING, DIMENSIONS AND TOLERANCES IN ACCORDANCE WITH ASME Y14.5M-1994. SEE NOTES FOR TOLERANCES.							
DESCRIPTION: Power Xpert 9395P 250-300 kVA UPS Electrical Wiring							
ORIGINATED: ATIF RASHEED	27.04.2015	ECO:	NAME:	REVISION: 006	SIZE: A2		
MODIFIED: Tuomas Avellan	23.03.2022	DOCUMENT TYPE: AUTOCAD DRAWING	P-110000417		SCALE: N/A		
CHECKED:		SAFETY:		RELEASED	SHEET: 4 OF 6		
APPROVED:							

EATON CORPORATION - CONFIDENTIAL AND PROPRIETARY
 NOTICE TO PERSONS RECEIVING THIS DOCUMENT AND/OR TECHNICAL INFORMATION
 THIS DOCUMENT, INCLUDING THE DRAWING AND INFORMATION CONTAINED THEREON, IS CONFIDENTIAL AND IS THE EXCLUSIVE PROPERTY OF EATON CORPORATION, AND IS LOANED AND SUBJECT TO RECALL BY EATON AT ANY TIME.
 BY TAKING POSSESSION OF THIS DOCUMENT, THE RECIPIENT ACKNOWLEDGES AND AGREES THAT THIS DOCUMENT CANNOT BE USED IN ANY MANNER ADVERSE TO THE INTERESTS OF EATON AND THAT NO PORTION OF THIS DOCUMENT MAY BE COPIED OR OTHERWISE REPRODUCED WITHOUT THE PRIOR WRITTEN CONSENT OF EATON. IN THE CASE OF CONFLICTING CONTRACTUAL PROVISIONS, THIS NOTICE SHALL GOVERN THE STATUS OF THIS DOCUMENT.
 © 2018 Eaton Corporation - All Rights Reserved.

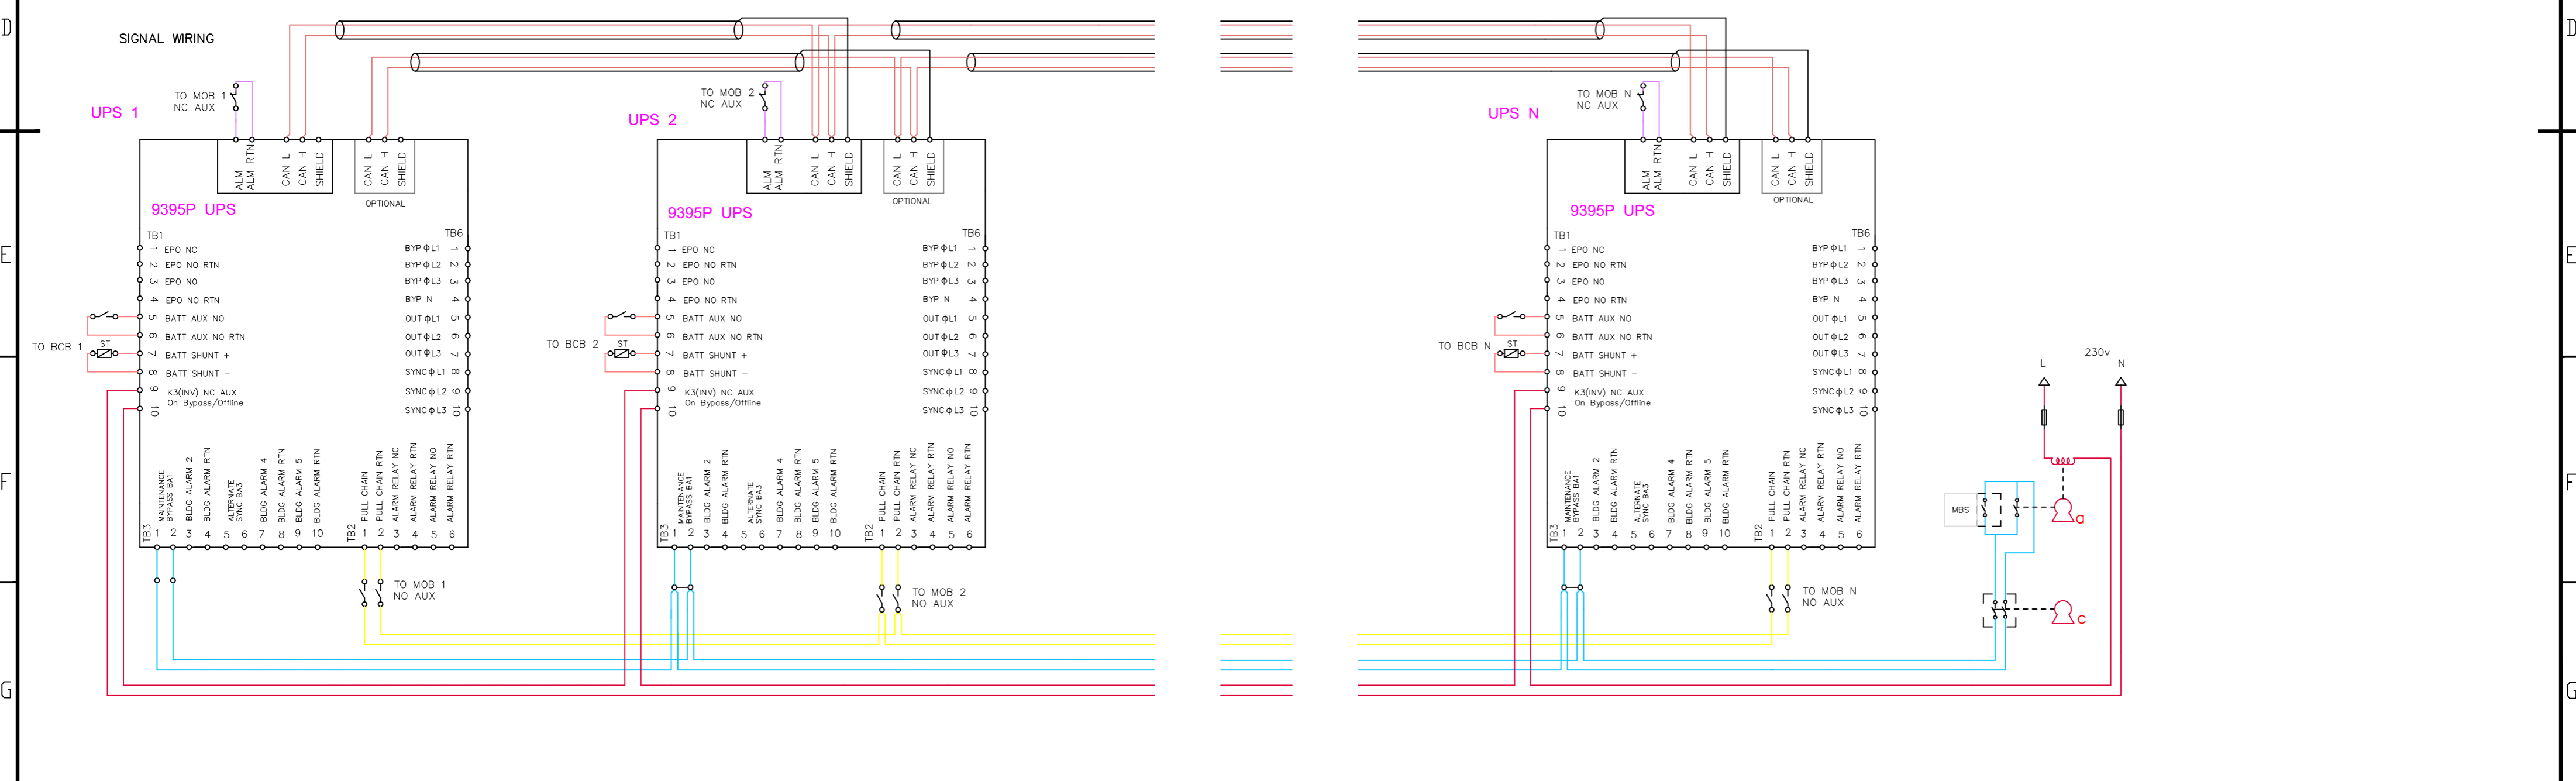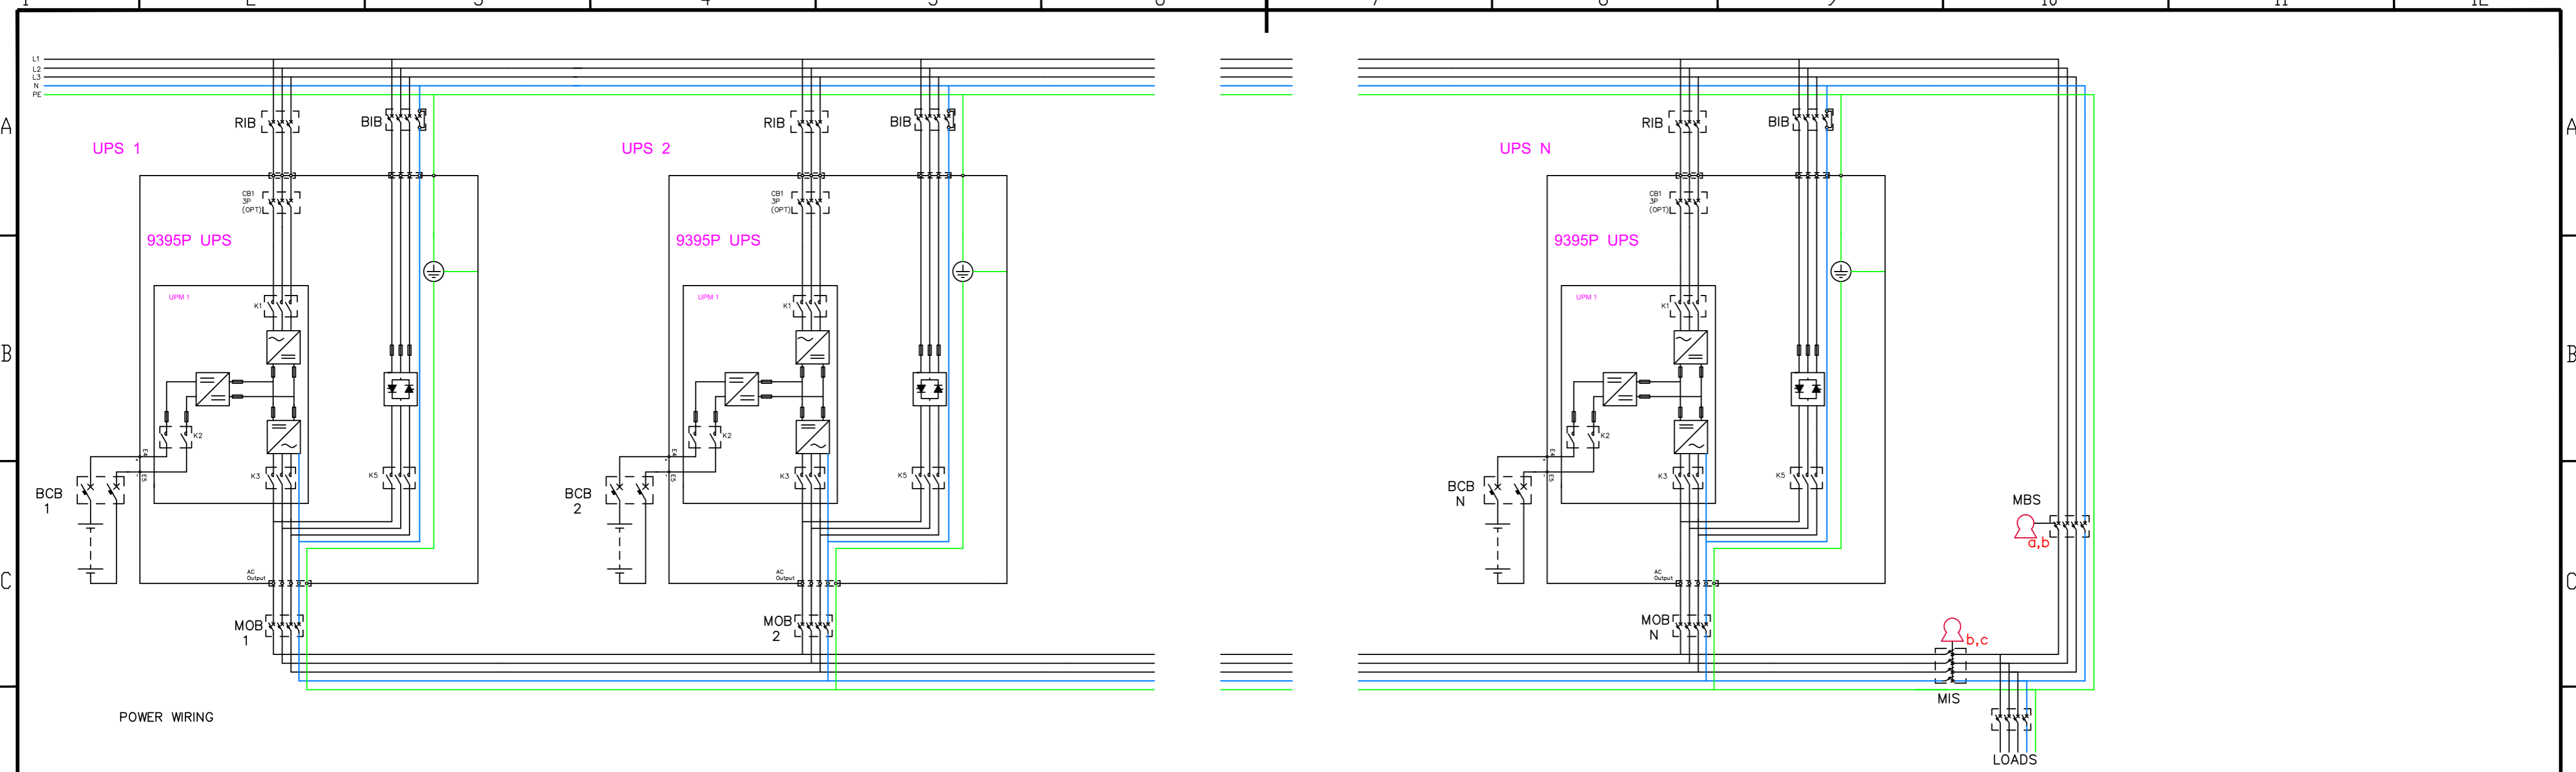

MBS STATUS (Provided by others, Installed by others)
0.75 - 2.5mm² twisted pair (if possible, else shielded)
No earth needed

MOB STATUS (Provided by others, Installed by others)
0.75 - 2.5mm² twisted pair (if possible, else shielded)
No earth needed

PCAN (DUAL AS OPTION)
Provided by Eaton, Installed by Eaton

PULL CHAIN (Redundant ON BYP STATUS)
Provided by Eaton, Installed by Eaton

ON BYPASS STATUS (NO INVERTORS ONLINE)
Provided by others, Installed by others
1.5 - 2.5mm², 600v

Mechanical bypass interlocking sequence

- Place UPS system to bypass. On bypass status (K3) will energize Key A solenoid to release it
- Removing key A will switch on "force bypass" to the UPS system
- Place key A to MBS breaker and close breaker. Key B will be released.
- Aux contact of MBS will keep "force bypass" on UPS system
- Place key B to MIS breaker and open MIS to isolate UPS system from load. Key C will be released
- Place key C to it's dedicated keyhole to release "force bypass" command to allow UPS system testing

METRIC THIRD ANGLE PROJECTION

EATON CORPORATION

DESCRIPTION: Power Xpert 9395P 250-300 kVA UPS Wiring Parallel Units

ORIGINATED: ATIF RASHEED	27.04.2015	ECO:	NAME:	REVISION: 006	SIZE: A2
MODIFIED: Tuomas Avellon	23.03.2022	DOCUMENT TYPE: P-110000417	AUTOCAD DRAWING	STATE: RELEASED	SCALE: N/A
CHECKED:					SHEET: 5 OF 6
SAFETY:					
APPROVED:					

EATON CORPORATION - CONFIDENTIAL AND PROPRIETARY
NOTICE TO PERSONS RECEIVING THIS DOCUMENT AND/OR TECHNICAL INFORMATION
THIS DOCUMENT, INCLUDING THE DRAWING AND INFORMATION CONTAINED THEREON, IS CONFIDENTIAL AND IS THE EXCLUSIVE PROPERTY OF EATON CORPORATION AND IS HEREBY ON LOAN AND SUBJECT TO RECALL BY EATON AT ANY TIME.
BY TAKING POSSESSION OF THIS DOCUMENT, THE RECIPIENT ACKNOWLEDGES AND AGREES THAT THIS DOCUMENT CANNOT BE USED IN ANY MANNER ADVERSE TO THE INTERESTS OF EATON AND THAT NO PORTION OF THIS DOCUMENT MAY BE COPIED OR OTHERWISE REPRODUCED WITHOUT THE PRIOR WRITTEN CONSENT OF EATON. IN THE CASE OF CONFLICTING CONTRACTUAL PROVISIONS, THIS NOTICE SHALL GOVERN THE STATUS OF THIS DOCUMENT.

© 2018 Eaton Corporation - All Rights Reserved.

Power Xpert 9395P 250-300 kVA UPS Site Planning Data

Product Specifications																	
UPS Rating		AC Input	3P Rectifier Input Breaker (RIB)		3P+Bolted N Bypass Input Breaker (BIB)			AC Output	4P Inverter AC output Breaker MOB			Battery Breaker (BCB) (Nominal ratings)			For Parallel Units Common Maintenance Bypass Switch (MBS)		
			Nominal Current	Maximum Current	Nominal Current at 400v Input	Maximum Current at 10% under voltage	Integrated Bypass Fuse		Output Current	Inverter Short Circuit Current	Auxiliary Switches	Rating	Common Battery Configuration (UPS Battery)	Trip Device (Shunt Trip)	Auxiliary Switches	Rating	Auxiliary Switches
KVA	KW	v	A	A	A	A	Type	v	A	A	Qty	VDC	A	VDC	Qty	A	Qty
250	250	400	447	455	361	398	170M4419 900A	400	361	760	2	600	555	48	1	435 x N	1
300	275	400	489	500	433	479	170M4419 900A	400	433	760	2	600	610	48	1	435 x N	1
300	300	400	506	506	433	479	170M4419 900A	400	433	760	2	600	666	48	1	N/A	N/A

Notes:

1. Rectifier AC input current calculations: Nominal – 100% load with full charging; Maximum – Rectifier current limit.
2. Inverter AC output current calculation: At 100% rated output load.
3. The system must be installed on a level floor suitable for computer or electronic equipment.
4. All wiring and installations must be in accordance with applicable national and local Electric Regulations.
5. AC input to UPS: (3) phases, (1) neutral, (1) ground.
AC output to load: (3) phases, (1) neutral, (1) ground.
DC input from battery to UPS: (1) positive, (1) negative, (1) ground.
6. All breakers should be adjusted according to the specified Ampere values to protect the UPS and installation.
7. For UPS installations that utilize single feed input the input breaker should be configured according to the rated rectifier input current.
8. Specifications are subject to change.

METRIC	THIRD ANGLE PROJECTION	EATON CORPORATION		
DIMENSIONS ARE IN MILLIMETERS AFTER PLATING, DIMENSIONS AND TOLERANCES IN ACCORDANCE WITH ASME Y14.5M-1994. SEE NOTES FOR TOLERANCES.				
DESCRIPTION: Power Xpert 9395P 250-300 kVA UPS Specifications				
ORIGINATED: ATIF RASHEED	27.04.2015	ECO:	NAME:	REVISION: 006
MODIFIED: Tuomas Avellan	23.03.2022	DOCUMENT TYPE: AUTOCAD DRAWING	P-110000417	STATE: RELEASED
CHECKED:				SCALE: N/A
SAFETY:				SHEET: 6 OF 6
APPROVED:				

EATON CORPORATION - CONFIDENTIAL AND PROPRIETARY
 NOTICE TO PERSONS RECEIVING THIS DOCUMENT AND/OR TECHNICAL INFORMATION
 THIS DOCUMENT, INCLUDING THE DRAWING AND INFORMATION CONTAINED THEREIN, IS CONFIDENTIAL AND IS THE EXCLUSIVE PROPERTY OF EATON CORPORATION, AND IS HEREBY ON LOAN AND SUBJECT TO RECALL BY EATON AT ANY TIME.
 BY TAKING POSSESSION OF THIS DOCUMENT, THE RECIPIENT ACKNOWLEDGES AND AGREES THAT THIS DOCUMENT CANNOT BE USED IN ANY MANNER ADVERSE TO THE INTERESTS OF EATON AND THAT NO PORTION OF THIS DOCUMENT MAY BE COPIED OR OTHERWISE REPRODUCED WITHOUT THE PRIOR WRITTEN CONSENT OF EATON. IN THE CASE OF CONFLICTING CONTRACTUAL PROVISIONS, THIS NOTICE SHALL GOVERN THE STATUS OF THIS DOCUMENT.
 © 2018 Eaton Corporation - All Rights Reserved.