



PLAN VIEW

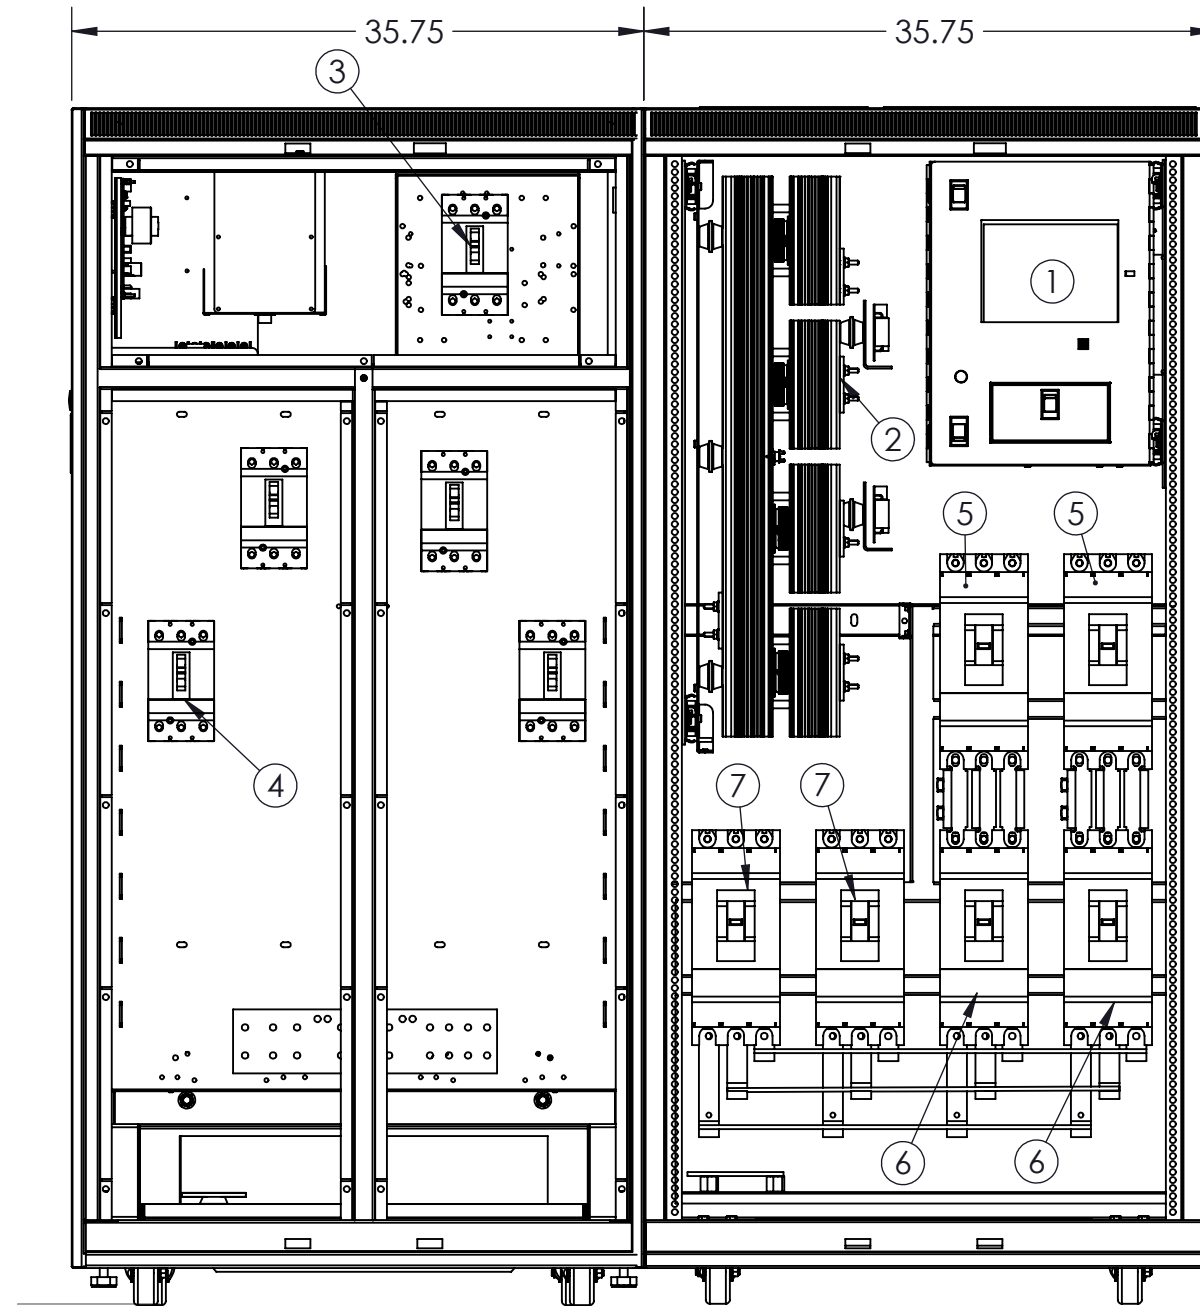

FRONT VIEW
(DOORS AND COVERS REMOVED)

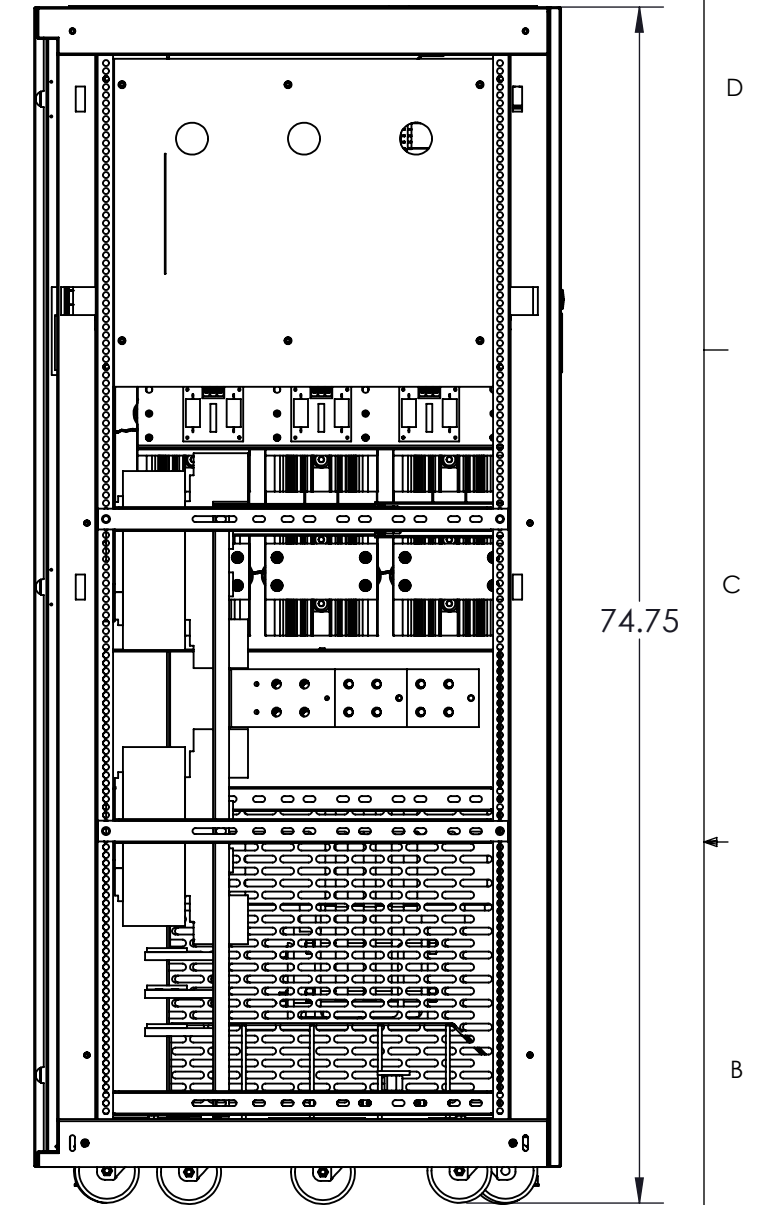

SIDE VIEW
(DOORS AND COVERS REMOVED)

NOTES:

1. OPERATOR INTERFACE PANEL.
2. SCR MODULE.
3. MAIN INPUT CIRCUIT BREAKER.
4. (4) SUB-FEED CIRCUIT BREAKER.
5. MOLDED CASE INPUT SWITCH.
6. MOLDED CASE BYPASS SWITCH
7. MOLDED CASE ISOLATION SWITCH
8. INPUT CABLE AREA TO BE PUNCHED
9. OUTPUT CABLE AREA TO BE PUNCHED
10. ALLOW A MINIMUM OF 21" CLEARANCE FOR FRONT DOOR SWING.
11. ALLOW A MINIMUM OF 21" CLEARANCE ON RIGHT FOR SIDECAR DOOR SWING.
12. RECOMMEND A MINIMUM OF 6" CLEARANCE BETWEEN WALL & VENTILATED SIDES FOR PROPER COOLING.

UNLESS OTHERWISE SPECIFIED:
 DIMENSIONS ARE IN INCHES
 [] IN MILLIMETER
 ANGULAR: $\pm 0.5^\circ$ BEND $\pm 1^\circ$
 TWO PLACE DECIMAL ± 0.02
 THREE PLACE DECIMAL ± 0.005

THIS DRAWING CONTAINS
 CONFIDENTIAL & PROPRIETARY
 INFORMATION AND SHALL NOT
 BE DISCLOSED OR COPIED
 WITHOUT THE EXPRESSED,
 WRITTEN PERMISSION OF
 SMITHS POWER



		DO NOT SCALE DRAWING	
APPROVALS		DATE	
DRAWN	MJP	09/29/16	
CHECKED			
ENG. APPR.			

TITLE: STATIC SWITCH PRIMARY SYSTEM 75kVA WITH (4) SUB-FEEDS		
SIZE B	DWG. NO. SSP21124	REV A
PART NO.		SHEET 1 OF 1