

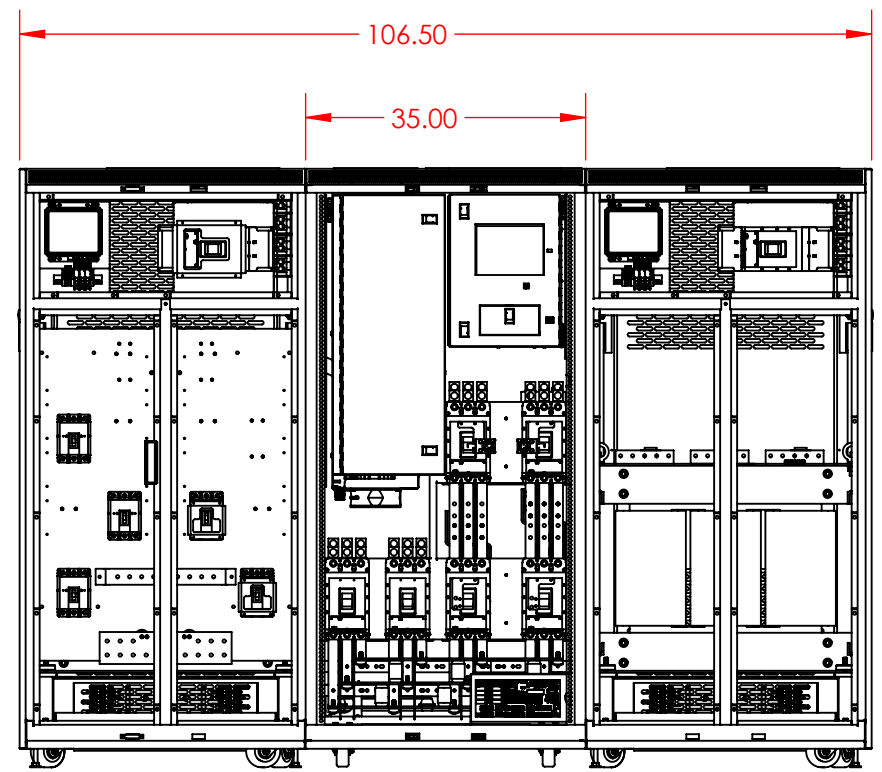
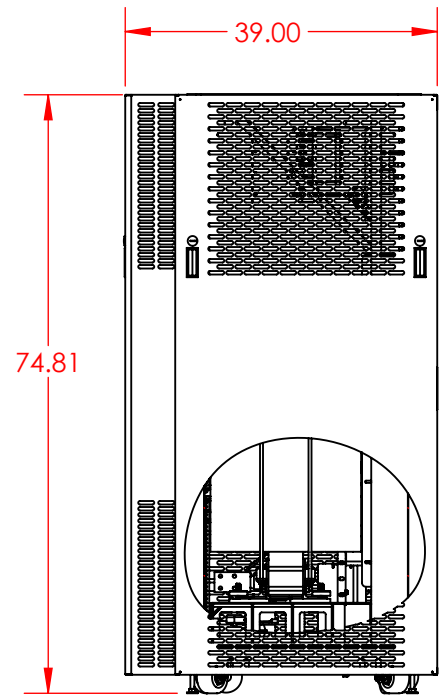


REVISIONS				
REV.	ECN #	DESCRIPTION	DATE	APPROVED
A		SUBMITTAL DRAWING	3/3/2021	SB

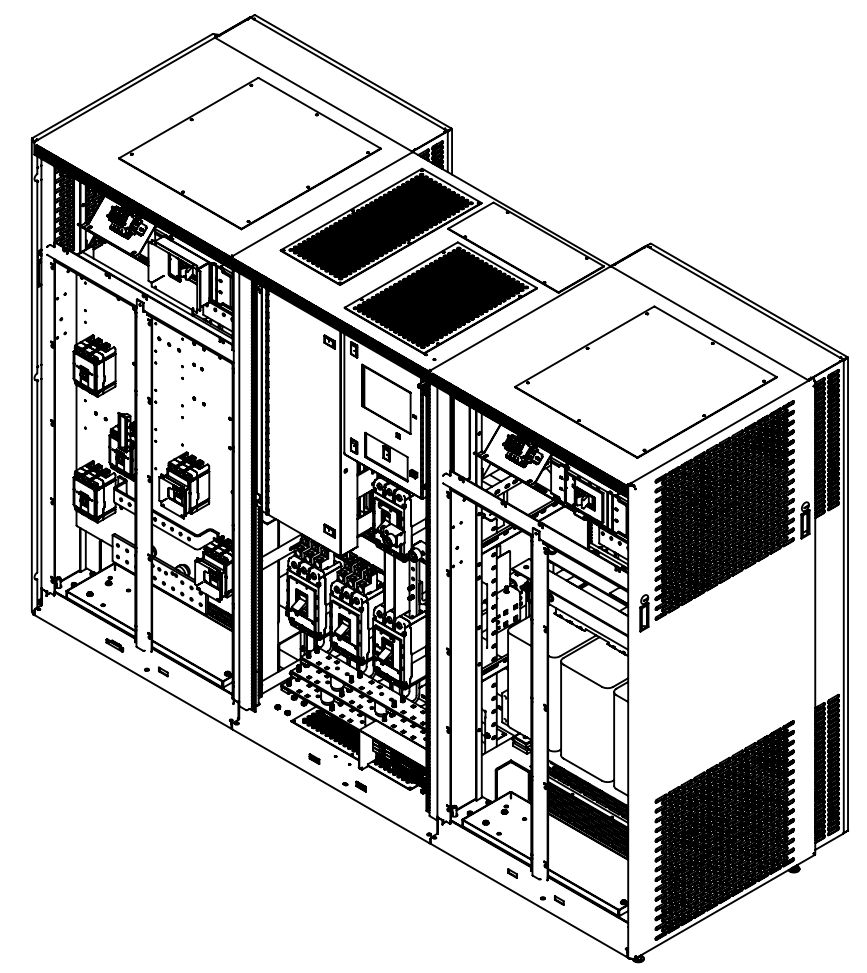

**DOORS & PANELS REMOVED FOR CLARITY**

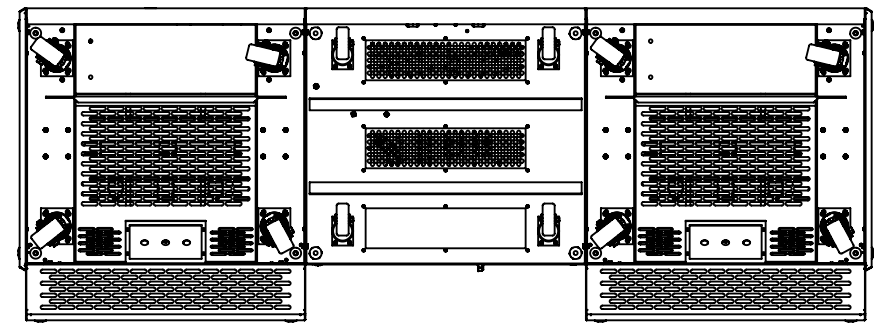

- NOTES:**
1. OPERATOR INTERFACE PANEL.
  2. SCR MODULE.
  3. MOLDED CASE INPUT SWITCH/CIRCUIT BREAKER.
  4. MOLDED CASE BYPASS SWITCH.
  5. MOLDED CASE ISOLATION SWITCH(2ND SWITCH).
  6. MAIN INPUT CIRCUIT BREAKER..
  7. ALLOW 36" CLEARANCE FOR FRONT DOOR SWING.
  8. ALLOW A MINIMUM OF 6" CLEARANCE FOR VENTILATION FOR PROPER COOLING.
  9. ACCESS TO REAR IS REQUIRED FOR INSTALATION.

UNLESS OTHERWISE SPECIFIED:  
DIMENSIONS AND TOLERANCES  
PER ASME Y14.5-2009

DIMENSIONS: INCHES  
TOLERANCES:  
ANGULAR (DEGREES): ± 0.5  
TWO PLACE DECIMAL: ± 0.02  
THREE PLACE DECIMAL: ± 0.005

		THIRD ANGLE PROJECTION
MATERIAL:		
APPROVALS		DATE
DRAWN BY	SB	3/3/2021
CHECKED BY	ER	3/3/2021

		THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED WRITTEN PERMISSION OF POWER DISTRIBUTION, INC.	
1 804 737 9880		DESCRIPTION:	
600A STS, (2) 200KVA PP1			
SIZE	DWG. NO.	REV	
<b>B</b>	SSS73279SUB	A	
SCALE:	NTS	SHEET 1 OF 1	