



**NOTES:**

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. 1-6 (50-250A) SUBFEEDS.
4. BCMS LOCAL MONITOR.
5. RECOMMEND A MINIMUM OF 30" IN REAR OR SIDE OF UNIT FOR MAINTENANCE.
6. MINIMUM OF 36" CLEARANCE FOR DOOR SWING.
7. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.
8. BCMS MOTHERBOARDS BEHIND SIDE PANEL.

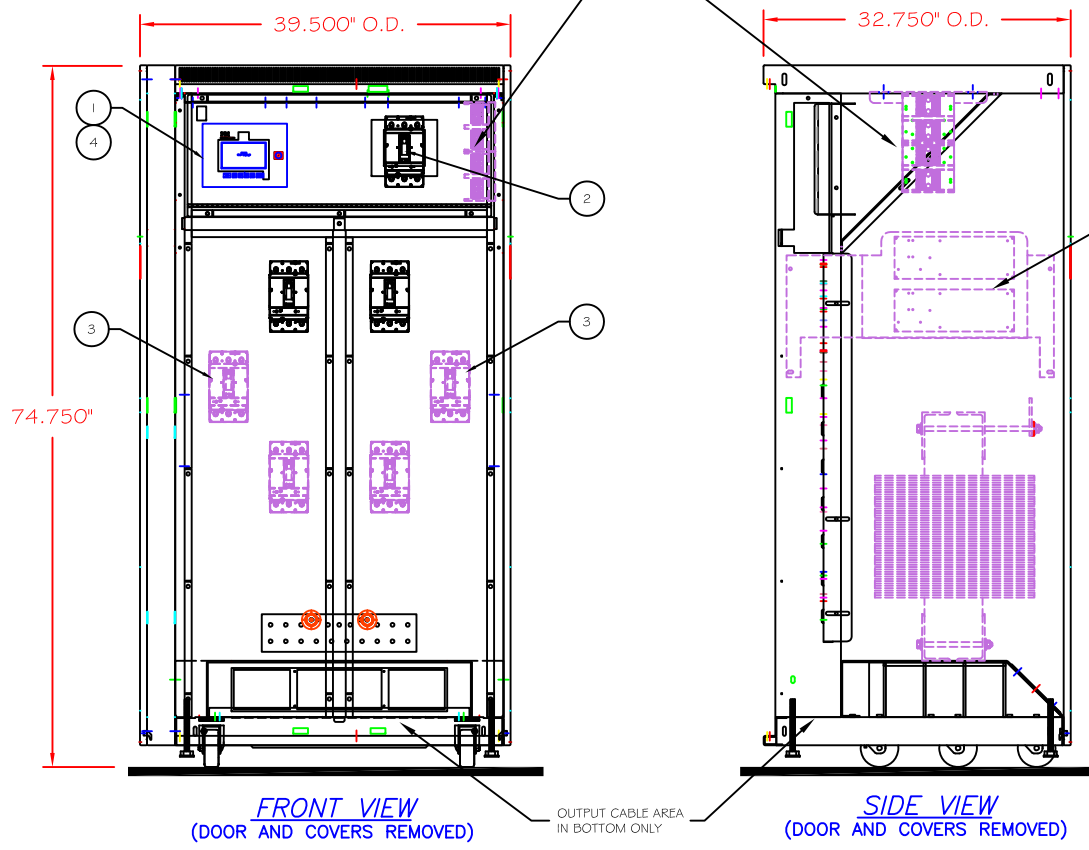

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		TITLE		-OUTLINE-	
				POWER-PAK PDU (30-150 kVA)	
				1-6 (50-250A) SUB-FEEDS	
		DWG. NUMBER	SHEET 1 OF 1	REVISION	
DWG11005-3-BCMS-39		-A-			
DRAWN BY	RAE	CHECKED BY	LN	 creating the perfect wave	
DATE	06-11-15	DATE	06-11-15		