



PLAN VIEW

NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. 225A SECONDARY MAIN CIRCUIT BREAKER.
4. (42) POLE DISTRIBUTION PANELBOARDS.
5. 1-3 (50-250A) SUBFEEDS.
6. RECOMMEND A MINIMUM OF 30" IN REAR OR SIDE OF UNIT FOR MAINTENANCE.
7. MINIMUM OF 36" CLEARANCE FOR DOOR SWING.
8. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.

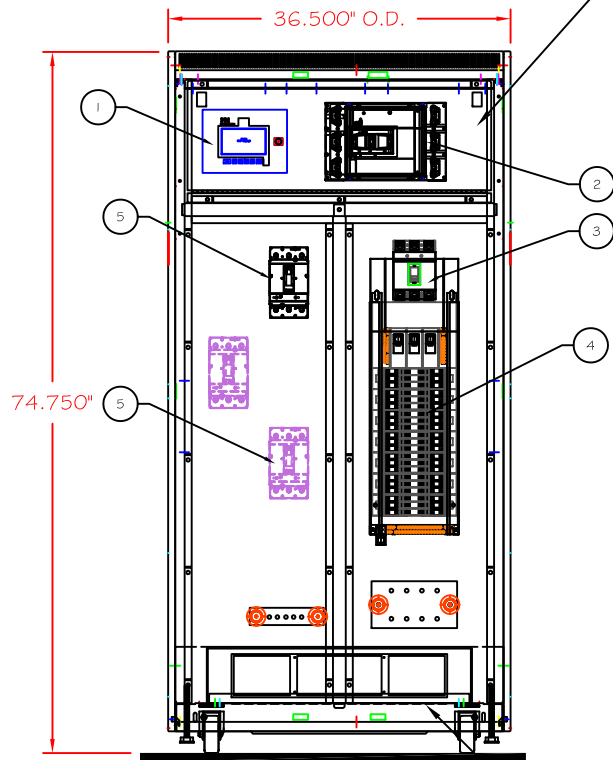


FRONT VIEW
(DOOR AND COVERS REMOVED)

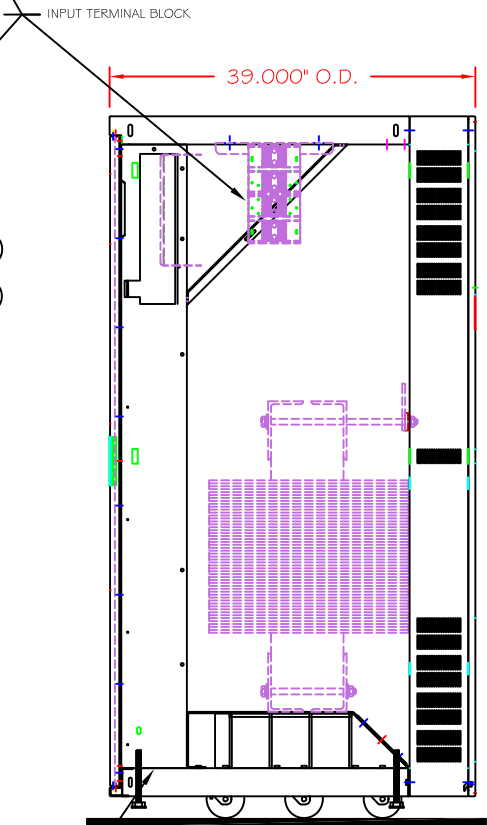

SIDE VIEW
(COVERS REMOVED)

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.	TITLE		-OUTLINE-	
	POWER-PAK PDU (200-300 kVA)		(PDU-35-S4)	
	(1) 42 POLE PANEL BOARD		1-3 (50-250A) SUBFEEDS	
	DWG. NUMBER	SHEET 1 OF 1	REVISION	
DWG11008		-B-		
DRAWN BY	RAE	CHECKED BY	KRH	
DATE	6-15-15	DATE	6-15-15	



PDI
creating the perfect wave