


NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. 225A SECONDARY MAIN CIRCUIT BREAKER.
4. (42) POLE DISTRIBUTION PANELBOARDS.
5. RECOMMEND A MINIMUM OF 30" IN REAR OR SIDE OF UNIT FOR MAINTENANCE.
6. MINIMUM OF 18" CLEARANCE FOR DOOR SWING IN FRONT.
7. MINIMUM OF 32" CLEARANCE FOR DOOR SWING ON SIDE.
8. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.



<p>THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.</p>	TITLE		-OUTLINE-	
	PDU (30-150 kVA)		W/ RH SIDECAR	
	(3-4) 42 POLE PANEL BOARDS			
	DWG. NUMBER	SHEET 1 OF 1	REVISION	
DWG11011		-A-		
DRAWN BY	RAE	CHECKED BY	DAS	
DATE	09-10-09	DATE	01-16-13	

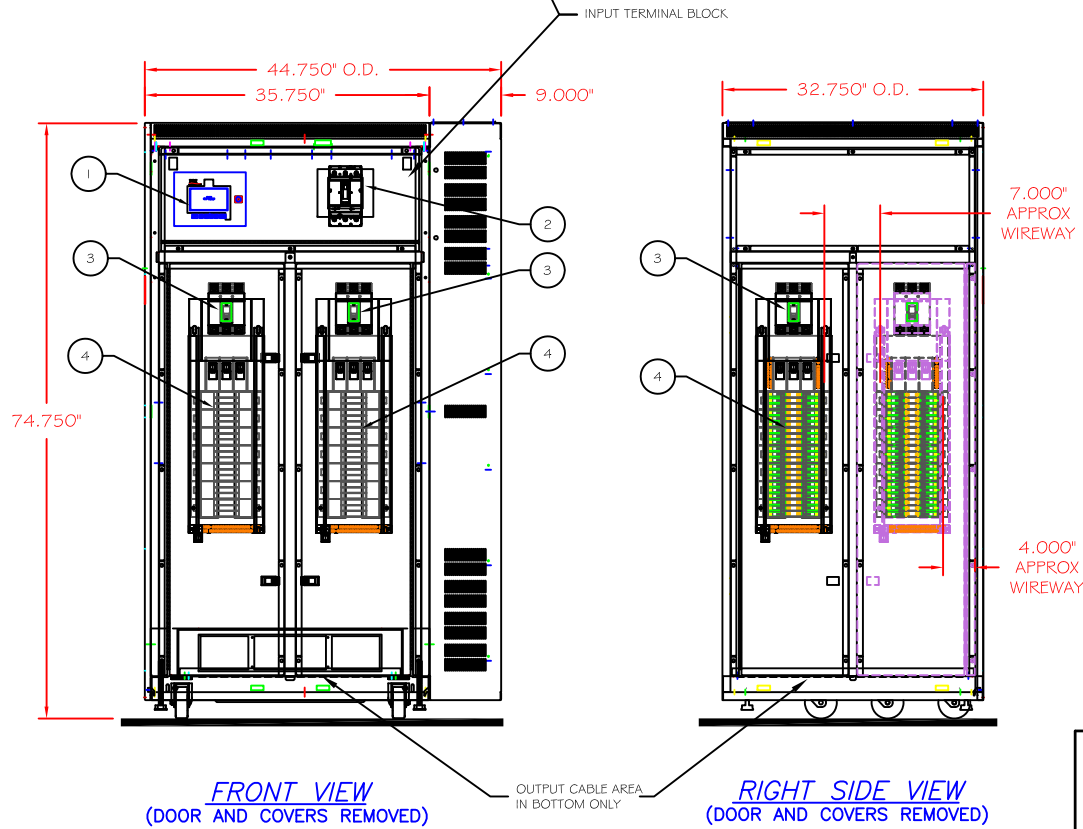