
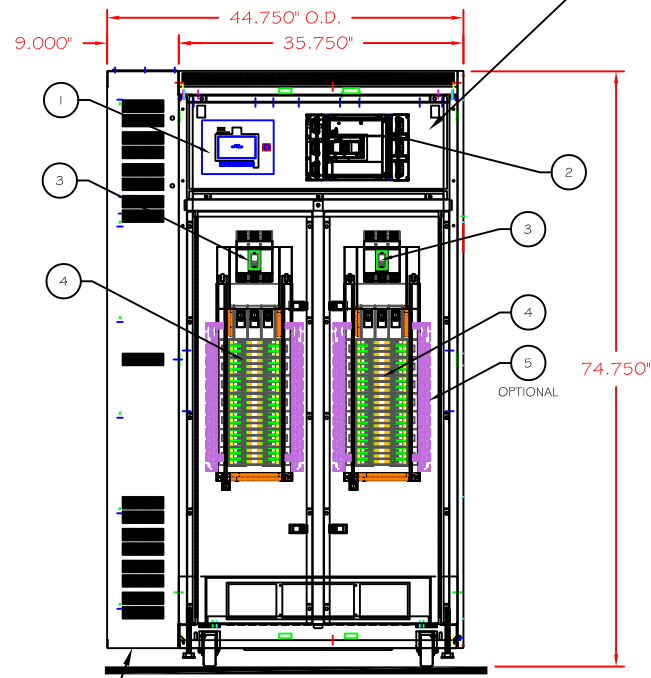
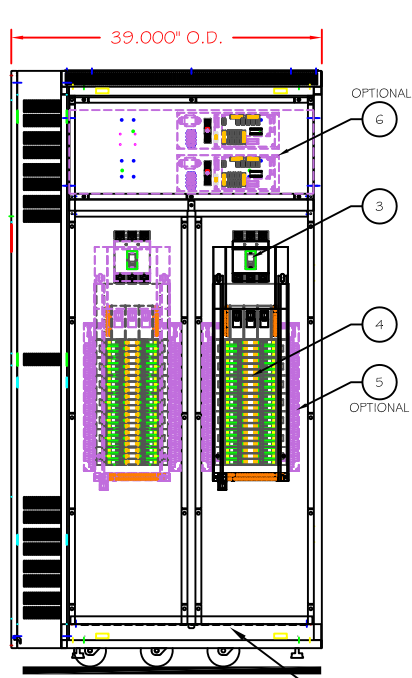



NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. 225A SECONDARY MAIN CIRCUIT BREAKER.
4. (42) POLE DISTRIBUTION PANELBOARDS.
5. CT STRIP FOR BCMS (OPTIONAL).
6. BCMS CIRCUIT BOARD (OPTIONAL).
7. RECOMMEND A MINIMUM OF 30" IN REAR OR SIDE OF UNIT FOR MAINTENANCE.
8. MINIMUM OF 36" CLEARANCE FOR DOOR SWING IN FRONT.
9. MINIMUM OF 36" CLEARANCE FOR DOOR SWING ON SIDE.
10. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.

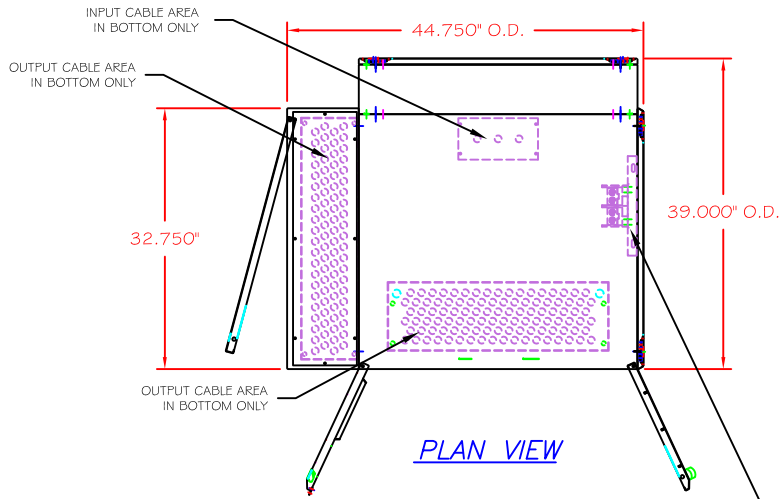

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		TITLE		-OUTLINE-		
		PDU (200-300 kVA) W/ LH SIDECAR (3-4) 42 POLE PANEL BOARDS				
		DWG. NUMBER	SHEET 1 OF 1	REVISION		
		DWG11014		-A-		
DRAWN BY	RAE	CHECKED BY	KRH			
DATE	03-13-06	DATE	03-13-06			
				 PDI creating the perfect wave		