



NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. 225A SECONDARY MAIN CIRCUIT BREAKER.
4. (42) POLE DISTRIBUTION PANELBOARDS.
5. CT STRIP FOR BCMS (OPTIONAL).
6. 1 (50-225A) SUBFEED.
7. RECOMMEND A MINIMUM OF 30" IN REAR OR SIDE OF UNIT FOR MAINTENANCE.
8. MINIMUM OF 36" CLEARANCE FOR DOOR SWING.
9. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.
10. BCMS CIRCUIT BOARD (OPTIONAL).



THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		TITLE		-OUTLINE-		
		PDU (200-300 kVA) W/ LH FS SIDECAR		(4) 42 POLE PANEL BOARDS & 1 (50-225A) SUBFEED		
		DWG. NUMBER	SHEET 1 OF 1	REVISION		
		DWG11026-1SF		-A-		
DRAWN BY	RAE	CHECKED BY	MP			
DATE	11-19-15	DATE	11-19-15			

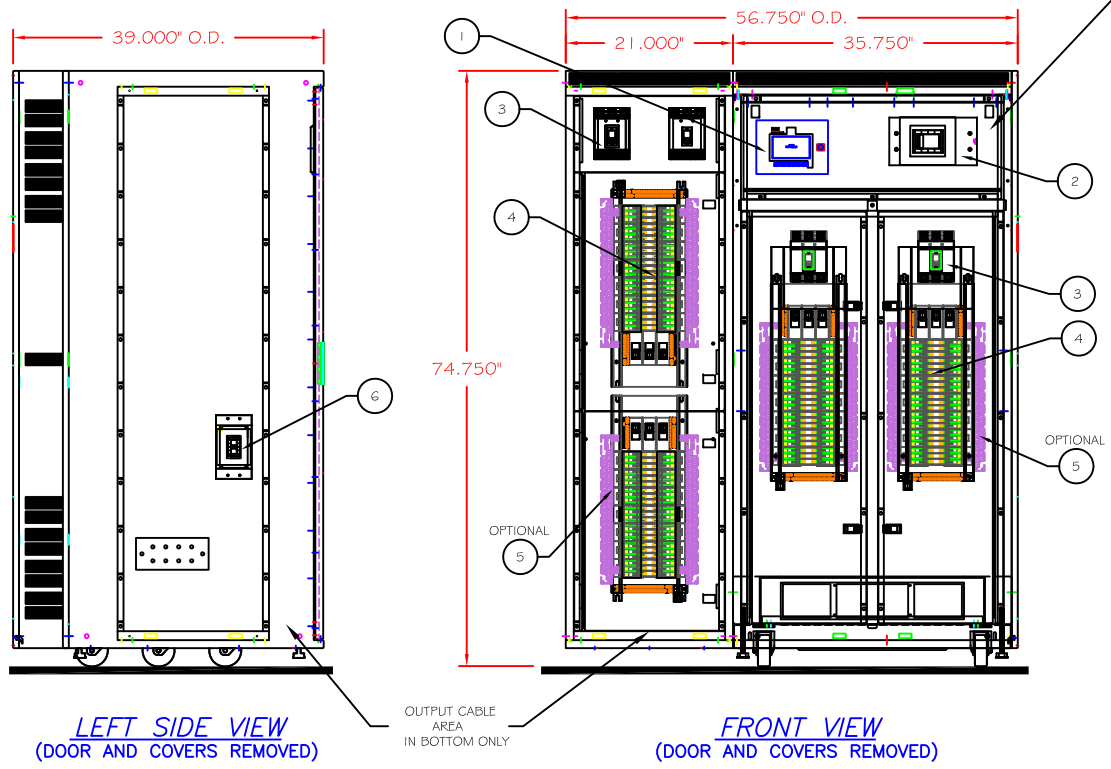

PDI
creating the perfect wave