


NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. 225A SECONDARY MAIN CIRCUIT BREAKER.
4. (42) POLE DISTRIBUTION PANELBOARDS.
5. CT STRIP FOR BCMS (OPTIONAL).
6. MINIMUM OF 36" CLEARANCE FOR DOOR SWING.
7. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.
8. BCMS CIRCUIT BOARD (OPTIONAL).

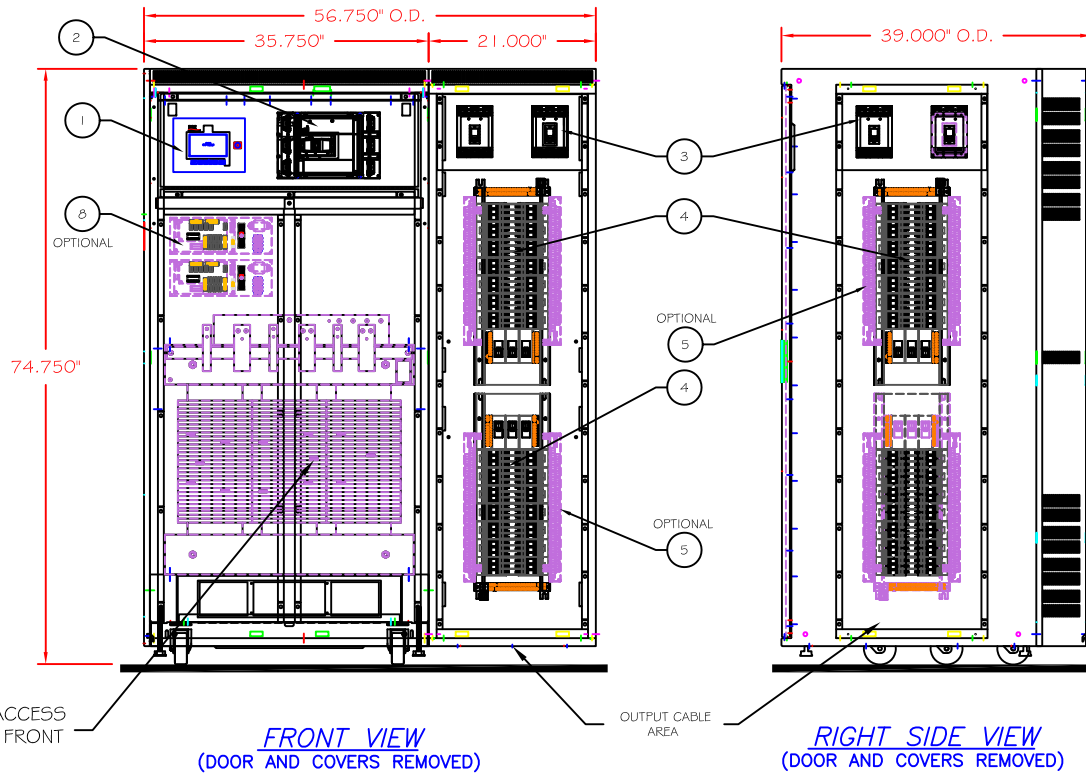

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.

TITLE			-OUTLINE-		
PDU (200-300 kVA)			W/ RH FS SIDECAR		
FRONT ACCESS W/(4) 42P PANEL BOARDS W/BCMS OPTION					
DWG. NUMBER	SHEET 1 OF 1	REVISION			
DWG11045-TE		-A-			
DRAWN BY	RAE	CHECKED BY	LN		
DATE	6-22-15	DATE	6-22-15		

PDI
creating the perfect wave