


NOTES:


1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. 1-6 (50-250A) 100% RATED SUBFEED BREAKERS.
4. BCMS MOTHERBOARDS.
5. MINIMUM OF 36" CLEARANCE FOR DOOR SWING.
6. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.

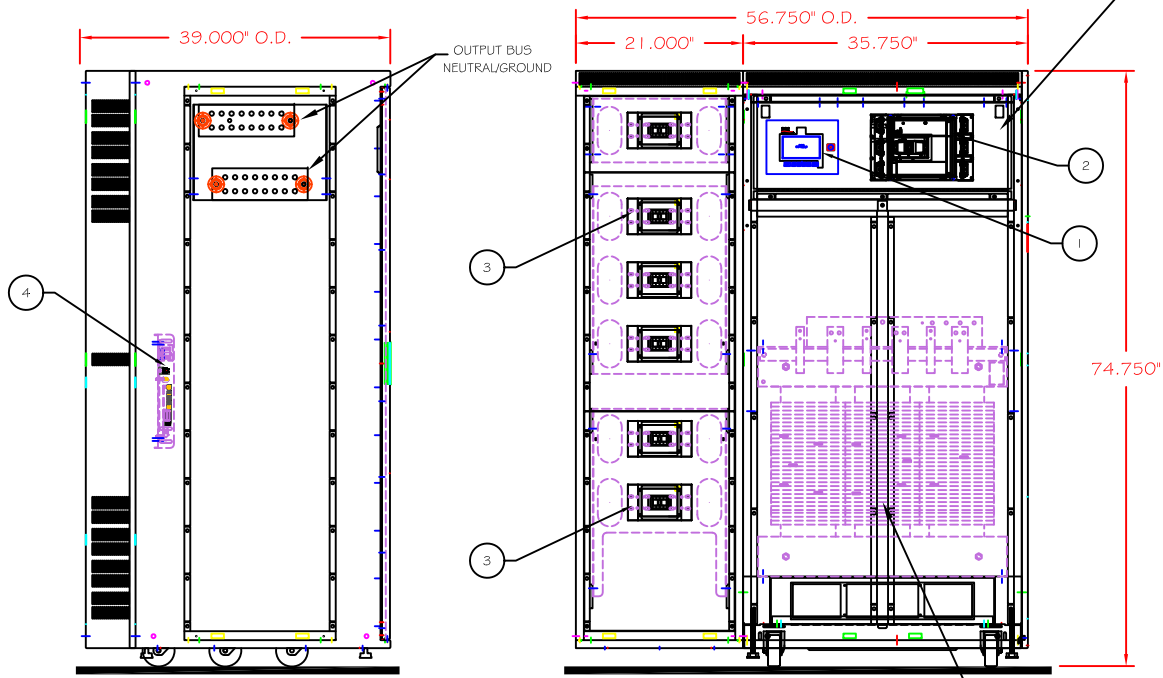

LEFT SIDE VIEW
(DOOR AND COVERS REMOVED)

FRONT VIEW
(DOOR AND COVERS REMOVED)

<p>THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.</p>		TITLE	
		-OUTLINE-	
		PDU (200-300 kVA) W/ LH FS SIDECAR	
		FRONT ACCESS W/ 1-6 (50-250A) SUBFEED BREAKERS	
DWG. NUMBER	SHEET 1 OF 1	REVISION	
DWG11051-CORESITE-C		-A-	
DRAWN BY	RAE	CHECKED BY	KRH
DATE	6-28-15	DATE	6-28-15



PDI
creating the perfect wave