


NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. 1-6 (50-250A) SUBFEEDS (BCMS OPTIONAL).
4. FRONT ACCESS.
5. MINIMUM OF 36" CLEARANCE FOR DOOR SWING IN FRONT.
6. MINIMUM OF 36" CLEARANCE FOR DOOR SWING ON SIDE.
7. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.
8. BCMS CIRCUIT BOARD (OPTIONAL).

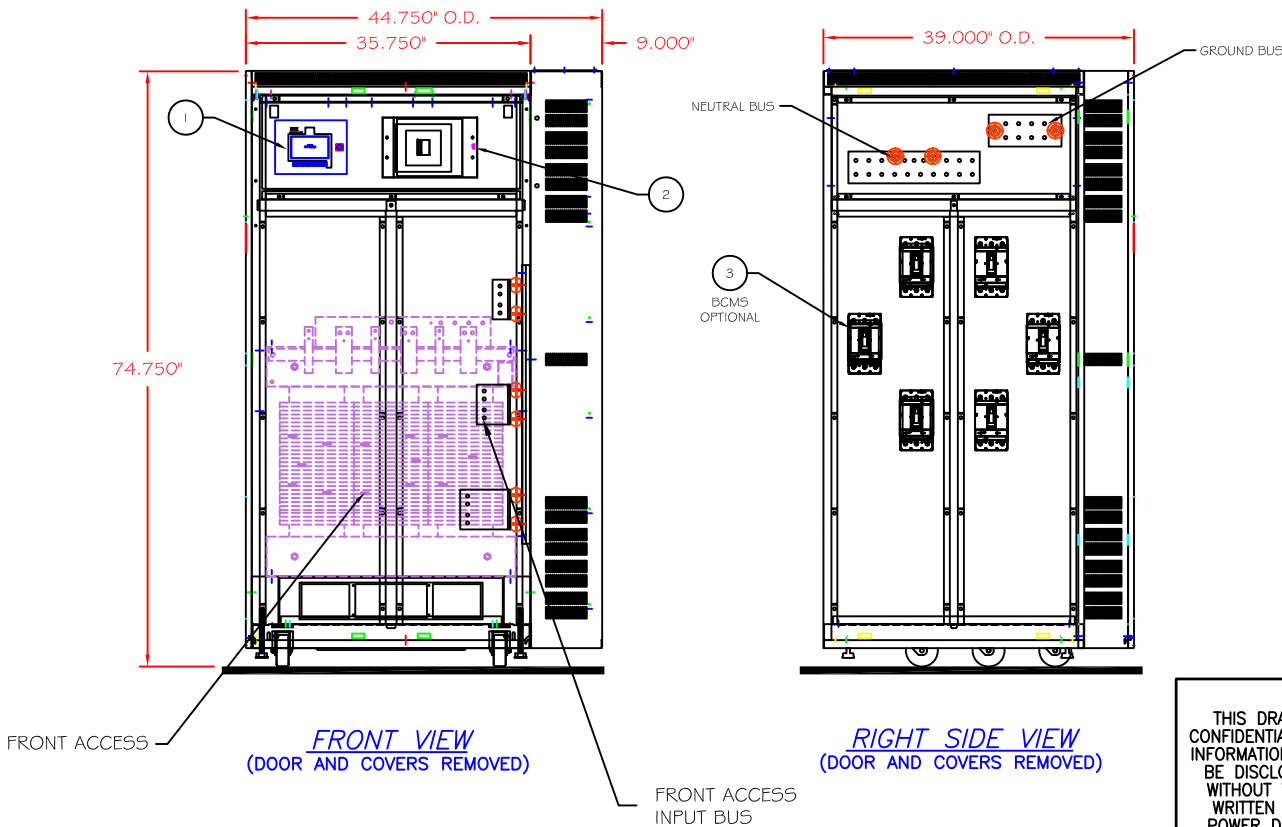

TOP ENTRY / TOP EXIT

| | | | | | | |
|--|----------|------------------------------------|--------------|--|--|--|
| THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC. | | TITLE | | -OUTLINE- | | |
| | | PDU (200-300 kVA) W/ RH 9" SIDECAR | | FRONT ACCESS W/ 1-6 (50-250A) SUBFEEDS | | |
| | | DWG. NUMBER | SHEET 1 OF 1 | REVISION | | |
| | | DWG11050-TOP | | -A- | | |
| DRAWN BY | RAE | CHECKED BY | KRH | | | |
| DATE | 10-25-10 | DATE | 10-25-10 | | | |

