



PLAN VIEW

NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT BREAKER
4. I-LINE PANEL BOARD 1000A (HMA495SL10).
5. (1-8) 400A BREAKERS.
6. MINIMUM OF 24" CLEARANCE FOR DOOR SWING.
7. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND REAR FOR PROPER COOLING.

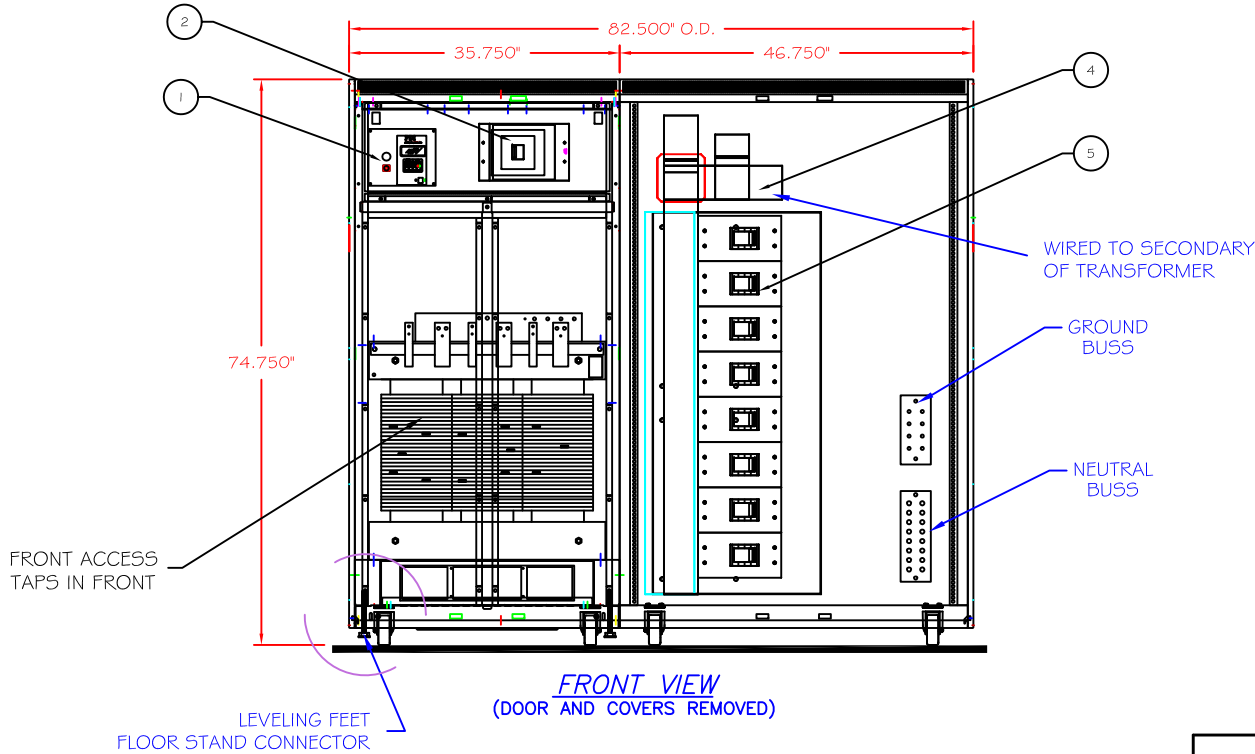

FRONT VIEW
(DOOR AND COVERS REMOVED)

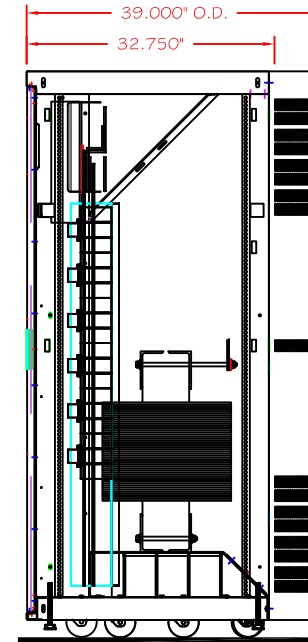

RIGHT SIDE VIEW
(DOOR AND COVERS REMOVED)

<p>THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.</p>	<p>—OUTLINE—</p> <p>POWER-PAK PDU (300 kVA)</p> <p>W/ EXPANSION CABINET 1000 AMP I-LINE PANELBOARD</p>	
	<p>DWG. NUMBER</p> <p>DWG11075</p>	<p>1 OF 1</p>
	<p>DRAWN BY</p> <p>RAE</p>	<p>REVISION</p>
	<p>DATE</p> <p>02-01-07</p>	<p>-A-</p>

