
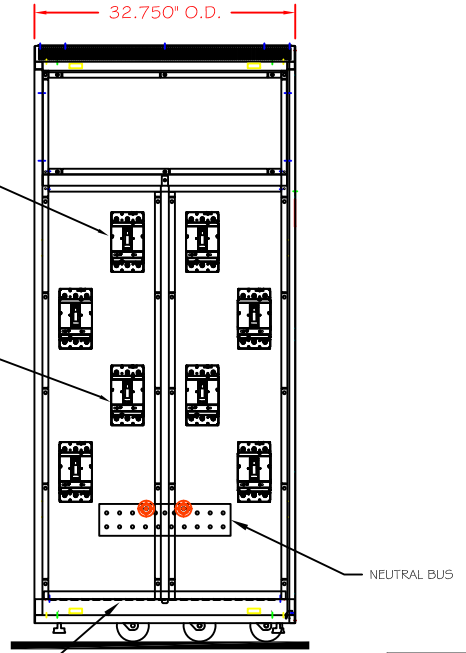



NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. 1-8 (50-250A) SUBFEEDS.
4. (2) SQD 225A NQ PANEL BOARD
5. MINIMUM OF 18" CLEARANCE FOR DOOR SWING IN FRONT.
6. MINIMUM OF 32" CLEARANCE FOR DOOR SWING ON SIDE.
7. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.

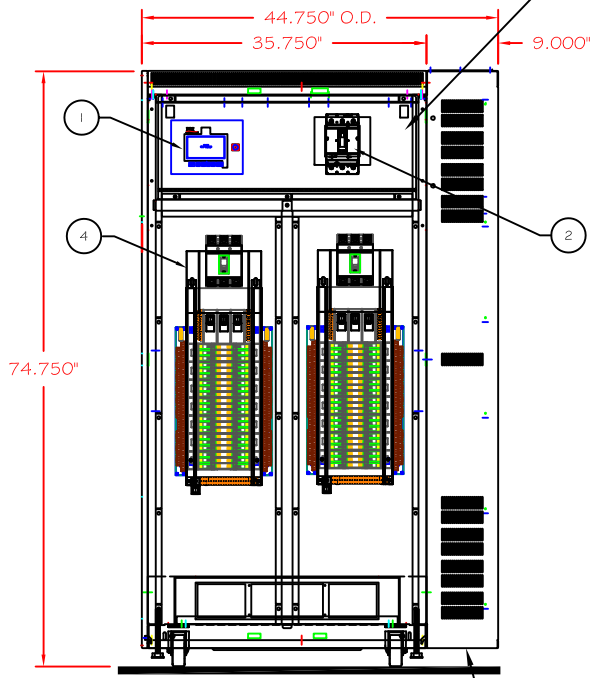

OUTPUT CABLE AREA IN BOTTOM ONLY

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		-OUTLINE-	
		PDU (30-150 kVA) W/ RH SIDECAR 1-8 (50-250A) SUBFEEDS, (2) 225 A SQD NQ PB	
DWG. NUMBER		1 OF 1 DWG11124	
DRAWN BY RAE		REVISION	
DATE 08-20-10		-A-	



**PDI**  
creating the perfect wave