



NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. 225A SECONDARY MAIN CIRCUIT BREAKER.
4. (42) POLE DISTRIBUTION PANELBOARDS.
5. CT STRIP FOR BCMS (OPTIONAL).
6. MINIMUM OF 21" CLEARANCE FOR DOOR SWING.
7. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.
8. RECOMMEND A MINIMUM OF 30" IN REAR OF UNIT FOR MAINTENANCE.
9. BCMS CIRCUIT BOARD (OPTIONAL).

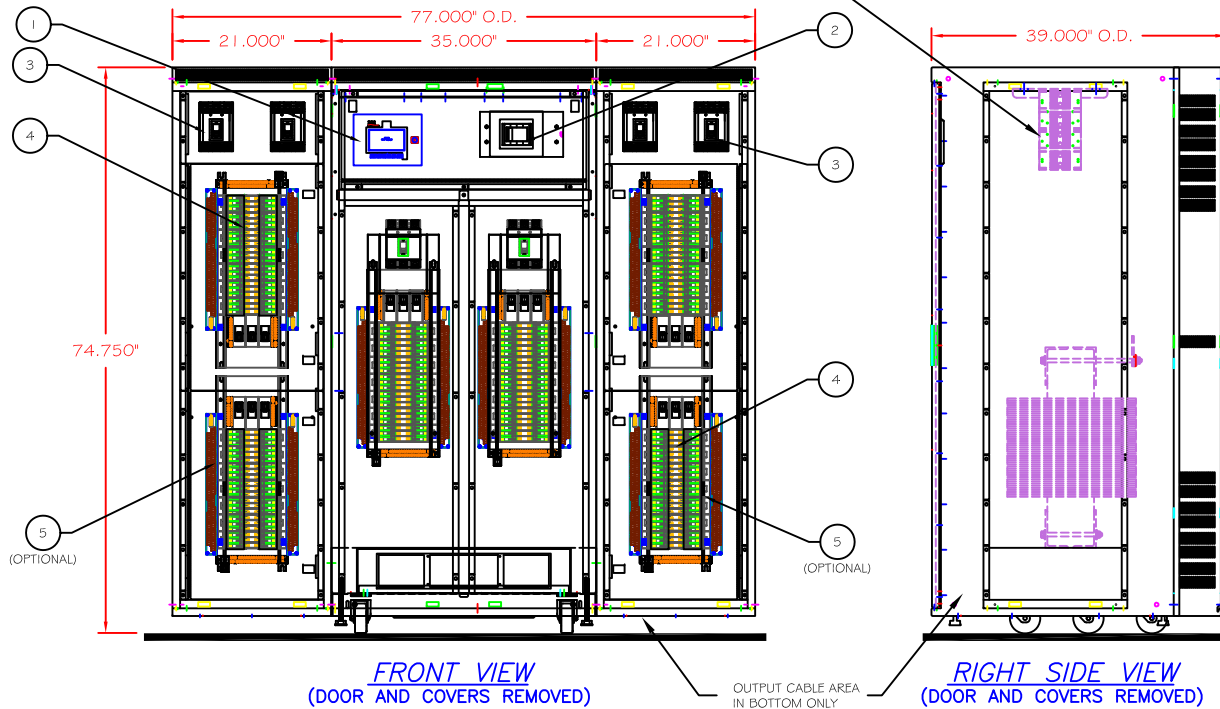

<p>THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.</p>	-OUTLINE-	
	PDU (200-300 kVA) WITH (x2) FF SIDECARS (6) 42 POLE PANEL BOARDS	
	DWG. NUMBER DWG11127	SHEET 1 OF 1 REVISION -A-
	DRAWN BY RAE	CHECKED BY KRH
DATE 07-07-08	DATE 07-07-08	 <p>creating the perfect wave</p>