
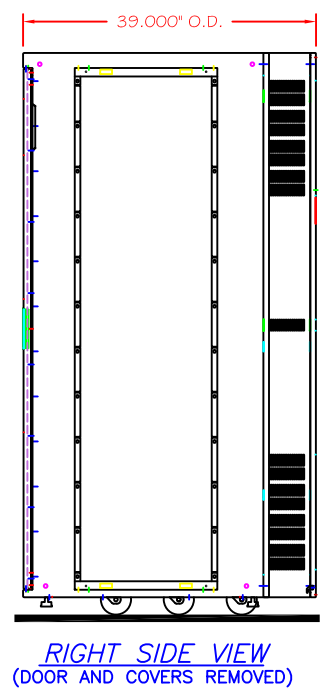



NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. (8) 400A SUBFEEDS.
4. (1) 100A SUBFEEDS.
5. MINIMUM OF 21" CLEARANCE FOR DOOR SWING.
6. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.
7. BCMS CIRCUIT BOARD.

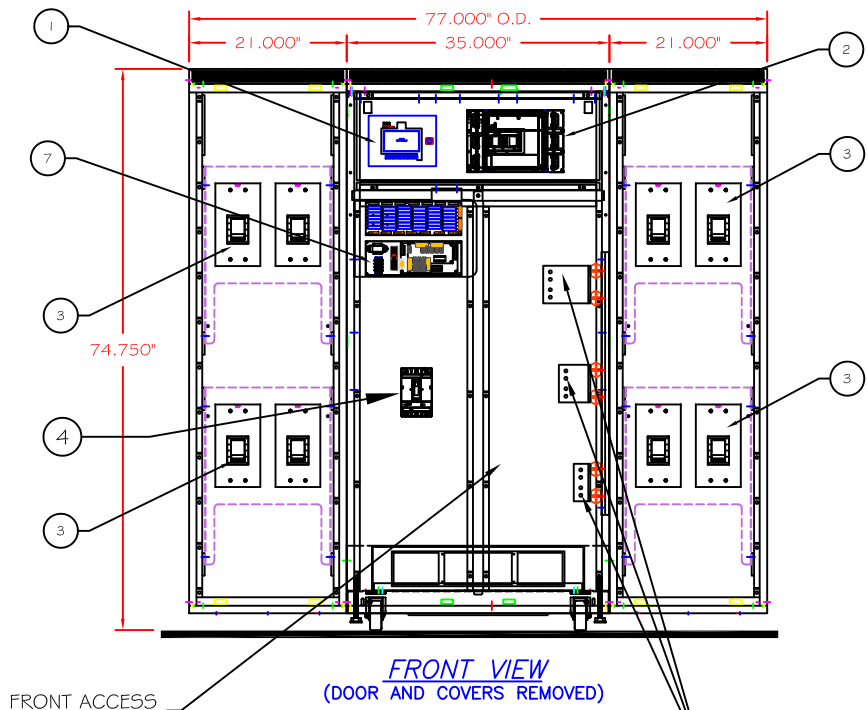

FRONT ACCESS TAPS IN FRONT

INPUT TERMINAL COMPRESSION LUG BUS IN FRONT/SIDE OF PDU FRAME

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		-OUTLINE-			
		PDU (200-300 kVA) W/ (x2) FF SIDECARS (8) 400A, (1) 100A SUBFEEDS			
		DWG. NUMBER DWG11242-1	SHEET 1 OF 1	REVISION -A-	 <p>creating the perfect wave</p>
		DRAWN BY LJN	CHECKED BY RAE	DATE 1/7/16	
DATE 1/7/16	DATE 1/7/16	DATE 1/7/16			