
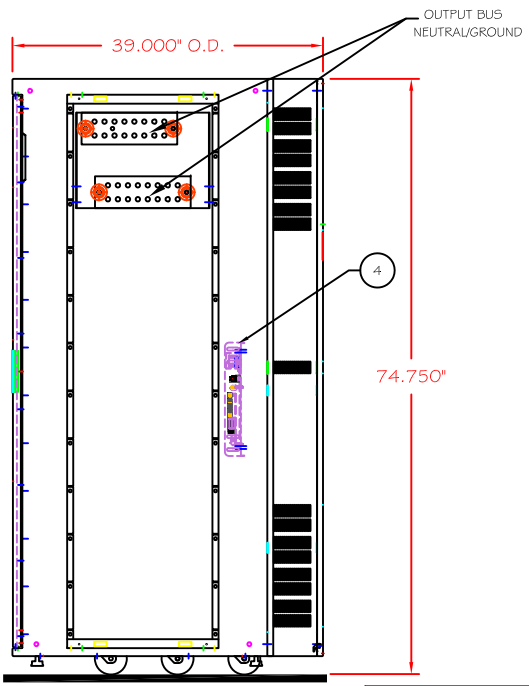


- NOTES:**
1. OPERATOR INTERFACE PANEL.
 2. MAIN INPUT CIRCUIT BREAKER.
 3. 3 (225A) SUBFEED BREAKERS.
 4. BCMS MOTHERBOARDS.
 5. MINIMUM OF 36" CLEARANCE FOR DOOR SWING.
 6. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.

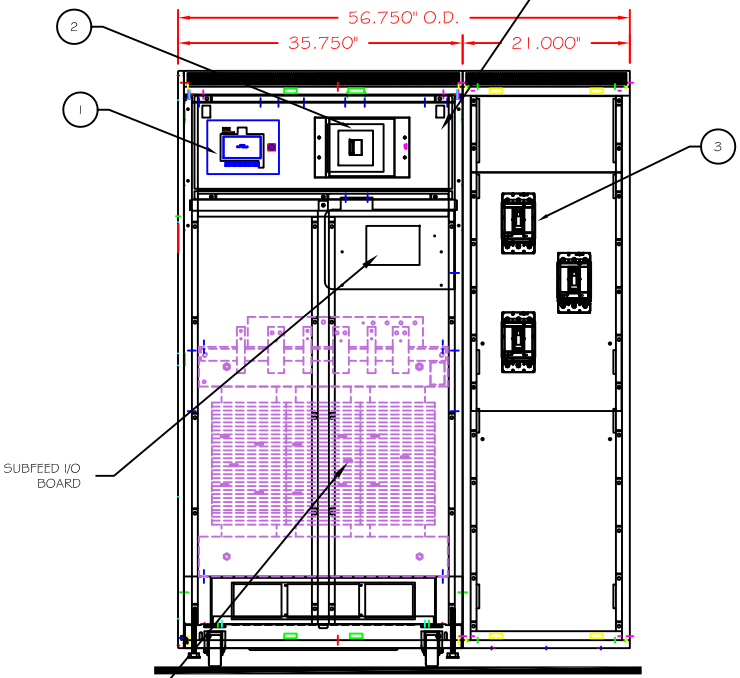

TOP ENRTY/EXIT


FRONT ACCESS TAPS IN FRONT

FRONT VIEW
(DOOR AND COVERS REMOVED)

RIGHT SIDE VIEW
(DOOR AND COVERS REMOVED)

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.

TITLE PDU (200-300 kVA) W/ RH FS SIDECAR FRONT ACCESS W/ 3 (225A) SUBFEED BREAKERS		
DWG. NUMBER DWG18327-3SF	SHEET 1 OF 1	REVISION -A-
DRAWN BY RAE	CHECKED BY MP	
DATE 12-15-15	DATE 12-15-15	


 creating the perfect wave