




- NOTES:**
1. OPERATOR INTERFACE PANEL.
 2. MAIN INPUT CIRCUIT BREAKER.
 3. 400A SECONDARY MAIN CIRCUIT BREAKER.
 4. ABB 400A 42P DISTRIBUTION PANELBOARDS.
 5. (2) 400A SUBFEEDS.
 6. MINIMUM OF 36" CLEARANCE FOR DOOR SWING IN FRONT.
 7. MINIMUM OF 36" CLEARANCE FOR DOOR SWING ON SIDES.
 8. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.

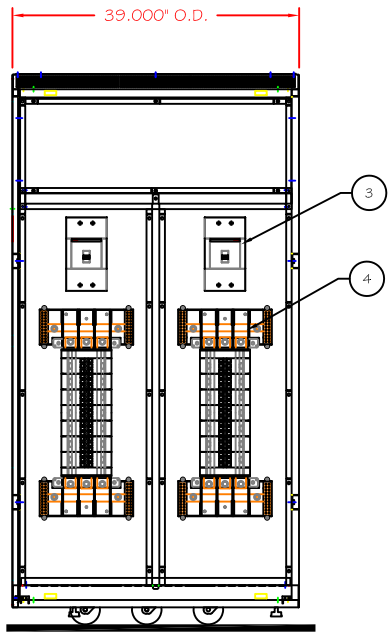

LEFT SIDE VIEW
(DOOR AND COVERS REMOVED)

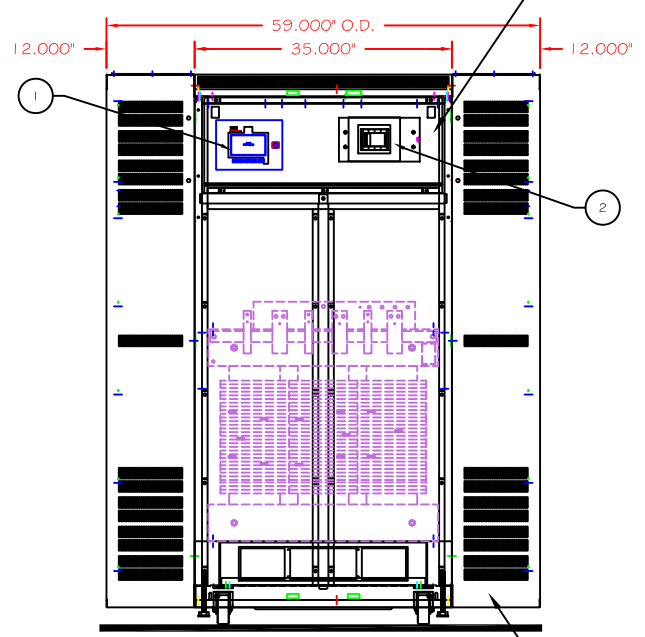

FRONT VIEW
(DOOR AND COVERS REMOVED)

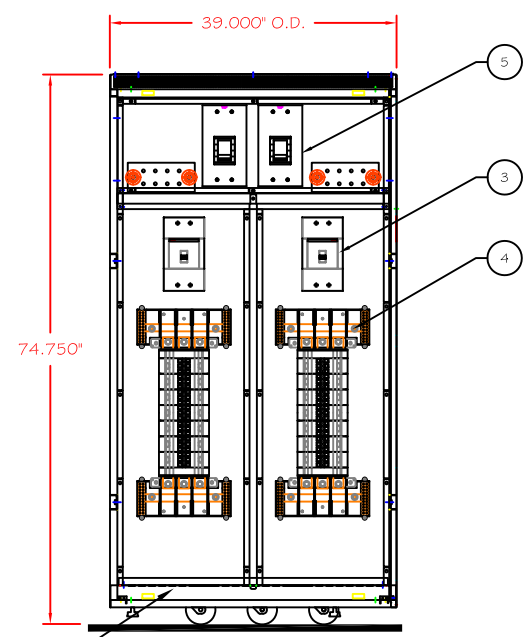

RIGHT SIDE VIEW
(DOOR AND COVERS REMOVED)

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.	TITLE		-OUTLINE-	
			PDU (200-300 kVA) W/ (x2) 12" SIDECARS (4) ABB 400A 42P PANEL & (2) 400A SUBFEEDS	
	DWG. NUMBER	SHEET 1 OF 1	REVISION	
	PDU19456		-A-	
DRAWN BY	RAE	CHECKED BY	MP	
DATE	12-14-15	DATE	12-14-15	

