



NOTES:

1. OPERATOR INTERFACE PANEL.
2. DUAL MAIN INPUT BREAKERS (WITH KIRK KEY).
3. SOLENOID KEY RELEASE.
4. 225A SECONDARY MAIN CIRCUIT BREAKER.
5. (42) POLE DISTRIBUTION PANELBOARD.
6. MINIMUM OF 18" CLEARANCE FOR DOOR SWING IN FRONT.
7. MINIMUM OF 32" CLEARANCE FOR DOOR SWING ON LEFT SIDE.
8. RECOMMEND A MINIMUM OF 30" IN REAR FOR MAINTENANCE.
9. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.

BCM5 BOARDS MOUNTED IN 3" DEEP SIDE SPACER

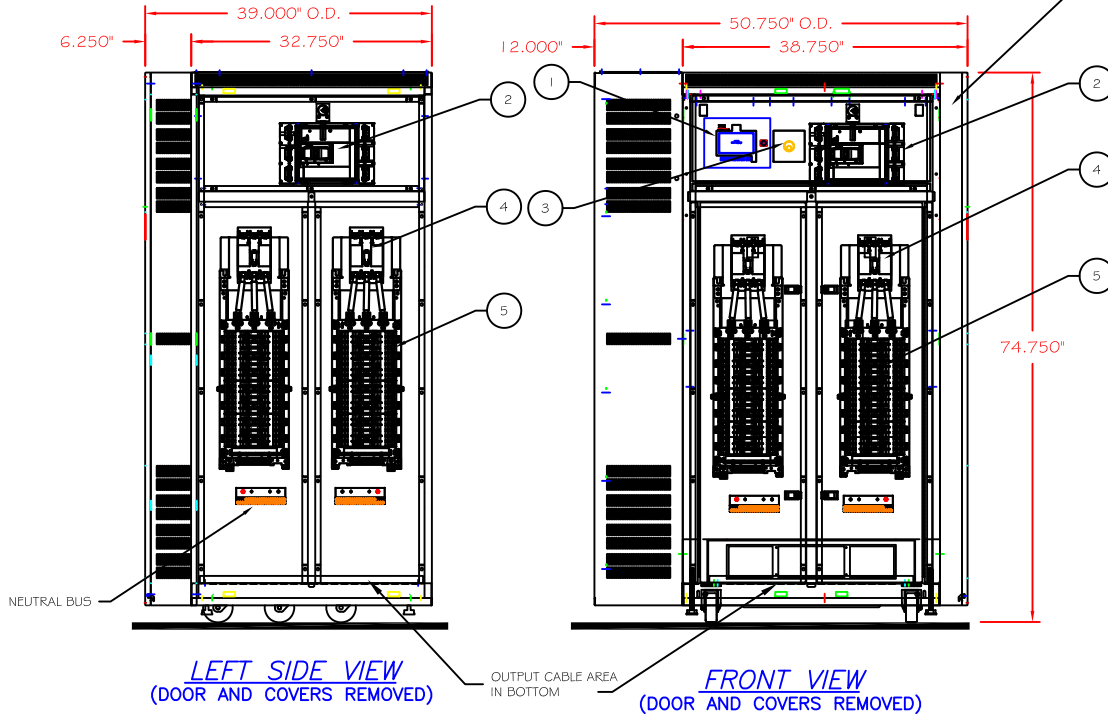

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.	TITLE		-OUTLINE-
	MDP POWERPAK PDU 200-300kVA (4) 225A 42P PANELS		
	DWG. NUMBER	SHEET 1 OF 1	REVISION
	DWG35095_B-LH-3SP		-B-
DRAWN BY	RAE	CHECKED BY	DAS
DATE	09-11-14	DATE	09-11-14



PDI
creating the perfect wave