


**NOTES:**

1. OPERATOR INTERFACE PANEL.
2. DUAL MAIN INPUT BREAKERS (WITH KIRK KEY).
3. SOLENOID KEY RELEASE.
4. 225A SECONDARY MAIN CIRCUIT BREAKER.
5. (42) POLE DISTRIBUTION PANELBOARD.
6. 225A SUB FEED.
7. MINIMUM OF 18" CLEARANCE FOR DOOR SWING IN FRONT.
8. MINIMUM OF 32" CLEARANCE FOR DOOR SWING ON RIGHT SIDE.
9. RECOMMEND A MINIMUM OF 30" IN REAR FOR MAINTENANCE.
10. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.

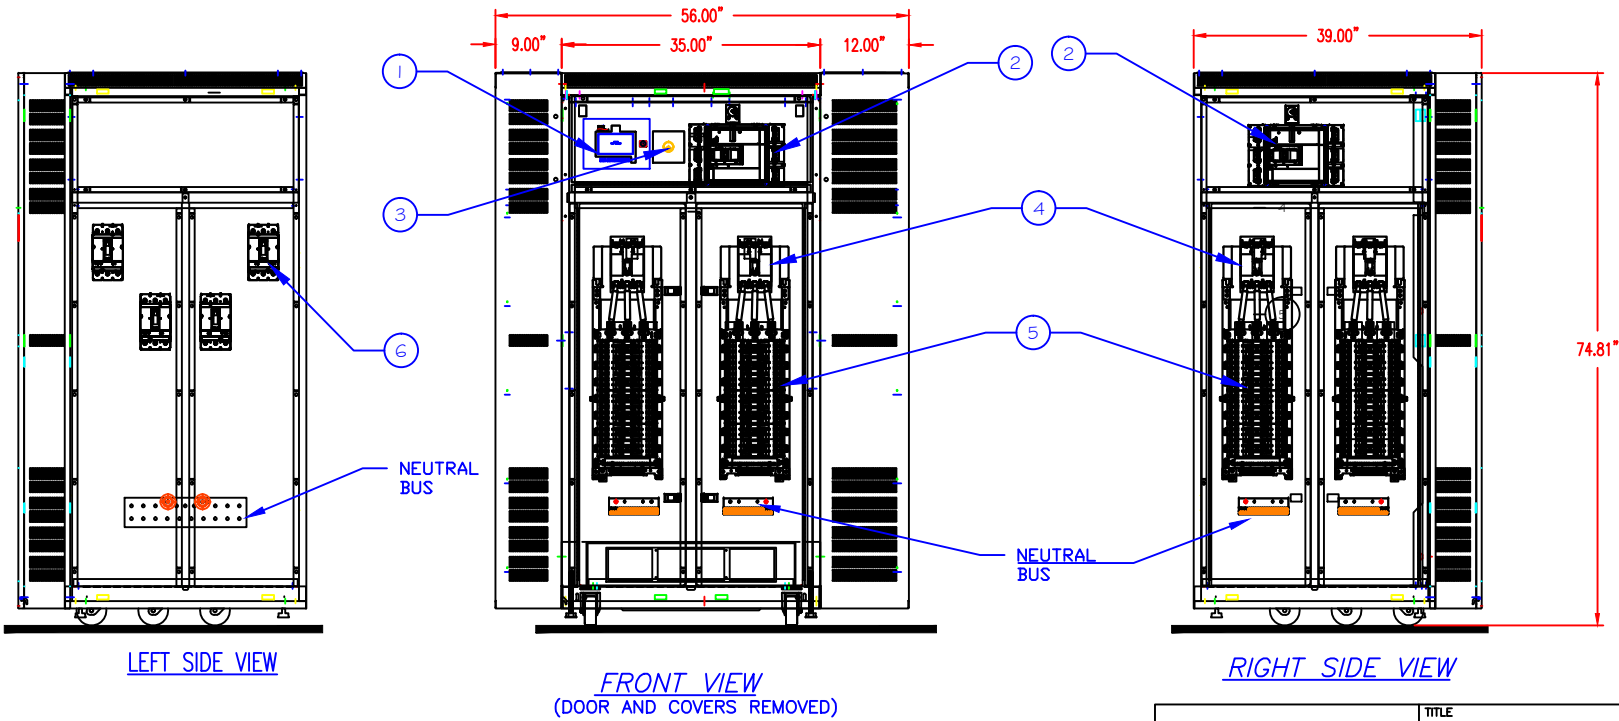

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.	TITLE -OUTLINE- MDP POWERPAK PDU 200-300kVA (4) 225A 42P PANELS, (4) 225A SUBFEED	
	DWG. NUMBER MDP18560	SHEET 1 OF 1 REVISION -A-
	DRAWN BY LJN	CHECKED BY RAE
	DATE 06-10-15	DATE 06-10-15
 creating the perfect wave		