
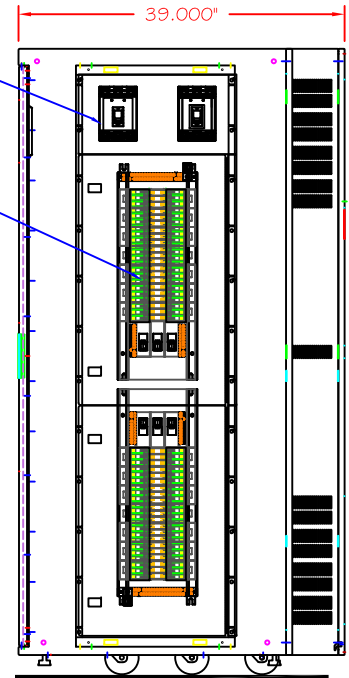
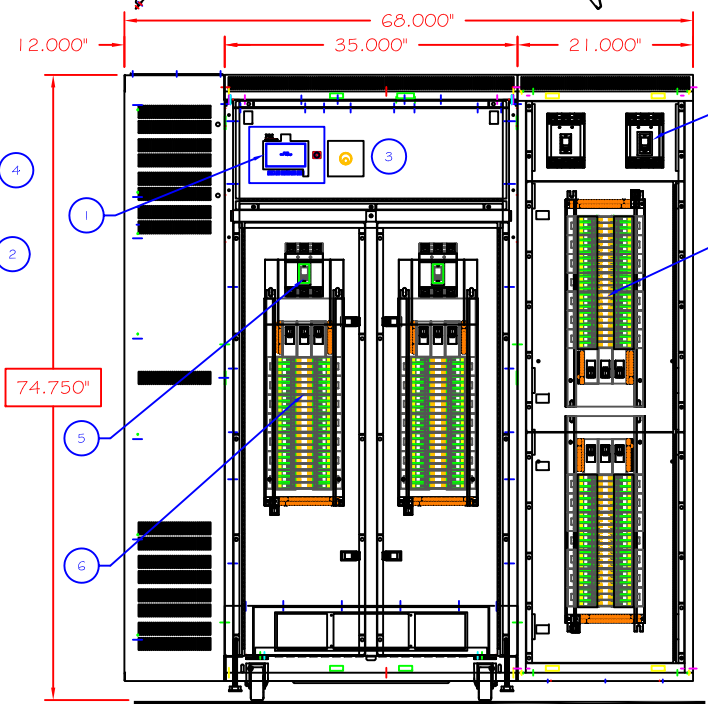



NOTES:

1. OPERATOR INTERFACE PANEL.
2. DUAL MAIN INPUT BREAKERS (WITH KIRK KEY).
3. SOLENOID KEY RELEASE.
4. SOURCE AVAILABLE LIGHTS.
5. 225A SECONDARY MAIN CIRCUIT BREAKER.
6. (42) POLE DISTRIBUTION PANELBOARDS.
7. MINIMUM OF 36" CLEARANCE FOR DOOR SWING IN FRONT, 36" ON LEFT SIDE.
8. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.
9. RECOMMEND A MINIMUM OF 30" IN REAR OF UNIT FOR MAINTENANCE.

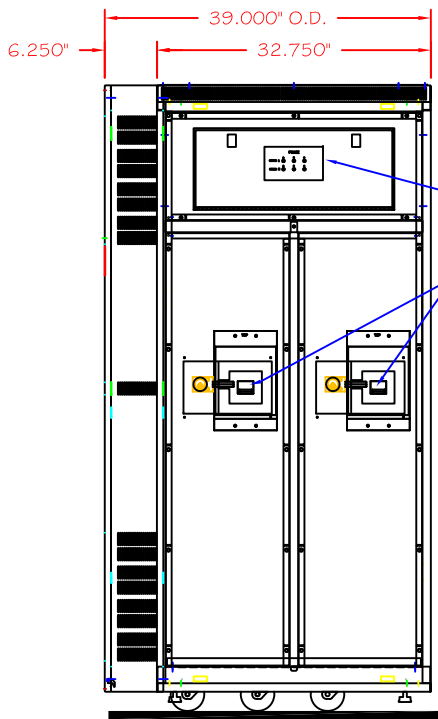

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		TITLE		-OUTLINE-	
		MDP POWERPAK PDU 200-300kVA FF AND SF SIDECARS WITH (6) 225A PANEL BOARDS			
DWG. NUMBER	SHEET 1 OF 1	REVISION			
DWG35086-KK		-A-			
DRAWN BY	RAE	CHECKED BY		KRH	
DATE	7-15-15	DATE		7-15-15	
				creating the perfect wave	