



NOTES:

1. OPERATOR INTERFACE PANEL.
2. PRIMARY BREAKER.
3. SOLENOID KEY .
4. TIE BREAKER W/ KIRKEY.
5. AUXILIARY INPUT BREAKER W/ KIRKEY.
6. (4) 400A SUBFEED.
7. BCMS
8. RECOMMEND A MINIMUM OF 30" SIDE OF UNIT FOR MAINTENANCE.
9. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.
10. MINIMUM OF 21" CLEARANCE FOR DOOR SWING.



<p>THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.</p>	TITLE		-OUTLINE-
	<p>POWERPAK PDU 300kVA (2) SECONDARY BREAKER 21 " SIDECAR W/ (4) 400A SUBFEEDS</p>		
	DWG. NUMBER	SHEET 1 OF 1	REVISION
	PDU 18282		-B-
DRAWN BY	LJN	CHECKED BY	RAE
DATE	06/25/15	DATE	06/25/15

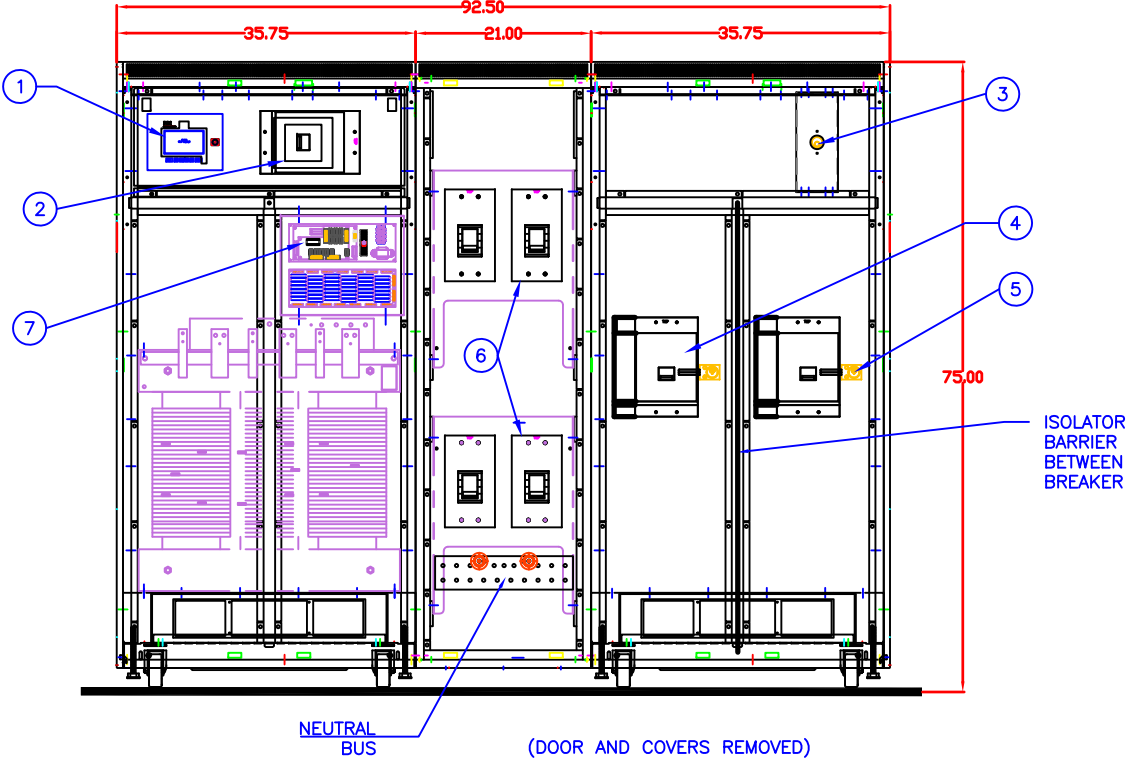

PDI
creating the perfect wave