



PLAN VIEW

NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. I-LINE PANEL BOARD 1200A (HRA495SL12).
4. UP TO (10) 250AF BREAKERS.
5. MINIMUM OF 24" CLEARANCE FOR DOOR SWING IN FRONT.
6. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND REAR FOR PROPER COOLING.

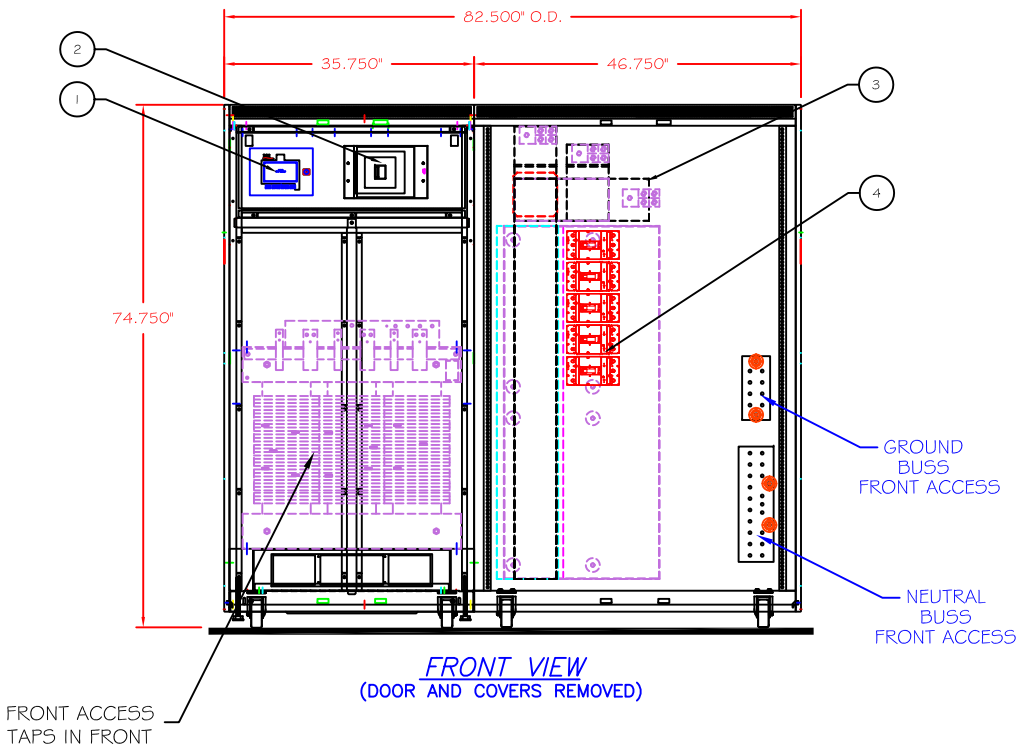

FRONT VIEW
(DOOR AND COVERS REMOVED)

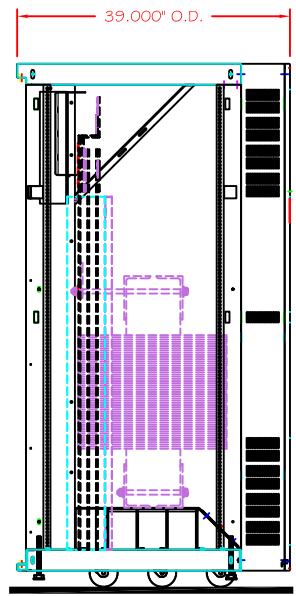

RIGHT SIDE VIEW
(DOOR AND COVERS REMOVED)

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		-OUTLINE- POWER-PAK PDU (300 kVA) W/ EXPANSION CABINET 1200 AMP I-LINE PANELBOARD	
		DWG. NUMBER PDU18673	SHEET 1 OF 1
DRAWN BY RAE	CHECKED BY KRH		
DATE 07-08-15	DATE 07-08-15		

creating the perfect wave