


FRONT VIEW
(DOORS & COVERS REMOVED)

NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. I-LINE PANEL BOARD (HCM2364-8).
4. (5) 225 AMP SUB-FEED CIRCUIT BREAKERS.
5. ALLOW A MINIMUM OF 6" CLEARANCE BETWEEN WALL AND VENTILATED SIDES FOR PROPER COOLING.
6. ALLOW A MINIMUM OF 18" CLEARANCE FOR DOOR SWING.

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		TITLE -OUTLINE- POWER-PAK PDU W/ EXPANSION CABINET 800 AMP I-LINE PANELBOARD	
		DWG. NUMBER PDU18674	1 OF 5
DRAWN BY K. Harlow	REVISION -A-	DATE 12-01-11	

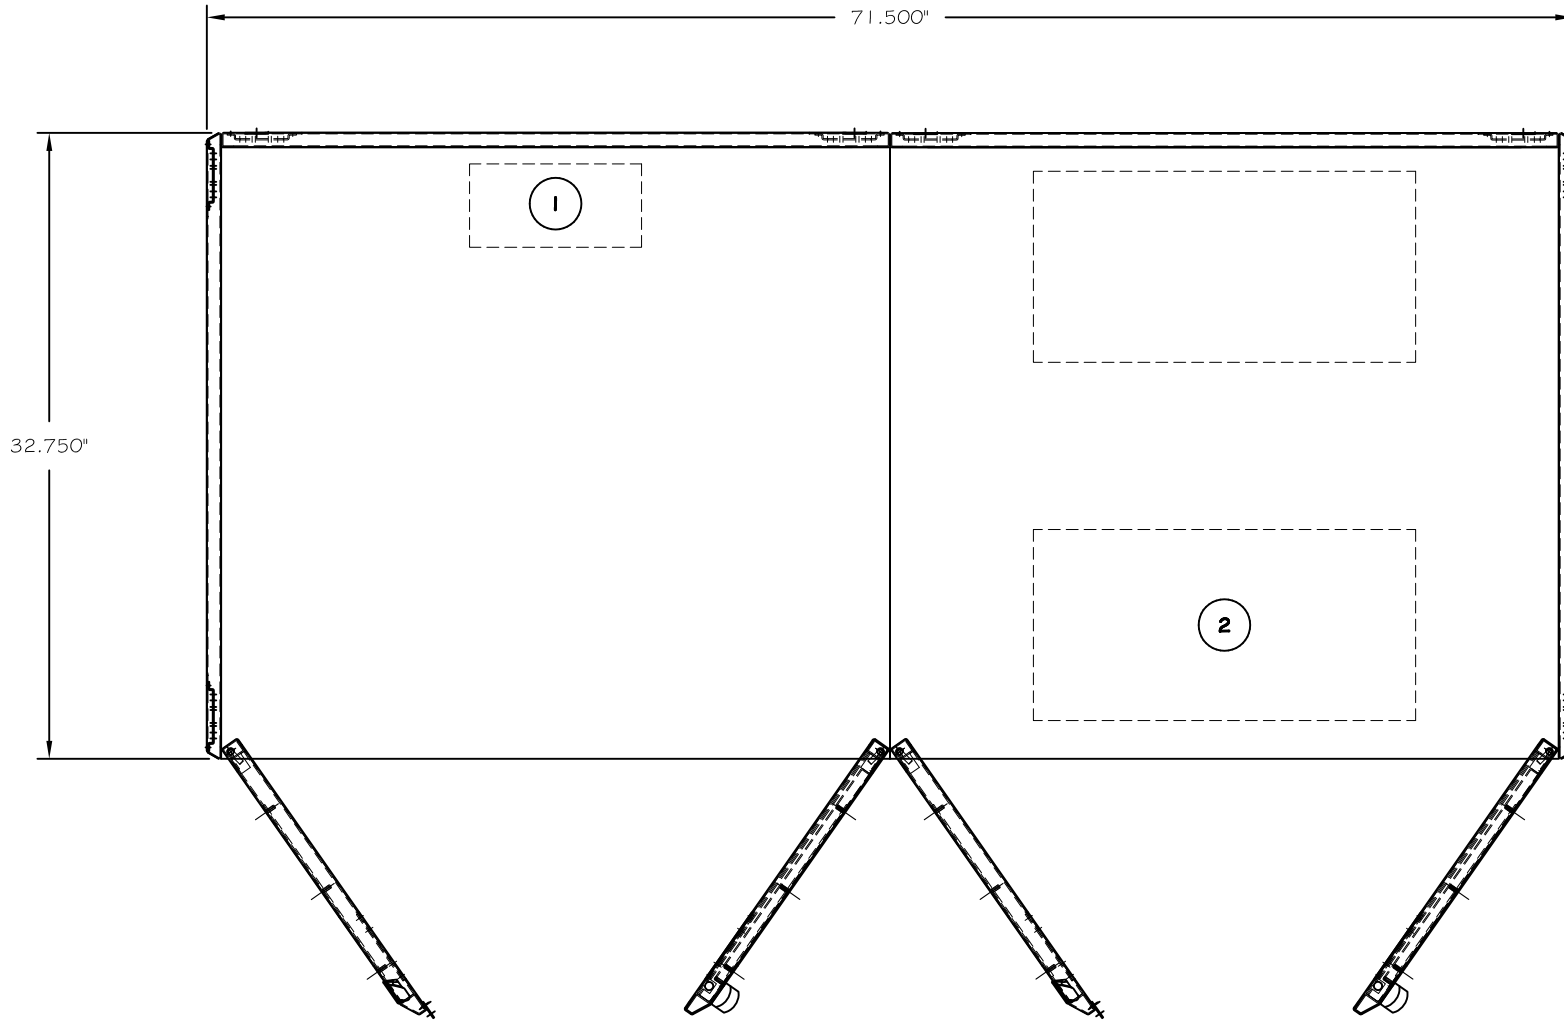

PLAN VIEW

NOTES:

1. INPUT CABLE AREA TO BE PUNCHED.
2. OUTPUT CABLE AREA TO BE PUNCHED.
3. ALLOW A MINIMUM OF 6" CLEARANCE BETWEEN WALL AND VENTILATED SIDES FOR PROPER COOLING.
4. ALLOW A MINIMUM OF 18" CLEARANCE FOR DOOR SWING.

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		TITLE -OUTLINE- POWER-PAK PDU W/ EXPANSION CABINET 800 AMP I-LINE PANELBOARD	
		DWG. NUMBER PDU18674	2 OF 5
DRAWN BY K. Harlow	REVISION -A-	DATE 12-01-11	