



**FRONT VIEW**  
(DOOR & COVERS REMOVED)

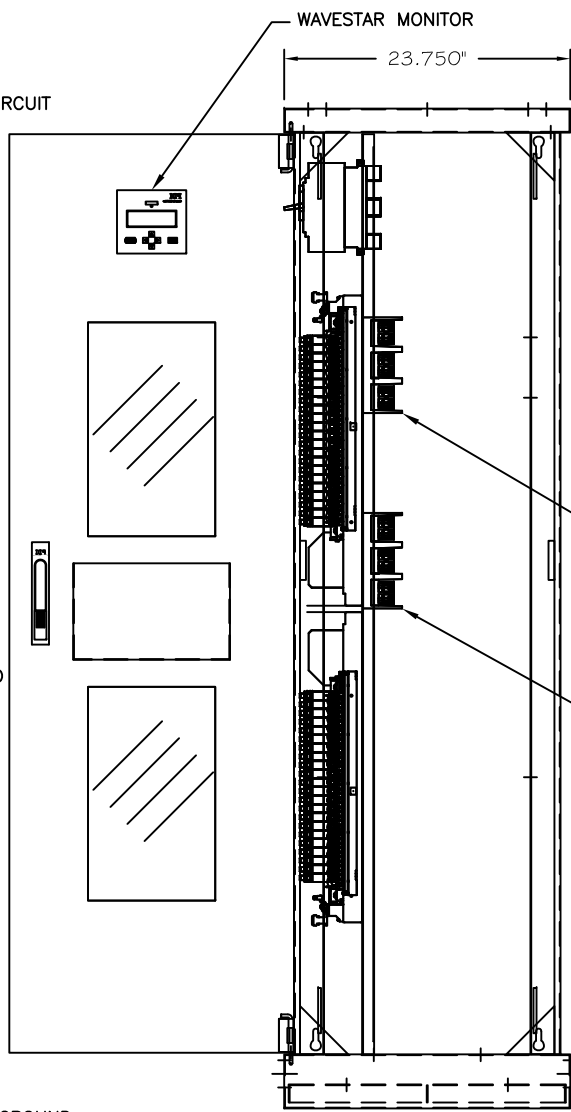

**SIDE VIEW**  
(DOOR & COVERS REMOVED)

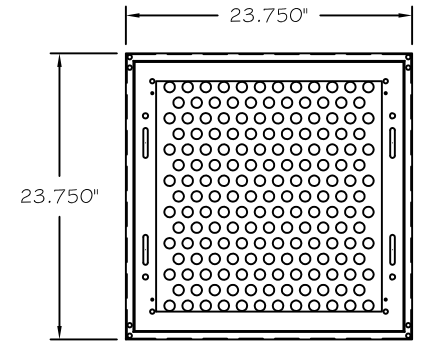

**FOOT PRINT**

- NOTES:**
1. HINGED REMOVABLE PANELS PROVIDED ON SIDES.
  2. ACCESS: MINIMUM 36" FROM FRONT & REAR OF ENCLOSURE, IS REQUIRED FOR OPERATION. SIDE ACCESS IS REQUIRED FOR INSTALLATION & MAINTENANCE.
  3. APPROXIMATE WEIGHT: 600lbs.
  4. (1) MOLDED CASE CIRCUIT BREAKER, (2) 42 CIRCUIT PANEL BOARDS WITH BCMS AND (1) WAVESTAR MONITOR (1) PDB.
  5. (168)- 0.875Ø KNOCKOUTS PROVIDED.

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.	TITLE <span style="float: right;">-OUTLINE-</span> REMOTE POWER PANEL (RPP)		
	(1) INPUT, (2) PNLBRDS W/BCMS & (1) WAVESTAR MON.		
	DWG. NUMBER	SHEET 1 OF 1	REVISION
	RPP18441		-A-
	DRAWN BY	CHECKED BY	
ISF	LJN		
DATE	DATE		
05-26-15	05-26-15		

