



FRONT AND REAR VIEW
(DOOR & COVERS REMOVED)

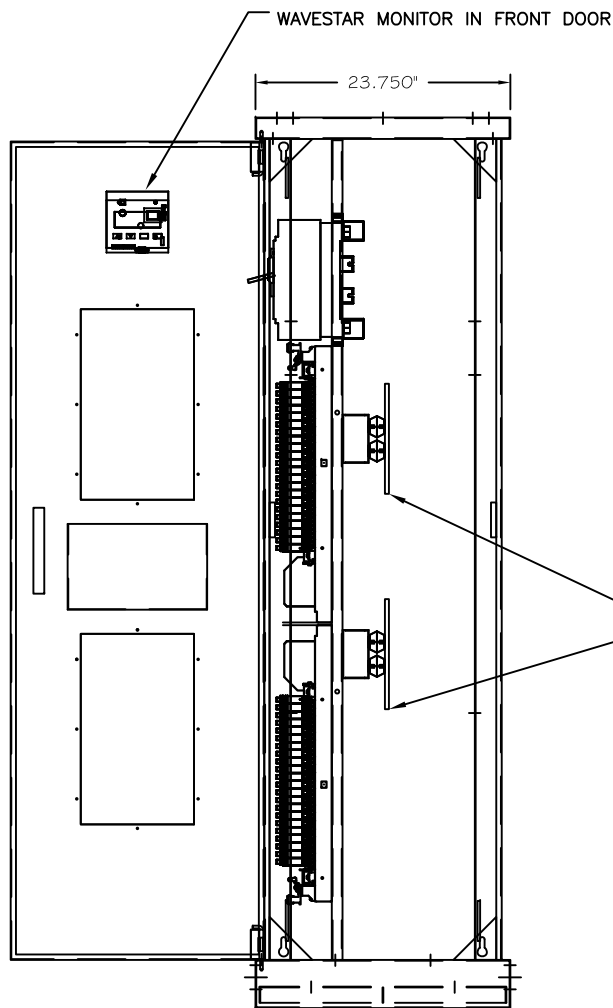

SIDE VIEW
(COVERS REMOVED)

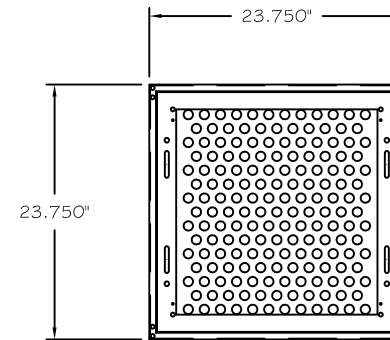

FOOT PRINT

(2) INPUT BUSES
POWER FEED
NEUTRAL
EQUIPMENT GROUND
ISOLATION GROUND(OPTIONAL)

NOTES:

1. HINGED REMOVABLE PANELS PROVIDED ON SIDES.
2. ACCESS: MINIMUM 36" FROM FRONT & REAR OF ENCLOSURE IS REQUIRED FOR OPERATION. SIDE ACCESS IS REQUIRED FOR INSTALLATION AND MAINTENANCE.
3. APPROXIMATE WEIGHT: 750lbs.
4. (2) INPUT BUSES ,(2) 400A MAIN,
(2) 400A PANELBOARDS W/BCMS AND WAVESTAR MONITOR.
5. (168) 0.875Ø KNOCKOUTS PROVIDED.

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		TITLE		-OUTLINE-		
				(2) INPUT BUSES, (2) MAIN CIRCUIT BREAKERS (2) 400A PANELBOARDS W/BCMS WAVESTAR MONITOR		
		DWG. NUMBER	SHEET 1 OF 1	REVISION		
		RPP18257		-A-		
		DRAWN BY	ISF	CHECKED BY	LJN	
DATE	04-16-15	DATE	04-16-15			

