



FRONT VIEW
(DOOR & COVERS REMOVED)

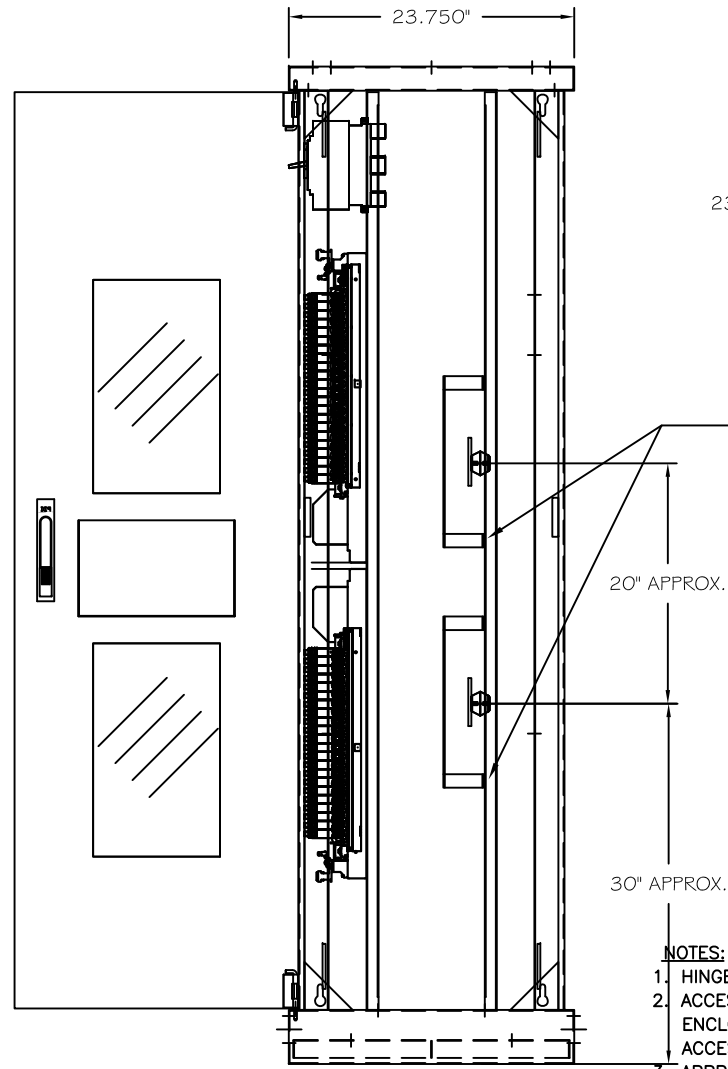

SIDE VIEW
(DOOR & COVERS REMOVED)

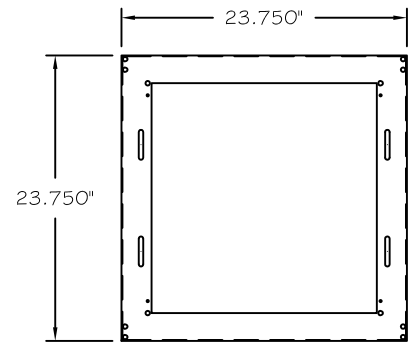


FOOT PRINT

- NOTES:**
1. HINGED REMOVABLE PANELS PROVIDED ON SIDES.
 2. ACCESS: MINIMUM 36" FROM FRONT & REAR OF ENCLOSURE, IS REQUIRED FOR OPERATION. SIDE ACCESS IS REQUIRED FOR INSTALLATION & MAINTENANCE.
 3. APPROXIMATE WEIGHT: 600lbs.
 4. (2) CIRCUIT BREAKERS, (2) 42 CIRCUIT PANELBOARD (2) METERS, (2) INPUT BUSES
 5. (168)- 0.875Ø KNOCKOUTS PROVIDED.

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.			-OUTLINE-			
			REMOTE POWER PANEL (RPP)			
			(2) MAINS & (2) PANELBOARDS (2) METER (2) INPUT BUS			
			DWG. NUMBER	SHEET 1 OF 2	REVISION	
			RPP18278		-B-	
DRAWN BY	ISF	CHECKED BY	LJN			
DATE	04-21-15	DATE	04-21-15			



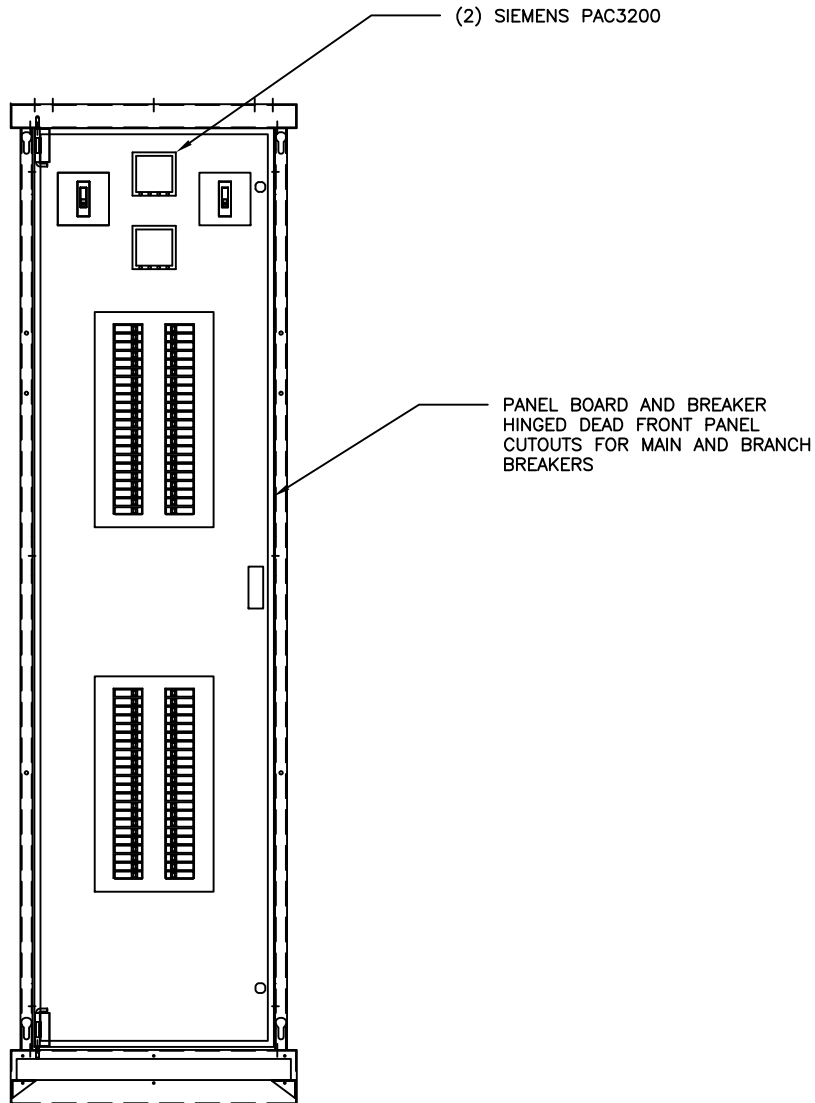

FRONT VIEW
(DOOR REMOVED)

NOTES:

1. HINGED REMOVABLE PANELS PROVIDED ON SIDES.
2. ACCESS: MINIMUM 36" FROM FRONT & REAR OF ENCLOSURE, IS REQUIRED FOR OPERATION. SIDE ACCESS IS REQUIRED FOR INSTALLATION & MAINTENANCE.
3. APPROXIMATE WEIGHT: 600lbs.
4. (2) CIRCUIT BREAKERS, (2) 42 CIRCUIT PANELBOARD
(2) METERS, (2) INPUT BUSES
5. (168)- 0.875Ø KNOCKOUTS PROVIDED.

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.	TITLE		-OUTLINE-
	REMOTE POWER PANEL (RPP)		
	(2) MAINS & (2) PANELBOARDS (2) METER (2) INPUT BUS		
	DWG. NUMBER	SHEET 2 OF 2	REVISION
	RPP18278		-B-
DRAWN BY	ISF	CHECKED BY	LJN
DATE	04-21-15	DATE	04-21-15

