


FRONT VIEW

NOTES:

1. OPERATOR INTERFACE PANEL.
2. ALLOW A MINIMUM OF 6" CLEARANCE FOR VENTILATION
3. ALLOW A MINIMUM OF 22" FOR FRONT DOOR SWING.
3. ALLOW A MINIMUM OF 18" FOR REAR INSTALLATION

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		TITLE -OUTLINE- STATIC TRANSFER SWITCH 1000 AMP STAND ALONE UNIT	
		DWG. NUMBER DWG40028	1 OF 3
DRAWN BY K. Harlow	REVISION -A-		
DATE 05-02-08			

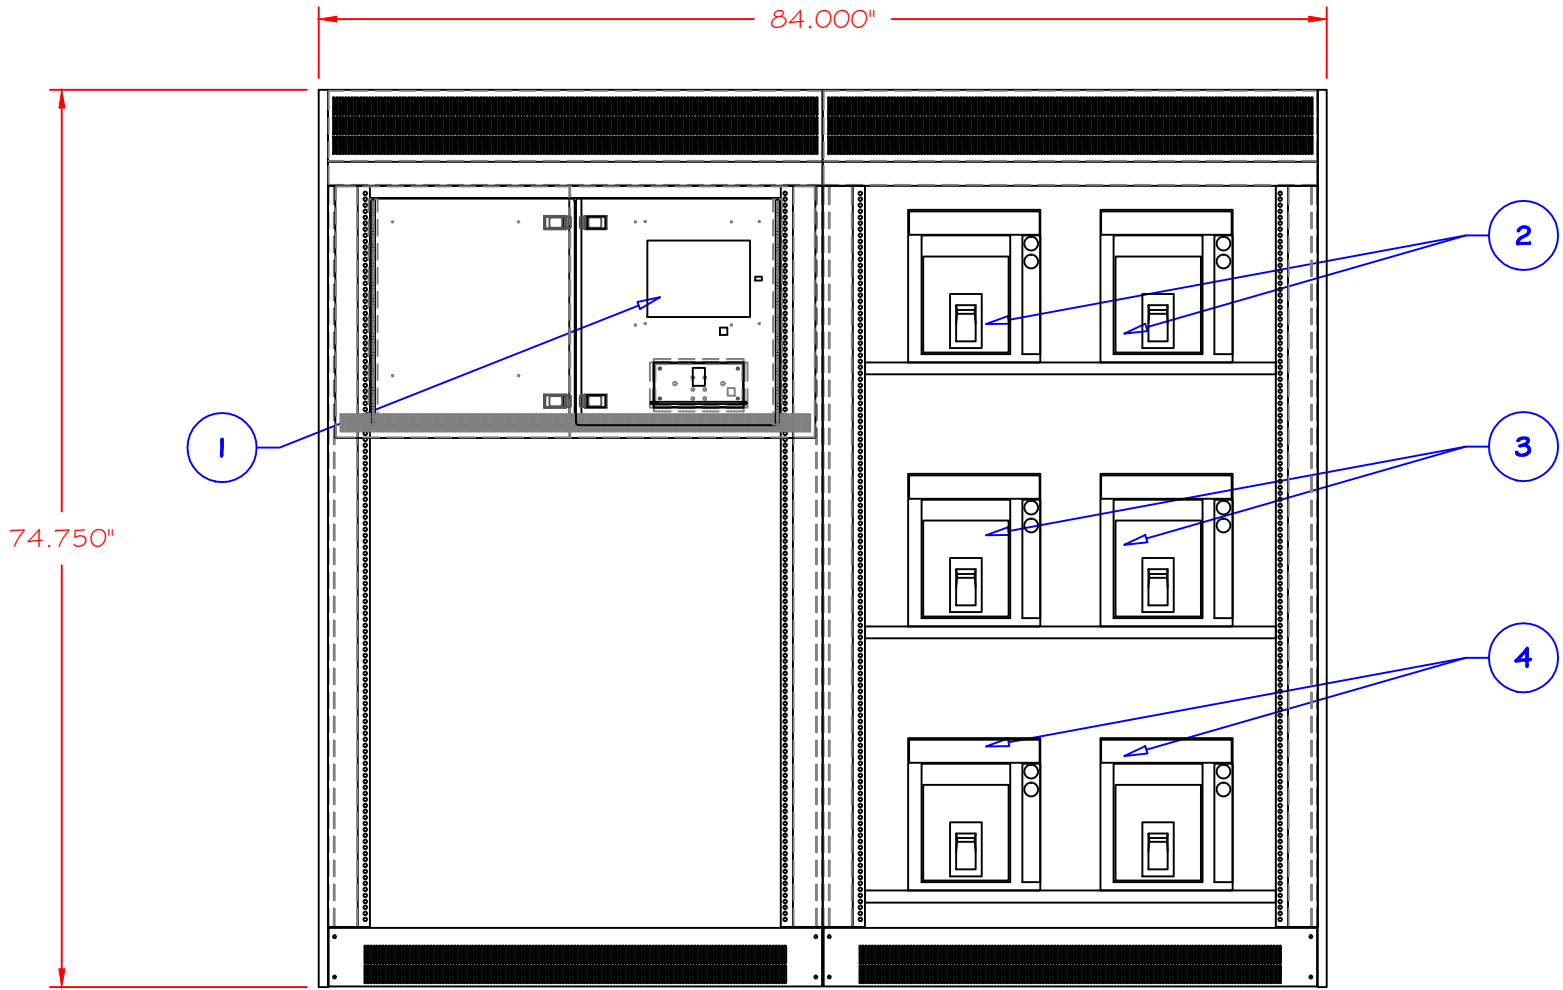


**FRONT VIEW
(DOORS & COVERS REMOVED)**

NOTES:

- 1. OPERATOR INTERFACE PANEL.
- 2. MOLDED CASE INPUT SWITCH.
- 3. MOLDED CASE BYPASS SWITCH.
- 4. MOLDED CASE ISOLATION SWITCH (2nd SWITCH OPTIONAL).

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		TITLE		-OUTLINE- STATIC TRANSFER SWITCH 1000 AMP STAND ALONE UNIT		
		DWG. NUMBER	2 OF 3			
		DRAWN BY	K. Harlow		REVISION	
		DATE	05-02-08			-A-

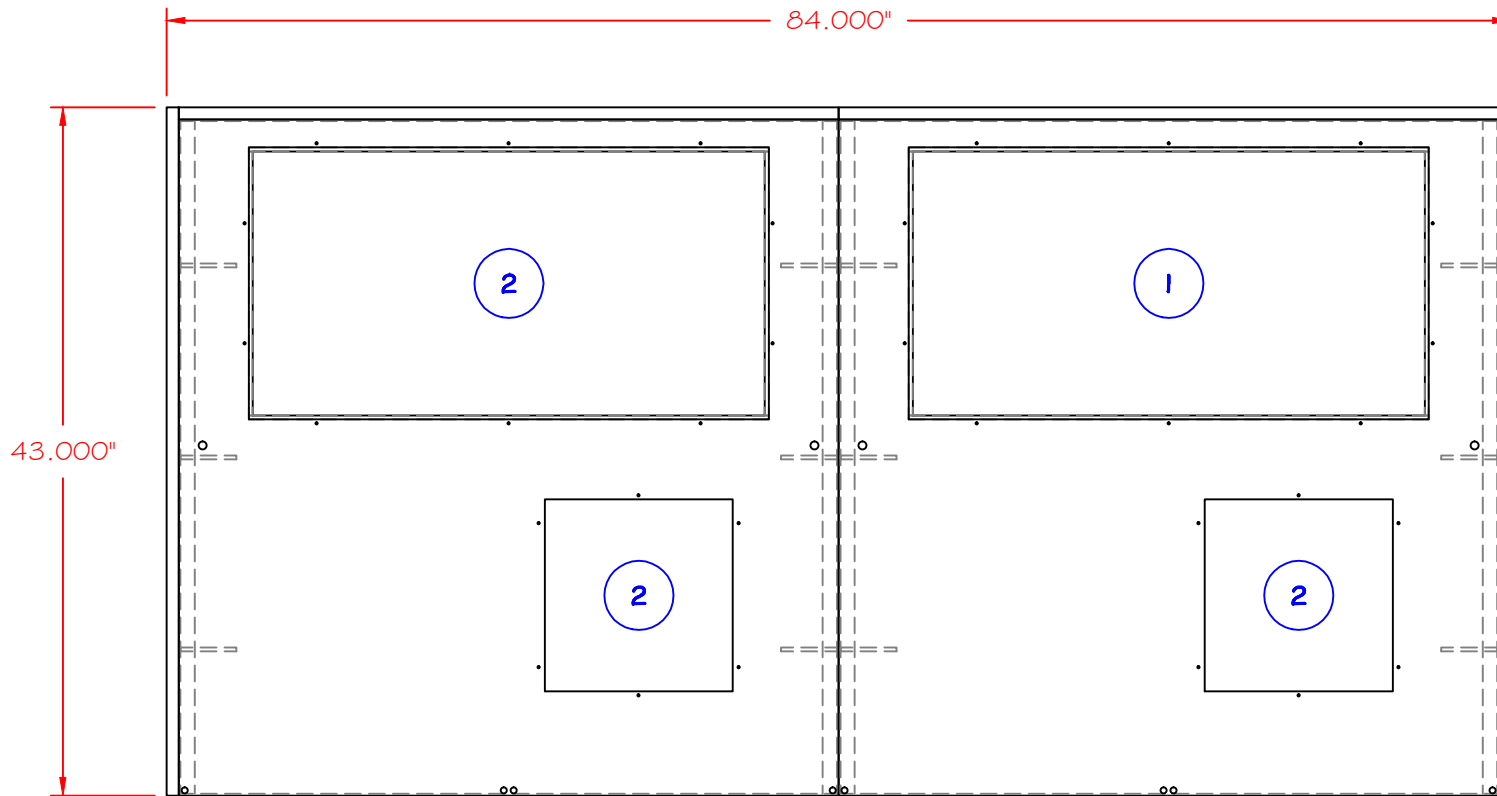

FOOT PRINT

NOTES:

1. CABLE INPUT AREA, TO BE PUNCHED.
2. VENTS FOR COOLING.

THIS DRAWING CONTAINS CONFIDENTIAL & PROPRIETARY INFORMATION AND SHALL NOT BE DISCLOSED OR COPIED WITHOUT THE EXPRESSED, WRITTEN PERMISSION OF POWER DISTRIBUTION INC.		TITLE -OUTLINE- STATIC TRANSFER SWITCH 1000 AMP STAND ALONE UNIT		
		DWG. NUMBER DWG40028	3 OF 3	
		DRAWN BY K. Harlow	REVISION -A-	
		DATE 05-02-08	PDI creating the perfect wave	