

Low-voltage power distribution and control systems > Panelboards >

# Fusible panelboards

## Pow-R-Line 1XF and 2XF

### Contents

<b>General Description</b> . . . . .	<b>22.9-2</b>
Panelboards Overview . . . . .	22.9-2
Application Considerations and Definitions . . . . .	22.9-4
Pow-R-Line 1XF Fusible Panelboard . . . . .	22.9-7
Pow-R-Line 2XF Fusible Panelboard . . . . .	22.9-8
<b>Devices</b> . . . . .	<b>22.9-9</b>
Circuit Breaker Technical Data . . . . .	22.9-9
Power Xpert Release Trip Unit for Molded Case Circuit Breakers . . . . .	22.9-11
Metering and Surge Protective Devices . . . . .	22.9-13
<b>Layouts and Dimensions</b> . . . . .	<b>22.9-14</b>
PRL1XF Layout Guide . . . . .	22.9-14
PRL2XF Layout Guide . . . . .	22.9-15
<b>Additional Resources</b> . . . . .	<b>22.9-16</b>
Series Rated Combinations . . . . .	22.9-16
Panelboard Selection Guide . . . . .	22.9-27



# EATON

Powering Business Worldwide



More about this product  
[Eaton.com/panelboards](https://Eaton.com/panelboards)



Complete library of design guides  
[Eaton.com/designguides](https://Eaton.com/designguides)

## Panelboards Overview

Choices to quickly change feeder breakers in electrical distribution equipment have evolved over the years. While using drawout switchgear with power air circuit breakers remains a highly reliable solution, requests for drawout molded case circuit breakers (MCCBs) have increased. And, customers need a wall-mounted panelboard solution with front-accessibility and front-connected equipment to meet space requirements and application needs.

Eaton's drawout MCCB Pow-R-Line® 4DX (PRL4DX) panelboard provides this solution.

This is the first design to offer two- and three-pole MCCBs in a mechanical drawout design. Breaker ratings from 20 A to 600 A use unique drawout cassettes. Breakers are inserted and removed via a mechanical removal system similar to other drawout designs associated with switchgear; however, these breakers are horizontally mounted in a traditional panelboard group-mounted manner.

## Market and Segment Applications

While the drawout MCCB panelboard design may be substituted for nearly any traditional application with feeder MCCBs, it has been specifically designed to meet the needs of several industries, including:

- Electrical distribution systems where a changeout of circuit breakers is needed to upgrade equipment to a new process
- Data centers
- Industrial facilities to minimize downtime
- Institutions
- Laboratories
- Healthcare facilities
- Critical load applications

## Standards and Certifications

- UL® 67 Listed for wall-mounted applications from 600 A to 1200 A
- National Electrical Code®

## Available Ratings

The panelboards are rated at 240 Vac, 480 Vac and 600 Vac. Fault current is available up to 200 kAIC at 240 Vac, 100 kAIC at 480 Vac and 65 kAIC at 600 Vac. The short-circuit current rating of the panelboard is determined by the low short-circuit current rating of the lowest rated overcurrent device in the panelboard.

Boxes and trims are UL 50 Listed and labeled. Both the box and the trim are painted ANSI-61 light gray. Deadfront covers are also painted ANSI-61 light gray to match box and trim.

Drawout feeder MCCBs are available in two- and three-pole offerings from 20 A to 600 A. Main breakers above 600 A are fixed-mounted using a traditional bolt-on design. Main breakers 600 A and below are available with either the traditional fixed-mounted, bolt-on design or in a drawout cassette. For drawout mains or feeders above 600 A, please use Eaton's switchboard offering.

## Panelboard Options

- Copper and silver-plated copper
- Copper lugs
- Density-rated bus
- Ground bars
- Customer-owned meters
- Service entrance equipment construction
- Surge protective devices
- Seismically qualified panelboards

## General Construction Features

Eaton's assembled panelboards are designed for sequence phase connection of branch circuit devices. This allows complete flexibility of circuit arrangement (single-, two- or three-poles) to allow balance of the electrical load on each phase.

Sturdy, rigid chassis assembly ensures accurate alignment of interior with panel front; prevents flexing and minimizes possibility of loosening or damage to current carrying parts during and after installation.

Four point in-and-out adjustment of panel interior is provided to meet critical depth dimensions on flush installations. This compensates for possible misalignment of box at installation.

Main lugs are mechanical solderless type and approved for copper and aluminum conductors.

## Enclosures

Boxes are code-gauge galvanized steel except for column type panelboards, which include a painted box finished in ANSI-61 light gray to match the trim. Standard panelboard cabinets are designed for indoor use. Alternate types are available for outdoor and special purpose applications.

All enclosures are furnished in accordance with UL standards and include wiring gutters with proper wire bending space. Special cabinets can be provided at an additional charge.

The box dimensions shown are inside dimensions. For outside dimensions, add 0.25-inch (6.4 mm).

Standard panelboard boxes are supplied without knockouts (blank endwalls).

### **EZ™ Trim**

The EZ Box and EZTrim are provided standard for Pow-R-Line 1X and Pow-R-Line 2X lighting panelboards, as well as Pow-R-Line 3X and Pow-R-Line 3E mid-range panelboards.



***EZTrim Provides Standard Door-in-Door Construction With No Exposed Hardware or Sharp Ridges. No Tools are Required for Installation.***

The trims for lighting and appliance branch circuit panelboards and small power distribution panelboards include a door with rounded corners and concealed hinges. A flush-type latch and lock assembly is included. All locks are keyed alike. These trims are available in both surface and flush mounted designs.

Fronts for power distribution panelboards use a unique breaker front cover design in which each device has a dedicated bolt-on steel cover. The individual covers form a single deadfront for the panelboard that is used in conjunction with two wiring gutter covers to complete the trim. A door is not finished as part of the standard offering on these panelboards but can be provided, for an additional charge, using a deeper than standard box.

### **Combination AFCI Circuit Breakers**

Eaton's 125 Vac AFCI single- and two-pole, 15 A and 20 A bolt-on breakers in panelboards meet Article 210.12 of the NEC®. See the NEC for definitions and details.

### **Fusible Panelboards**

Pow-R-Line 1XF and Pow-R-Line 2XF fusible lighting panelboards were developed for ultra high fault currents and for use in selective coordination applications and test circuits.

## Application Considerations and Definitions

### Standards

All Eaton's panelboards are designed to meet the following applicable industry standards, except where noted:

1. Underwriters Laboratories
  - a. Panelboards: UL 67
  - b. Cabinets, boxes and trims: UL 50

**Note:** Only panelboards containing UL listed devices can be UL labeled.

2. National Electrical Code
3. NEMA Standards: PB 1
4. Federal Specification W-P-115c  
Circuit breaker— Type I Class 1  
Fusible switch— Type II Class 1

### Panelboard Selection Factors

In selecting a panelboard, the following factors must be considered:

- a. Service (voltage and frequency).
- b. Interrupting capacity (fully or series rated).
- c. Ampere rating of main.
- d. Ampere ratings of branches.
- e. Installation environment.
- f. Codes and standards mandates.

### Panelboard Short-Circuit Rating

The short-circuit rating of Eaton's assembled panelboards are test verified by, and listed with, Underwriters Laboratories. Generally, these ratings are that of the lowest interrupting rated device in the panel.

Certain exceptions to this rule exist where branch devices have been UL tested in combination with specific main devices having a higher interrupting rating. Where these defined main breaker and branch breaker combinations are used, the **series short-circuit rating** of the assembled panelboard will be the same as the series tested rating of the approved rated main breaker. Available main and branch breaker combinations are tabulated on **Page 22.6-18** through **Page 22.6-26** All combinations shown are UL tested and listed.

These series ratings apply to panels having main devices, or main lug only panelboards fed remotely by the device listed in the series ratings chart as the main, for which UL listed tests were conducted.

### Selective Coordination

Please refer to Molded Case Circuit Breakers Design Guides for detailed information on overcurrent protective device combinations for use on selectively coordinated systems.

### Service Entrance Equipment

NEC Articles 230.F and G, and UL, require that:

- a. Panels used as service entrance equipment must be located near the point where the supply conductors enter the building.
- b. A panelboard having main lugs only shall have a maximum of six service disconnects to de-energize the entire panelboard from the supply conductors. Where more than six disconnects are required, a main service disconnect must be provided.
- c. Must include connector for bonding and grounding neutral conductor.
- d. A service-entrance-type UL label must be factory installed.
- e. Ground fault protection of equipment shall be provided for solidly grounded wye electrical services of more than 150 V to ground, but not exceeding 600 V phase-to-phase for each service disconnecting means rated 1000 A or more.

Service entrance panels must be identified as such on the order entry to the manufacturing location.

### Column Type Panelboards

The same general code restrictions apply as for standard width panels except where trough extensions are used.

### Multi-Section Panelboards

When more than 42 overcurrent protective devices are required, two or more separate enclosures may be required. Separate fronts for each box are standard.

### Interconnecting Multi-Section Panelboards

When a panelboard, for connection to one feeder, must be furnished in more than one section (box), each section must be furnished with main bus and terminals of the same rating, unless a main overcurrent device is provided in each section.

Sub-feed or through-feed provisions must also be added to provide connection capability to the second section.

**Note:** Sub-feed or through-feed lugs cannot be used on any panelboard that is not protected by a single main overcurrent device either in the panelboard or immediately upstream, i.e., service entrance panelboards with main lugs only using the six disconnect rule.

### Sub-Feed Lugs (Figure 22.9-1)

Sub-feed lugs are one means of interconnecting multi-section panels. The sub-feed (second set of) lugs are mounted directly beside the main lugs. These are required in each section except the last panel in the lineup. The feeder cables are brought into the wiring gutter of the first section and connected to the main lugs. Another set of the same size cables are connected to the sub-feed lugs (Section 1) and are carried over to the main lugs of the adjacent panel. Cross connection cables are not furnished by Eaton. Sub-feed lugs are only available on main lug only panels.

**Note:** Sub-feed lugs may not be used on main lug only (six disconnect rule) service entrance panels.

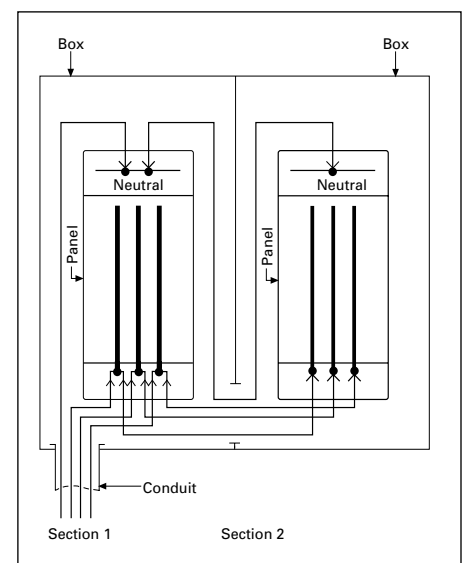


Figure 22.9-1. Sub-Feed Lugs

### Through-Feed Lugs (Figure 22.9-2)

Through-feed lugs are another method to interconnect multi-section panelboards. The incoming feeder cables are connected to the main lugs or main breaker at the bottom of panel (Section 1). Another set of lugs (through-feed) are located at the opposite end of the main bus. The interconnecting cables are connected to the through-feed lugs in Section 1 and are carried over to the main lugs in Section 2. The connection arrangement could be reversed, i.e., main lugs at top; through-feed lugs at bottom end of panel. Cross cables are not furnished by Eaton.

**Note:** Through-feed lugs may not be used on main lug only (six disconnect rule) service entrance panels.

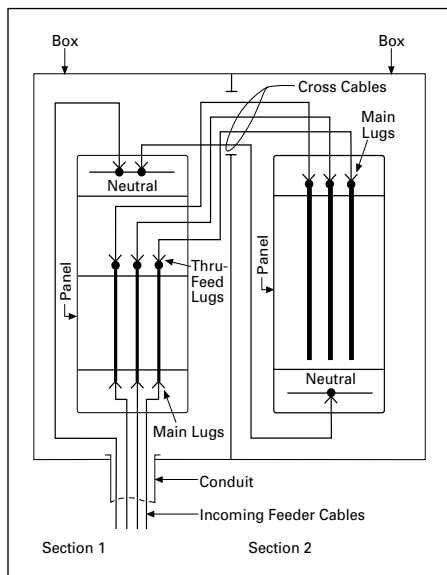


Figure 22.9-2. Through-Feed Lugs

### Multiple Section Panelboard—Flush Mounted

Shown below is the standard method for flush mounting multiple section lighting and distribution panelboards using standard flush trims.

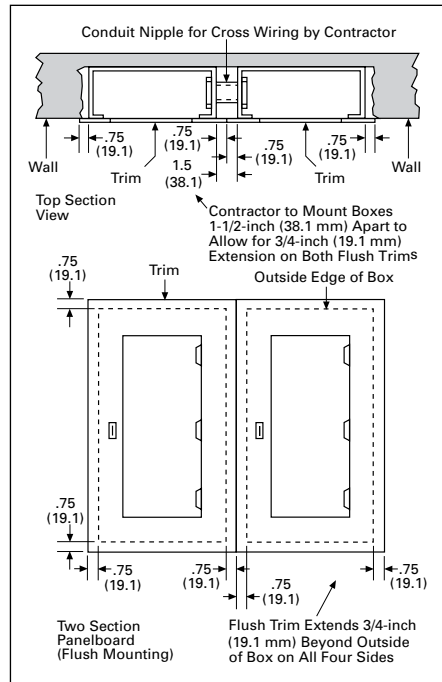


Figure 22.9-3. Multiple Section Panelboard—Flush Mounted—Dimensions in Inches (mm)

### Branch Circuit Loading for Lighting Panels

The size of mains and branches should be selected based on the following:

- Lighting circuits: NEC Article 210, 215, 220 and 240.
- Distribution circuits, actual or continuous loads: NEC Article 384.16.
- Motor circuits: NEC Article 430.
- Diversity factor.
- Provision for future loading.

### Overcurrent Protection

National Electrical Code Article 408 states a panelboard shall be protected by an overcurrent protective device having a rating not greater than that of the panelboard. The overcurrent protective device shall be located within or at any point on the supply side of the panelboard.

Exceptions to Article 408 selectively apply. Refer to the National Electrical Code Article 408 for specifics.

### Ground Fault Protection

Ground fault protection (GFP) may be added to most panelboards using Eaton's integral molded case circuit breaker GFP and included feeder devices on power panelboards and mains on all panelboards.

### Arcflash Reduction Maintenance System™

Eaton's Arcflash Reduction Maintenance System is available on many molded case circuit breakers from 70 A to air power circuit breakers at 5000 A. Recognized by the 2011 National Electrical Code and the National Electrical Safety Code (NFPA 70E), the Arcflash Reduction Maintenance System allows breakers to trip quickly thus significantly reducing the available arc flash potential.

### Ambient Temperatures

The primary function of an overcurrent device is to protect the conductor and its insulation against overheating. In selecting the size of the devices and conductors, consideration should be given to the ambient temperature surrounding the conductors within and external to the panelboard. Cumulative heating within the panelboard may cause premature operation of the overcurrent protective devices.

UL test procedures are based, in part, on 80% loading of panelboard branch circuit devices. Article 408 of the NEC limits the loading of overcurrent devices in panelboards to 80% of rating where in normal operation the load will continue for three hours or more.

Further derating may be required, depending on such factors as ambient temperature, duty cycle, frequency or altitude.

**Exception:** There is one exception to this rule in both UL and NEC. It applies to assemblies and overcurrent devices that have been approved for continuous duty at 100% of its rating. This exception is covered in NEC 210.20 (a). Also see Molded Case Circuit Breakers Design Guides for additional information.

### Special Conditions

Standard panelboards, assembled with standard components, are adequate for most applications. However, special consideration should be given to those required for application under special conditions such as:

- a. Excessive vibration or shock.
- b. Frequencies above 60 cycles.
- c. Altitudes above 6600 ft (2012 m).
- d. Damp environment (possible fungus growth).
- e. Compliance with federal, state and municipal electrical codes and standards.

### Seismic Qualification



Refer to Power Distribution Systems Design Guides for information on seismic qualification for this and other Eaton products.

### Harmonic Currents

Standard panelboard neutrals are rated for 100% of the panelboard current. However, because harmonic currents can cause overheated neutrals, an option is provided for neutrals to be rated at 200% (1200 A maximum neutral for 600 A main bus) of the panelboard phase current. Panelboards with the 200% rated neutral are UL listed as suitable for use with nonlinear loads.

Prior to specifying the 200% rated neutral, Eaton recommends a harmonic survey be conducted of the distribution system, be it new or existing.

### Surge Protective Devices (SPD)

The quality of power feeding sensitive electronic loads is critical to the reliable operation of any facility. In modern offices, hospitals and manufacturing facilities, the most frequent causes of microprocessor-based equipment downtime and damage are voltage transients and electrical noise.

Electrical loads and microprocessor-based equipment are highly susceptible to both high and low energy transients. High energy transients include lightning induced surges and power company switching. These high energy transients can destroy components instantly.

More frequently the electrical system experiences low energy transients and high frequency noise.

The effects of continual low energy transients and high frequency noise can cause erratic equipment performance or sudden failure of electronic circuit board components.

Eaton can provide protective and diagnostic systems integral to panelboards. The SPD is integrated into the panelboards using a "zero lead length" direct bus bar connection. Integral disconnect is used on all Pow-R-Line 4 panels.



Eaton SPDs May be Integrated into Most Panelboards

The SPD protects sensitive electronic equipment from the damaging effects of high and low energy transients.

For complete product description and available ratings, refer to Surge Protection (SPD) & Power Conditioning Products Design Guides.

### Compact Panelboard Meter

Most Eaton panelboards can integrate a compact meter for reading the panelboard power and energy usage. Eaton's Power Xpert Meter 350 has ANSI 12.20 0.5% accuracy, a bright backlit LCD display, real energy pulse output, phase loss alarm and optional RS-485 communication capability.

## Pow-R-Line 1XF Fusible Panelboard



*Pow-R-Line 1XF*

### General Description

#### Panelboard Ratings

##### Voltage

- 240 Vac maximum

##### Main Lugs

- 100–400 A

##### Main Breakers

- 100–400 A

##### Branch Devices

- 30 A
- Hybrid breaker and fuse
- Class “CC” fuses, 30 A maximum

##### Short-Circuit Current Ratings (Symmetrical)

- 240 Vac: 200 kA fully rated

##### Service

- Three-phase, four-wire 208Y/120 V and 240/120 V delta
- Single-phase, three-wire 120/240 V
- Single-phase, two-wire 120 V
- Three-phase, three-wire 208 and 240 V

Suitable for service entrance applications when specified.

### Mains

For available mains, refer to **Table 22.9-1**.

Main breakers are vertically mounted.

### Branch Circuits

For available branch devices, refer to **Table 22.9-2**.

### Application Description

For use on high fault current systems requiring lighting panels, selectively coordinated systems and laboratories and testing stations where overcurrent protection below 15A is required.

### Main Lugs Only

The short-circuit rating of the MLO assembled panelboard will be fully rated based upon the upstream device.

Main lugs only ampere ratings: 100, 225 and 400.

### Main Circuit Breakers

The short-circuit rating shown is that of the main breaker only. The short circuit rating of the assembled panelboard is the rating of the lowest fully rated main or branch device or the rating of an approved series rated combination.

**Table 22.9-1. Main Circuit Breakers**

Breaker Frame Amperes	Breaker Type	Interrupting Rating (kA Symmetrical) at 240 Vac
100	PDD2xF	22
100	PDD2xG	65
100	PDG2xG	65
100	PDG3xG	65
100	PDD2xM	100
100	PDG2xM	100
225	PDD2xF	22
225	PDD2xG	65
225	PDG2xG	65
225	PDG3xG	65
225	PDD2xM	100
225	PDG2xM	100
400	PDD3xGy	42
400	PDG3xG	65
400	PDG3xM*	100
400	PDG3xP*	200
400	LHH	200

**Table 22.9-2. Branch Overcurrent Devices**

Hybrid breaker/fuse (Class CC) branch device ①

Ampere Rating	Interrupting Rating	Breaker Type
30	200	Hybrid

① Class “CC” fuses are required, 30A maximum. Fuses are not supplied by Eaton.

## Pow-R-Line 2XF Fusible Panelboard



*Pow-R-Line 2XF*

### General Description

#### Panelboard Ratings

##### Voltage

- 240 Vac
- 480Y/277 Vac maximum

##### Main Lugs

- 100–400 A

##### Main Breakers

- 100–400 A

##### Branch Devices

- 30 A (bolt-on)
- Hybrid breaker and fuse
- Class “CC” fuses, 30 A maximum

##### Short-Circuit Current Ratings (Symmetrical)

- 480Y/277 Vac: 200 kA fully rated

##### Service

- Three-phase, four-wire 480Y/277 V

Suitable for service entrance applications when specified.

### Application Description

For use on high fault current systems requiring lighting panels, selectively coordinated systems and laboratories and testing stations where overcurrent protection below 15 A is required.

#### Mains

For available mains, refer to **Table 22.9-3**.

#### Branch Circuits

For available branch devices, refer to **Table 22.9-4**.

#### Main Lugs Only

The short-circuit rating of the MLO assembled panelboard will be fully rated based upon the lowest rated branch device or may be series rated with an approved upstream device.

Main lugs only ampere ratings: 100, 225 and 400.

#### Main Circuit Breakers

The short-circuit rating shown is that of the main breaker only. The short-circuit rating of the assembled panelboard is the rating of the lowest fully rated main or branch device or the rating of an approved series rated combination.

**Table 22.9-3. Main Circuit Breakers**

Breaker Frame Amperes	Breaker Type	Interrupting Rating (kA Symmetrical) at 480Y/277 Vac
100	PDG2xG,	35
100	PDG3xG	65
100	PDG2xM	100
	PDG2xP	
225	PDG2xG,	35
225	PDG3xG	65
225	PDG2xM	100
	PDG2xP	
400	PDG3xM*	35
400	PDG3xG	65
400	PDG3xP*	100
400	LHH	100

**Table 22.9-4. Branch Overcurrent Devices**

Hybrid breaker/fuse (Class CC) branch device ①

Ampere Rating	Interrupting Rating	Breaker Type
30	200	Hybrid

① Class “CC” fuses are required, 30A maximum. Fuses are not supplied by Eaton.



## Circuit Breaker Technical Data

Table 22.9-5. Electrical Characteristics of Circuit Breakers

Circuit Breaker Ratings				UL Listed Interrupting Ratings (kA rms Symmetrical)						
Type	Ampere Rating	Number of Poles	Volts AC	AC Rating, Volts					DC Rating, Volts ①	
				120/240	240	277	480	600	125	250
PDG2xF	15–100 15–100	1 2, 3	277 480	— —	— 18	14 —	— 14	— —	10 —	— 10
PDG2xG, PDG3xG*	15–150 15–225	1 2, 3	277 600	— —	— 65	35 —	— 35	— 18	10 —	— 10
PDD2xF PDD2xG PDD3xGY	100–225 100–225 250–400	2, 3 2, 3 2, 3	240 240 240	— — —	22 65 65	— — —	— — —	— — —	10 10 —	— — 10
PDG3xG* ②, PDF3xG ③ LHH ④	100–400 150–400	2, 3 2, 3	600 480	— —	65 100	— —	35 65	25 35	— —	10 42
<b>High Interrupting Capacity Circuit Breakers</b>										
PDG2xM	15–150 15–225	1 2, 3	277 600	— —	— 100	65 —	— 65	— 25	10 —	— 22
PDD2xM PDG3xM* ②, PDF3xM ③	100–225 100–400	2, 3 2, 3	240 600	— —	100 100	— —	— 65	— 35	10 —	— 22
<b>Current Limiting Circuit Breakers</b>										
PDG2xP PDD2xM	15–225 100–225	2, 3 2, 3	600 240	— —	200 200	— —	100 —	35 —	— 10	22 —
PDG3xP* ② PDG3xM* ④	100–400 250–600	2, 3 2, 3	600 600	— —	200 200	— —	100 100	65 50	— —	22 42

① DC ratings apply to substantially non-inductive circuits.

② Available with integral ground fault protection.

③ 100% rated breaker.

④ DC rating not available with PXR trip units.

⑤ 100k based on NEMA test procedure.

### Terminal Wire Ranges, Pressure-Type Al/Cu Terminals Except as Noted

Where copper-aluminum terminals are supplied on designated panelboard types, best results are obtained if a suitable joint compound is applied when aluminum conductors are used.

**Table 22.9-6. Standard Main Lug Terminals**

Panel Type	Wire Size Ranges for Ampere Capacity						
	100 A	225 A	250 A	400 A	600 A	800 A	1200 A
Pow-R-Line 1X, 1XF, 1RX	#12-1/0	#6-300 kcmil	—	(2) #4-500 kcmil	(2) #4-500 kcmil ①	—	—
Pow-R-Line 2X, 2XF, 2RX	#12-1/0	#6-300 kcmil	—	(2) #4-500 kcmil	(2) #4-500 kcmil ①	—	—

① Not applicable PRL 1XF, 1RX, PRL 2XF, 2RX.

**Note:** Optional 750 kcmil mechanical screw-type terminals are available upon request. Panelboard dimensions may be affected. Refer to Eaton.

**Table 22.9-7. Standard Main Breaker and Branch Breaker Terminals**

Breaker Type	Ampere Rating	Wire Size Ranges
PDD2xF, PDD2xG PDD2xM, PDD2xM ②	100-225	#4-4/0 or #6-300 kcmil
PDG2xF, PDG2xG PDG2xM, PDG2xP ②, HFDDC ③	15-100 125-225	#14-1/0 #4-4/0
PDD3xGy	250-350 400	250-500 kcmil (2) 3/0-250 kcmil or (1) 3/0-500 kcmil
PDG3xG* PDG3xM*, PDG3xP* HKDDC ③, PDF3xG ② PDF3xM ②	225 350 400	(1) #3-350 kcmil (2) 3/0-250 kcmil or (2) 3/0-250 kcmil or (1) 3/0-500 kcmil
LHH	150-400	#2-500 kcmil (2) #2-500 kcmil or (1) 500-750 kcmil
PDG3xG*, PDG3xM*, PDG3xM*	250-400 500-600	(1) #2-500 kcmil (2) #2-500 kcmil

② Suitable for DC applications only.

③ LHH is 400 A maximum.

**Table 22.9-8. Fusible Switch Terminals**

Ampere Rating	Wire Size Ranges
30	#14-1/0
60	#14-1/0
100	#14-1/0
200	#4-300 kcmil
400	250-750 kcmil or (2) 3/0-250 kcmil

## Power Xpert Release Trip Unit for Molded Case Circuit Breakers

### Description

Eaton's Power Xpert Release (PXR) trip units are programmable communicating microprocessor-based low-voltage electronic trip unit systems for Eaton molded case circuit breakers. PXR trip units are available in four models: PXR 10, PXR 20, PXR 20D and PXR 25.

### Standards and Certifications

The PXR trip units are listed by Underwriters Laboratories (UL) and Canadian Standards Association (CSA) for use in Frame PD-2, PD-3, PD-4, PD-5 and PD-6 molded case circuit breakers. All PXR units have also passed the IEC 60947-2 test program that includes EMC testing. All trip units meet the low-voltage and EMC directives and carry the CE mark.

### Features


The PXR electronic trip units provide an enhanced and easy-to-use interface that enables end users and maintenance engineers to more easily change set points, test and configure circuit breakers, and review energy and power information. Also, the Power Xpert Protection Manager software provides the capability of secondary injection tests and reports on-demand without the need of expensive test kits.

Advanced features include:


- Industry-first breaker health algorithms provide real-time monitoring and communication of breaker condition
- Cause of trip LED indication and trip event data storage
- Zone selective interlocking (ZSI) verification and testing indication
- Adjustable Arcflash Reduction Maintenance System™ (ARMS) settings
- LCD display with programmable settings



**Arcflash Reduction Maintenance System (ARMS)**

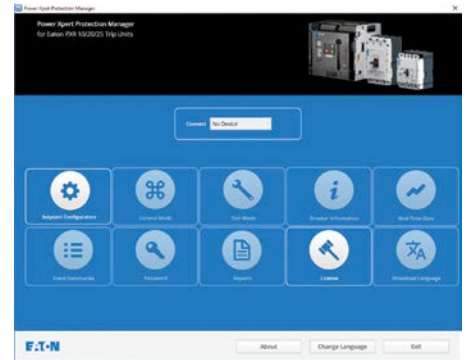

**Power Xpert Protection Manager (PXPM) Software**

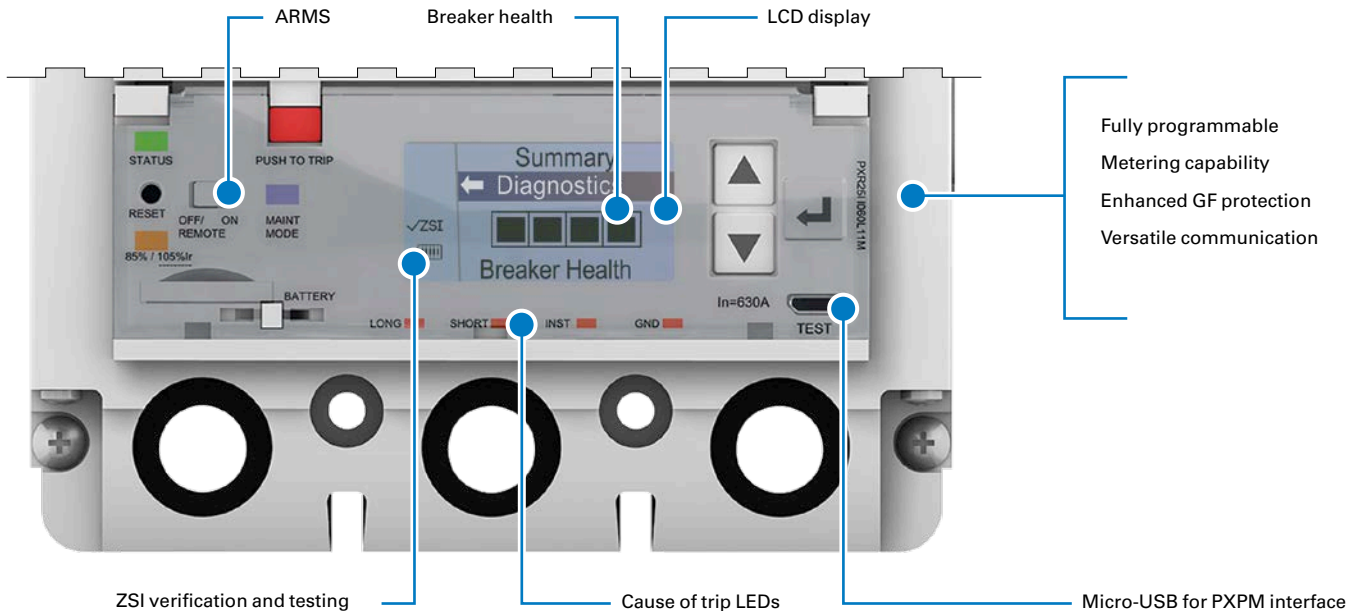

- Fully programmable
- Metering capability
- Enhanced GF protection
- Versatile communication

**PXR 25 Trip Unit Features**

**Table 22.9-9. Power Xpert Release (PXR) Features**

Features	PXR 10	PXR 20	PXR 20D	PXR 25
Protection types	LSI	LSI/LSIG	LSI/LSIG	LSI/LSIG
Status indication	Standard	Standard	Standard	Standard
USB secondary injection testing	Standard	Standard	Standard	Standard
Programmable by USB port (PXPM)	Standard	Standard	Standard	Standard
Independent instantaneous adjustment	Standard	Standard	Standard	Standard
Adjustable L, S, I, G pickup and time		Standard	Standard	Standard
Cause of trip indication	Available through USB port (PXPM)	Standard	Standard	Standard
Load alarm indication with 2 levels		Standard	Standard	Standard
Programmable load alarm levels			Standard	Standard
Ground fault protection and alarm		Optional	Optional	Optional
Arcflash Reduction Maintenance System (ARMS) Available PD3, PD4, PD5, PD6		Optional	Optional	Optional
Zone selective interlocking (ZSI) with indication		Optional	Optional	Optional
Programmable relays		Optional	Standard	Standard
Modbus RTU communication		Optional	Standard	Standard
CAM module communication		Optional	Optional	Optional
Rotatable LCD display			Standard	Standard
Breaker health and diagnostic monitoring		Available through USB port (PXPM)	Standard	Standard
Voltage metering accurate to 0.5%				Standard
Power and energy metering accurate to 1%				Standard

## Metering and Surge Protective Devices



*Power Xpert Meter 350*

### Power Xpert Meter 350

The Power Xpert Meter 350 (PXM350) is a revenue grade energy meter that delivers a cost-effective solution for energy and submetering applications. This DIN rail mounted, three-phase energy meter provides high accuracy in a small form factor. The user-friendly LCD display is ideal for building energy management, energy monitoring and metering systems.

Meter features include:

- Data collection and management for energy and multi-parameters measurement
- Demand measurement and forecasting of current, active power, reactive power and apparent power
- System event logging with configurable parameter alarms
- LCD display with backlight support
- Electronic and physical sealing to prevent tampering

For more information on other available power meters, visit [www.eaton.com/meters](http://www.eaton.com/meters).



*Integrated Surge Protective Devices*

### Integrated Surge Protective Devices

Eaton integrates our industry-leading surge protective devices (SPD) in to switchboards. Lead length is kept to a minimum to maximize SPD performance. SPD units are available with ratings up through 400k, and are UL listed and labeled to UL 1449 3rd Edition.

All switchboards with integrated SPD units are connected to a lineside overcurrent protective device for disconnecting means. When applied on the lineside of a service entrance main, the disconnecting means does not count as a service disconnect per National Electrical Code Article 230.71[A].

For complete SPD product description, application and ratings, visit [www.eaton.com/spd](http://www.eaton.com/spd).

## PRL1XF Layout Guide



### Technical Data and Specifications

#### Bussing

100–400 A: Tin-plated aluminum is standard, copper is available as an option.

#### Boxes

Boxes are made from code-gauge galvanized steel.

Blank ends are supplied as standard, knockouts are available upon request.

#### Trim

Trims are made from code-gauge steel and painted ANSI 61 gray Type YS.

#### Modifications

**Table 22.9-10. Through-Feed Lugs**

Ampere Rating	Information
100	See <a href="#">Table 22.9-11</a>
225	See <a href="#">Table 22.9-11</a>
400	See <a href="#">Table 22.9-11</a>

#### Ground Bar

Standard bolted in box. Aluminum is standard, copper is available as an option.

#### Enclosures

Type 1.

### Box Sizing and Selection

Box size for all Type 1 panelboards are available from [Table 22.9-11](#).

#### Instructions

1. Select the rating and type of mains required.
2. Count total number of branch circuit poles (including spaces) required in the panelboard. Do not count main breaker poles.
3. Using correct table, type of mains and ampere rating per Step 1, find total number of poles.

**Note:** Where total number of poles (Step 2) fall between number in table, use the next higher number.

4. Read box size across columns to the right.

#### Top and Bottom Gutters (minimum)

5.50 inches (139.7 mm).

#### Side Gutters

28.00-inch (508.0 mm) wide box:  
6.50 inches (165.1 mm).

**Table 22.9-11. Type 1 Panelboards—Dimensions in Inches (mm)**

Ampere Rating of Mains	Main Breaker Type Mounting Position	Maximum Number of Branch Circuits Including Provisions	Box Dimensions		
			Height	Width	Depth
<b>100 A</b>					
100 A Main lugs or main breaker	PDG2xF, PDG G,	18	36.00 (914.4)	28.00 (711.2)	5.75 (146.1)
	PDG3xG,	30	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)
	PDG2xM,	42	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)
	P2DxG P Vertical	48	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)
100 A Main lugs or main breaker with 100A through-feed lugs	PDG2xF, PDG G	18	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)
	PDG3xG,	30	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)
	PDG2xM,	42	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)
	P2DxG P Vertical	48	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)
<b>225 A</b>					
225 A Main lugs or main breaker	PDD2xF, PDD G,	18	36.00 (914.4)	28.00 (711.2)	5.75 (146.1)
	PDD2xM	30	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)
	PDD2xM,	42	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)
	PDG2xG PDG2xM PDG2xP PDG3xG Vertical	48	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)
225 A Main lugs or main breaker with 225 or 100 A through-feed lugs	PDD2xF	18	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)
	PDD2xG	30	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)
	PDG2xF	42	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)
	PDG2xG	48	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)
	PDD2xM				
	PDG2xG PDG2xM PDG2xP PDG3xG Vertical				
<b>400 A</b>					
400 A Main lugs or main breaker	PDD3xGy	18	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)
	PDG3xG	30	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)
	PDG3xM*	42	72.00 (1828.8)	28.00 (711.2)	5.75 (146.1)
	PDG3xP LHH Vertical	48	72.00 (1828.8)	28.00 (711.2)	5.75 (146.1)

## PRL2XF Layout Guide



### Technical Data and Specifications

#### Bussing

100–400 A: Tin-plated aluminum is standard, copper is available as an option.

#### Boxes

Boxes are made from code-gauge galvanized steel.

Blank ends are supplied as standard, knockouts are available upon request.

#### Trim

Trims are made from code-gauge steel and painted ANSI 61 gray, Type YS.

#### Modifications

Table 22.9-12. Through-Feed Lugs

Ampere Rating	Information
100	See Table 22.9-13
225	See Table 22.9-13
400	See Table 22.9-13

#### Ground Bar

Standard bolted in box. Aluminum is standard. Copper is available as an option.

#### Enclosures

Type 1.

### Box Sizing and Selection

Box size for all Type 1 panelboards are available from Table 22.9-13.

#### Instructions

- Using description on the required panelboard, select the rating and type of mains required.
- Count total number of branch circuit poles (including spaces) required in the panelboard. Do not count main breaker poles.
- Using correct table, type of mains and ampere rating per Step 1, find total number of poles.

**Note:** Where total number of poles (Step 2) fall between number in table, use the next higher number.

- Read box size across columns to the right.

### Top and Bottom Gutters (Minimum)

5.50 inches (139.7 mm).

### Side Gutters

20.00-inch (508.0 mm) wide box:  
5.50 inches (139.7 mm).

Table 22.9-13. Type 1 Panelboards—Dimensions in Inches (mm)

Ampere Rating of Mains	Main Breaker Type Mounting Position	Maximum Number of Branch Circuits Including Provisions	Box Dimensions			
			Height	Width	Depth	
<b>100 A Panelboards</b>						
100 A Main lugs or main breaker	PDG2xG, PDG3xG PDG2xM, PDG2xP Vertical	18	36.00 (914.4)	28.00 (711.2)	5.75 (146.1)	
		30	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)	
		42	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)	
		48	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)	
100 A Main lugs or main breaker with 100 A through-feed lugs	PDG2xG, PDG3xG PDG2xM, PDG2xP Vertical	18	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)	
		30	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)	
		42	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)	
		48	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)	
<b>225 A Panelboards</b>						
225 A Main lugs or main breaker	PDG2xG, PDG2xM PDG2xP, PDG3xG Vertical	18	36.00 (914.4)	28.00 (711.2)	5.75 (146.1)	
		30	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)	
		42	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)	
		48	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)	
225 A Main lugs or main breaker with 100 A through-feed lugs	PDG2xG, PDG3xG PDG2xM, PDG2xP Vertical	18	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)	
		30	48.00 (1219.2)	28.00 (711.2)	5.75 (146.1)	
		42	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)	
		48	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)	
<b>400 A Panelboards</b>						
400 A Main lugs or main breaker	PDD3xGy, PDG3xG PDG3xM*, PDG3xP* LHH Vertical	18	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)	
		30	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)	
		42	72.00 (1828.8)	28.00 (711.2)	5.75 (146.1)	
		48	72.00 (1828.8)	28.00 (711.2)	5.75 (146.1)	
400 A Main lugs or main breaker with 100 A through-feed lugs	PDD3xGy, PDG3xG LHH PDG3xM*, PDG3xP* Vertical	Main	18	60.00 (1524.0)	28.00 (711.2)	5.75 (146.1)
			30	72.00 (1828.8)	28.00 (711.2)	5.75 (146.1)
			42	72.00 (1828.8)	28.00 (711.2)	5.75 (146.1)
			48	90.00 (2286.0)	28.00 (711.2)	5.75 (146.1)

## Series Rated Combinations


UL permits panelboards to be labeled with a short-circuit rating of up to 200,000 A symmetrical where UL listed combinations of main and branch circuits are used.

These combinations consist of main breakers or fusible devices connected ahead of, and in series with approved conventional devices.


Two arrangements are acceptable and comply with UL standards for panelboards. The main circuit breaker may be installed in the panel as a main device (**Figure 22.9-4**), or it may be mounted remote (**Figure 22.9-5**) from the panel. In either case, the approved main and branch combinations must be followed. These arrangements are acceptable and are UL listed having been tested in accordance with UL standards.

From the tables on **Page 22.9-18** through **Page 22.9-26**, specific combinations of main devices (upstream) and branch devices (downstream), series connected and electrically adjacent in the system, may be selected to qualify the assembled panelboard for the short-circuit ratings shown. Series ratings apply **only** to those Eaton breakers listed and published.

**Do not use "Classified" breakers.**

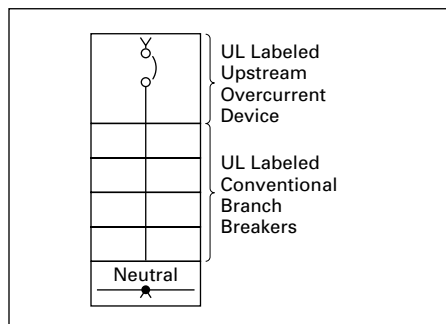

**Figure 22.9-4. Main Device**

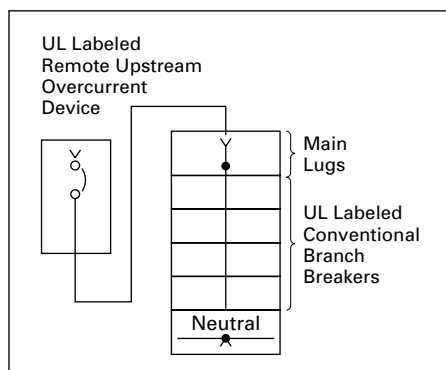

**Figure 22.9-5. Mounted Remote**

Industry standards and the NEC require protection of the entire electrical distribution system from damage due to short-circuit faults. Article 230.205 of the NEC states that service entrance equipment shall be suitable for the short-circuit current available at its supply terminals. The entire distribution system is required to meet this standard. Series rated systems have become an effective method of meeting these requirements.

There are three protection systems used to protect low voltage power distribution equipment. They are:

- Fully rated protection
- Fully rated, selectively coordinated protection
- Series rated protection

**Fully Rated Protection**—Where all overcurrent devices are rated for the full prospective short-circuit current at their line side terminals throughout the system.

**Selectively Coordinated Protection**—A fully rated system where the overcurrent device closest to the fault will open first, thus isolating the faulty circuit.

**Series Rated Protection**—A short-circuit interrupting rating assigned to a combination of two or more over-current protective devices that are connected in series and in which the rating of the downstream device(s) in the combination is less than the series rating.

Series ratings are also known in the industry as integrated ratings, series combination ratings and series connected ratings.

### UL Issues

In a series rated system, all of the overcurrent devices in series in the protective scheme must have been tested and listed by Underwriters Laboratories for series combination use in the system.

All Eaton's series ratings are in full compliance with all applicable requirements of the latest editions of UL 489, 891 and 67.


The UL Recognized Component Directory (the Yellow Book) contains breaker manufacturers' series connected listings. These are intended **ONLY** as a guideline for use by others who are responsible for their own testing, labeling and listing. Therefore, the UL Recognized Component Directory cannot be used to interpret series connected ratings in assembled equipment. The assembled equipment must also be UL tested for series ratings.

### Code Issues

The fault current contribution of motors connected between series rated breakers must be considered. Article 240.86 in the NEC states that for series ratings, the sum of the motor full-load currents cannot exceed 1% of the interrupting rating of the lower rated circuit breaker. The actual fault current contribution from induction motors is about four times their full-load current (impedance value of 25%). For example, if the downstream branch circuit breakers used in a series rated combination have an interrupting rating of 14,000 A rms symmetrical for a 480 V system, the maximum allowable motor contribution to that panel from the branch circuit breakers is 140 A (1%). For typical induction motors, this is equivalent to a total horsepower at 480 V of approximately 115 horsepower.

Requirements of the NEC (NFPA-70) for series ratings may be met by equipment marked with ratings adequate for the available fault current at the point of application in the electrical system. Eaton panelboards and switchboards are marked consistent with NEC Article 240.83.

Additionally, Article 110.22 requires field marking on equipment where series ratings are used. This label is supplied standard with all Eaton panelboards and switchboards.

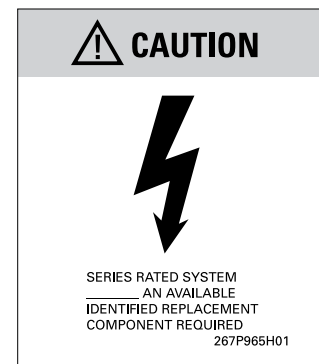

**NEC Required Caution Label**

**Note:** The NEC requires the installer to properly apply and complete this label. Label(s) must be placed on all equipment where series ratings are used.



## Fuse Application Considerations

Fuses can be used instead of circuit breakers in fully rated, selectively coordinated and series connected protection systems. See the tables on **Page 22.9-24** through **Page 22.9-26** for fuse breaker data applied to series connected designs.

Don't apply fuses using the up-over-down method, which has been recommended by some fuse manufacturers for sizing a current-limiting fuse that protects a downstream molded case circuit breaker with a specified rms symmetrical interrupting rating. The method can lead to erroneous and unsafe conclusions, and should not be used.


**Example:** Assume a specific type of current-limiting fuse rated 2000 A. Then using the figure below:

1. Draw a vertical line from the prospective short-circuit current of 200 kA to intersect the typical peak let-through curve at "A."
2. Draw a horizontal line left from Point "A" to intersect the "prospective peak" curve at "B."
3. Drop a vertical line from "B" to intersect the horizontal axis and read the recommended rating, 65 kA rms, concluding that a circuit breaker with a 65 kA interrupting capacity will be protected by a specified 2000 A current-limiting fuse.

**This conclusion is wrong when the downstream service has a blow-open contact assembly, as does a molded case circuit breaker or similar device.**

The reason: The up-over-down method ignores dynamic impedance (the inherent current-limiting of the downstream molded case circuit breaker). Such impedance is developed directly by the forces of the let-through current created when the contacts are blown open.

For proper application of current-limiting fuses, always refer to recommendations by the manufacturer of the circuit breaker, which are based on actual test data.

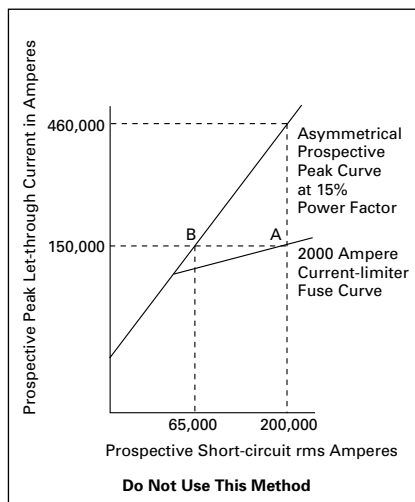

**Figure 22.9-6. Old Up-Over-Down Chart**

## Applying Series Ratings

The following is provided to use the series rating tables on the following pages.

- Step 1. Determine the available system voltage and fault current.
- Step 2. Select the appropriate table using the system voltage.
- Step 3. Use the appropriate "Series Equipment Rating" column equal to, or greater than, the available fault current, to determine the allowable combinations of main (upstream) and branch (downstream) overcurrent devices. Main devices are shown in bold/shaded areas. Respective branch breakers are shown directly below their associated main device. If a rating is not initially found in a column, first look to the columns to the right for higher "Series Equipment Ratings" within the same table. If still not found, use ratings from table of a higher system voltage (higher numbered tables).

### Example 1:

240 V, three-phase, three-wire, AC system with available fault current of 37,438 A. Main (upstream) device is a three-pole, 150 A, PDG2xG breaker. The branch (downstream) breakers are two- and three-pole, 20, 30 and 60 A, 240 V, BAB breakers.

1. Go to the 240 V table (**Table 22.9-15**).
2. Look down under the 42 kA column. This rating is not shown.
3. Look to the columns to the right. This rating is shown under the 65 kA column, and therefore is valid.

### Example 2:

480Y/277 V, three-phase, four-wire, AC system with available fault current of 62,097 A. Main (upstream) device is a three-pole, 250 A breaker. The branch (downstream) breakers are two- and three-pole, 60, 70 and 100 A FDB breakers.

1. Go to the 480Y/277 V table (**Table 22.9-18**).
2. Look down under the 65 kA column. This rating is not shown.
3. Look to the columns to the right. This rating is still not shown.
4. Look at the table with the next higher system voltage (480 V, **Table 22.9-19**).
5. This rating is shown under the 65 kA column, and therefore is valid.

### Example 3:

208Y/120 V, three-phase, four-wire, AC system with available fault current of 56,438 A. Main (upstream) device is a three-pole, 225 A, PDD2xG breaker. The branch (downstream) breakers are single-pole, 20 A BAB (120/240 V), and two- and three-pole, 70 A BAB (240 V).

1. Go to the 240 V table (**Table 22.9-15**).
2. Look under the 65 kA column. This rating is shown under the 65 kA column, and therefore is valid for the two- and three-pole (240 V) breakers.
3. Look at the 120/240 V table (**Table 22.9-14**) for the single-pole (120/240 V) rating.
4. Look under the 65 kA column. This rating is shown under the 65 kA column, and therefore is valid for the single-pole (120/240 V) breakers.

**Other Applications of Series Ratings**

Series ratings can also be applied under the following guidelines:

Any FULLY RATED breaker can be applied upstream, downstream, or in the middle of, any of the series ratings stated in the tables.

Any series rating stated in the tables may have additional branch breakers of the EXACT SAME TYPE further downstream in that rating.

COMBINING SERIES RATINGS is allowed under certain conditions. Main and branch series ratings may be combined if:

Breakers A, B and C are in series respectively from main to branch.  
 Breakers A and B series rate together, breakers A and C series rate at the same interrupting rating level (or higher), it is allowable to use A, B and C together at the A-B series rating.

It is improper to combine series ratings under the following condition:

Breakers A, B and C are in series respectively from main to branch. Breakers A and B series rate together, breakers B and C series rate at the same interrupting rating level (or higher), it is **NOT** allowable to use A, B and C together at the A-B or B-C series rating. However, combining multiple overcurrent devices as in this example, can be accomplished if all devices in the series combination have been tested together and listed in triple rating **Table 22.9-27**.

**Main devices shown centered at top in shaded area, respective branch devices shown directly below.**

**Table 22.9-14. 120/240 Vac—Breaker/Breaker Series Ratings**

Main devices are shown centered at top, in shaded area. Respective branch devices shown directly below.

Main Breaker Maximum Amperes	Series Equipment Rating—kA Symmetrical									
	18	22	42	65	100	200				
100	<b>PDG2xF</b> BAB HQP QBGF QBGFT QBCAF	<b>QBHW QPHW</b> BAB HQP QBGF QPGF QBAG QBHW QBGFT QPGFT		<b>GB, GHB</b> BAB HQP QBGF QPGF QBAG QBHW QPHW QBHW QPHW QBGFT QPGFT QBCAF		<b>FB-P</b> BAB HQP QBGF QPGF QBAG QBHW QPHW PDG2xF PDG2xG QBGFT QPGFT			<b>FCL</b> BA HQP QBGF QPGF QBAG QBHW QPHW GB, GHB GHQ PDG2xF PDG2xG PDG2xM QBGFT QPGFT QBCAF	
125				<b>BRX</b> BAB (15–70 A) BAB (90–100 A) HQP (15–70 A) HQP (90–100 A)		<b>EGH</b> GHQ, GHB				
150	BAB HQP QBGF QBAG QBGFT QBCAF			<b>PDG3xG*</b> BAB HQP QBHW QPHW		BAB HQP GHB PDG2xF PDG2xG (15–150 A) QBHW QPHW				
200						<b>LA-P</b> BAB HQP QBHW QPHW PDG2xF PDG2xG				

**Table 22.9-14. 120/240 Vac—Breaker/Breaker Series Ratings (Continued)**

Main devices are shown centered at top, in shaded area. Respective branch devices shown directly below.

Main Breaker Maximum Amperes	Series Equipment Rating—kA Symmetrical										
	18	22	42	65	100	200					
225		<b>PDD2xF</b> BAB HQP QBGF QPGF QBHGF QPHGF QBHW QPHW QBAG QBGFT QPGFT QBHGFT QPHGFT	BAB HQP QBGF QPGF QBHGF QPHGF QBHW QPHW QBAG QBGFT QPGFT QBHGFT QPHGFT QBCAF	<b>PDD2xG, PDG2xG</b> BAB HQP QBGF QPGF QBAG QBHW QBHGF QBGFT QPHGF QBCAF	<b>FDE</b> QBGF QPGF QBAG QBHGF QBGFT QPHGF QBCAF QPHGF	BAB HQP QBHW QPHW	<b>PDD2xM</b> BAB ① HQP ① QBGF QPGF QBAG QBGFT QPGFT QBCAF	BAB HQP QBGF QBAG QBHW QPHW QBHGF GB, GHB GHQ, GHQRSP PDG2xF, EGS PGD2xG QBGFT QPGFT QBCAF	<b>PDG2xP</b> BAB HQP QBHW QPHW  BAB HQP QBGF QBAG QBHW QPHW QBHGF GHB, PDG2xF PDG2xG (15–150 A) QBGFT EGS PDG3xG* (15–150 A) QBCAF QBHGFT QPGF QPGFT QPHGF QPHGFT	<b>PDG2xP</b> GB, GHB GHQ PDG2xF PDG2xG PDG2xM EGS EGH	
250				<b>JD</b> BAB (15–70 A) HQP (15–70 A) QBHW QPHW PDG2xF	BAB HQP QBHW QPHW	QBGF QPGF QBAG QBHGF QPGFT QBCAF	GB, GHB PDG2xF PDG2xG EGS	BAB HQP QBHW QPHW		GB, GHB PDG2xF PDG2xG PDG2xM EGS EGH	
400		<b>PDD3xGy</b> BAB HQP QBGF QPGF QBAG QBGFT QPGFT	<b>PDG3xG*</b> <b>PDF3xG</b> BAB (15–70 A) HQP (15–70 A) QBHW QPHW	<b>PDG3xM*</b> <b>PDF3xM</b> BAB (15–70 A) HQP (15–70 A) QBHW QPHW	<b>PDD3xGy</b> <b>PDF3xG</b> PDG2xF	<b>KDPDG3xP</b> BAB (15–70 A) HQP (15–70 A)	<b>PDG3xM*</b> <b>PDF3xM</b> GB, GHB PDG2xF PDG2xG EGS ②	<b>PDG3xP*</b> QBHW QPHW		<b>PDG3xP</b> GB, GHB PDG2xF PDG2xG PDG2xM EGS EGH	<b>LCL</b> BAB HQP QBGF QPGF QBAF QBAG QBHW QPHW GB, GHB PDG2xF PDG2xG PDG2xM QBGFT QPGFT QBCAF
600							<b>PDG2xF</b>				
800							<b>PDG4xM</b> PDG2xF				
1200							<b>PDG5xM</b> <b>PDG5xM-C</b> PDG2xF PDD2xF PDD2xG				

① Single-pole version is restricted to 15–70 A.

② Not valid with PDF3xM.

**Series Rated Combinations**

**Table 22.9-15. 240 Vac—Breaker/Breaker—Series Ratings**

For single- and two-pole 120/240V rated breakers (BA, BAB, HQP, QBHW, QPHW), see **Table 22.9-14**.

Main devices are shown centered at top, in shaded area. Respective branch devices shown directly below.

Main Breaker Maximum Amperes	Series Equipment Rating—kA Symmetrical								
	18	22	42	65	100	100	100	100	200
100	<b>PDG2xF</b> BAB_H HQP_H	<b>QBHW_H</b> <b>QPHW_H</b> BAB_H HQP_H		<b>GB, GHB</b> BAB_H HQP_H QBHW_H QPHW_H		<b>FB-P</b> BAB_H HQP_H PDG2xF PDG2xG			<b>FCL</b> BAB_H HQP_H QBHW_H QPHW_H GB, GHB PDG2xF PDG2xG PDG3xG* PDG2xM*
125						<b>EGH</b> GHB			
150	<b>FDB</b> BAB_H HQP_H								
200						<b>LA-P</b> BAB_H HQP_H QBHW_H QPHW_H PDG2xF PDG2xG JDB			
225		<b>PDD2xF</b> HQP_H BAB_H QBHW QPHW	HQP_H BAB_H QBHW QPHW <b>CHH</b> BAB_H	<b>PDD2xG</b> BAB_H HQP_H QBHW_H	<b>PDG2xG, PDG3xG*</b> BAB_H HQP_H QBHW_H QPHW_H PDG2xF <sup>①</sup>	<b>PDD2xM, EDC</b> BAB_H HQP_H	<b>PDG2xM</b> BAB_H HQP_H QBHW_H QPHW_H GB, GHB PDG2xF PDG2xG PDG3xG*	<b>PDG2xP</b> BAB_H HQP_H QBHW_H QPHW_H	<b>PDG2xP</b> GB, GHB PDG2xF PDG2xG PDG3xG* PDG2xM
250				<b>JDB</b> BAB_H (15–70A) HQP_H (15–70 A) QBHW_H QPHW_H PDG2xF	BAB_H (15–70 A) HQP_H (15–70 A) QBHW_H QPHW_H	GB, GHB PDG2xF PDG2xG PDD2xG JDB EGS	BAB_H HQP_H QBHW_H QPHW_H		GB, GHB PDG2xF PDG2xG PDG3xG* PDG2xM, PDD2xF PDD2xG PDD2xM JDB EGS, EGH

① Valid on two- and three-pole breaker only. Not valid for single-pole.

**Table 22.9-16. 240 Vac—Breaker/Breaker—Series Ratings**

For single- and two-pole 120/240 V rated breakers (BA, BAB, HQP, QBHW, QPHW), see **Table 22.9-14**. Main devices are shown centered at top, in shaded area. Respective branch devices shown directly below.

Main Breaker Maximum Amperes	Series Equipment Rating—kA Symmetrical				
	65	100		200	
400	<b>PDD3xGy, PDG3xG* PDF3xG</b> BAB_H HQP_H QBHW_H QPHW_H PDG2xF	<b>PDG3xM*, PDF3xM</b> QBHW_H ① QPHW_H ① GB, GHB PDG2xF PDG3xG*, PDG2xG PDD2xF, PDD2xG JDB PDD3xGy, PDG3xG* EGS ②	<b>PDG3xP*</b> QBHW_H QPHW_H	<b>PDG3xP</b> GB, GHB PDG2xF PDG2xG, PDG3xG* PDG2xM, PDD2xF PDD2xG, PDD2xM JDB PDG3xG* PDD3xGy PDG3xM*	<b>LCL</b> BAB_H HQP_H QBHW_H QPHW_H GB, GHB PDG2xF PDG2xG, PDG2xM PDD2xF, PDD2xG PDG3xG* PDD2xM, JDB PDD3xGy, PDG3xG* PDG3xM
500		<b>NB-P</b> JDB PDG3xG*, PDD3xGy PDF3xG			
600		<b>HLDB</b> GB ①, GHB ① PDG2xG, PDD2xF PDD2xG, PDG2xF JDB PDG3xG*, PDD3xGy, PDF3xG, LDB		<b>PDD2xF, PDD2xG PDD2xM</b>	
800		<b>NB-P</b> PDG3xG*, PDD3xGy	<b>PDG4xM</b> PDG2xF PDG2xG		
1200		<b>PDG5xM</b> PDD2xF, PDD2xG PDG2xF			<b>PDG5xP</b> PDD2xF, PDD2xG PDD2xM
2500		<b>PDD2xF, PDD2xG</b>			<b>PDD2xF, PDD2xG PDD2xM</b>

① Valid on two- and three-pole breakers only. Not valid for single-pole.

② Not valid with PDF3xM.

Main devices shown in shaded area, respective branch devices shown directly below.

**Table 22.9-17. 277 Vac—Breaker/Breaker Series Ratings**

Main devices are shown centered at top, in shaded area. Respective branch devices shown directly below.  
All ratings in this table apply to single-pole branch breakers only. For two- and three-pole branch breakers, see other tables.

Main Breaker Maximum Amperes	Series Equipment Rating—kA Symmetrical					
	22	25	35	65	100	150
100						<b>FCL</b> GHB GHQ, GHQRSP PDG2xF PDG2xG PDG2xM
125			<b>EGS</b> GHQ, GHB	<b>EGH</b> GHQ, GHB		
225			<b>PDG2xG, PDG3xG*</b> GHB GHQ GHQRSP ① GHBGFEP ①	<b>PDG2xM</b> GHB GHQRSP ② GHBGFEP ② GHQ PDG2xF PDG2xG	<b>PDG2xP</b> GHB PDG2xF PDG2xG PDG2xM	
250	<b>JD, JDB</b> GHB		<b>JD, JDB</b> GHB (15–50 A) GHBGFEP ③	<b>HJD</b> GHB (15–50 A) PDG2xF PDG2xG GHBGFEP	<b>LCL</b> PDG2xP	<b>JDC</b> GHB PDG2xF PDG2xG PDG2xM
400	<b>PDG3xG*</b> <b>PDF3xG</b> GHB	<b>PDG3xM*</b> <b>PDF3xM</b> GHB	<b>PDG3xG*</b> <b>PDF3xG</b> GHB PDG2xF PDG2xG GHQ ④	<b>PDG3xM*, PDF3xM</b> GHB PDG2xF PDG2xG GHQ ⑤	<b>PDG3xP*</b> GHB PDG2xF PDG2xG PDG2xM	<b>LCL</b> GHB PDG2xF PDG2xG PDG2xM

① Not valid with PDG3xG\*.

② Not valid with HFDE.

③ Not valid with JDB.

④ Not valid with PDF3xG.

⑤ Not valid with PDF3xM.

**Table 22.9-18. 480Y/277 Vac—Breaker/Breaker Series Ratings**

Main devices are shown centered at top, in shaded area. Respective branch devices shown directly below.  
All ratings in this table apply to two- and three-pole branch breakers only. For single-pole branch breakers, see **Table 22.9-17**.

Main Breaker Maximum Amperes	Series Equipment Rating—kA Symmetrical					
	22	25	35	65	100	150
100						<b>FCL</b> GHB, GHQRSP
125			<b>EGS</b> GHB	<b>EGH</b> GHB		
225			<b>PDG2xG, PDG3xG*</b> GHB, GHQRSP ⑥	<b>PDG2xM</b> GHB, GHQRSP ⑦	<b>PDG2xP</b> GHB	
250	<b>JDB</b> GHB		<b>JDB</b> GHB (15–50 A)	GHB (15–50 A)	GHB	
400	<b>PDG3xG*</b> <b>PDF3xG</b> GHB	<b>PDG3xM*, PDF3xM</b> GHB	<b>PDG3xG*</b> <b>PDF3xG</b> GHB (15–50 A)	<b>PDG3xM*, PDF3xM</b> GHB (15–50 A)	<b>PDG3xP*</b> GHB (15–50 A)	<b>LCL</b> GHB

⑥ Not valid with PDG3xG\*.

⑦ Not valid with HFDE.

Main devices shown in shaded area, respective branch devices shown directly below.

**Table 22.9-19. 480 Vac—Breaker/Breaker Series Ratings**

Main devices are shown centered at top, in shaded area. Respective branch devices shown directly below.  
 All ratings in this table apply to two- and three-pole branch breakers only. Not valid for single-pole branch breakers.

Main Breaker Maximum Amperes	Series Equipment Rating – kA Symmetrical				
	25	35	65	100	150
100				<b>FB-P</b> PDG2xF PDG2xG PDG2xM	<b>FCL</b> PDG2xF PDG2xG, PDG3xG* PDG2xM
200				<b>LA-P</b> PDG2xF PDG2xG PDG2xM JDB	
225		<b>PDG2xG, PDG3xM,</b> PDG2xF	<b>PDG2xM*</b> PDG2xF PDG2xG, PDG3xG EGS ①	<b>PDG2xP</b> PDG2xF, EGS, EGH PDG2xG, PDG3xG* PDG2xM	
250	<b>JDB</b> PDG2xF		PDG2xF PDG2xG PDG3xG* JDB EGS	PDG2xF, EGS, EGH PDG2xG, PDG3xG* PDG2xM JDB	<b>LCL</b> PDG3xG*
400		<b>PDG3xG*</b> PDG2xF	<b>PDG3xM*</b> PDG2xF PDG2xG, PDG3xG* JDB PDG3xG* EGS	<b>PDG3xP*</b> PDG2xF, EGS, EGH PDG2xG, PDG3xG* PDG2xM JDB PDG3xG* PDG3xM*	<b>LA-P</b> JDB PDG3xG* PDG3xM*
500				<b>NB-P</b> JDB PDG3xG* PDG3xM*	
600		<b>LDB</b> <b>CLD</b> JDB	<b>HLDB</b> PDG2xG, PDG3xG* JDB PDG3xG* LDB		

① Not valid with HFDE.

**Table 22.9-20. 600 Vac—Breaker/Breaker Series Ratings**

Main fuse class shown centered at top, in shaded area. Respective branch devices shown directly below.  
 All ratings in this table apply to two- and three-pole branch breakers only. Not valid for single-pole branch breakers.

Main Breaker Maximum Amperes	Series Equipment Rating – kA Symmetrical					
	18	25	35	42	50	100
225	<b>PDG2xG</b>	<b>PDG2xM</b> PDG2xG	<b>PDG2xP</b> PDG2xG, PDG3xG* PDG2xM			
250	<b>JDB</b>	PDG2xG JDB	PDG2xG PDG2xM JDB			<b>LCL</b> PDG3xG*
400		<b>PDG3xG*</b> <b>PDF3xG</b> PDG2xG JDB	<b>PDG3xM*, PDF3xM</b> PDG2xG, PDG3xG* PDG2xM JDB	<b>PDG3xP*</b> PDG2xG, PDG3xG* PDG2xM	<b>PDG3xP*</b> JDB PDG3xG* PDG3xM*	<b>LCL</b> PDG2xG, PDG3xG* PDG2xM PDG2xP JDB PDG3xG* PDG3xM* PDG3xP*
600		<b>LDB</b> <b>CLD</b> PDG2xG JDB	<b>HLDB</b> PDG3xG* LDB			

**Table 22.9-21. 120/240 Vac—Fuse/Breaker Series Ratings**

Main fuse class shown centered at top, in shaded area. Respective branch devices shown directly below.

Main Fuse Maximum Amperes	Series Equipment Rating – kA Symmetrical					
	100			200		
100						<b>R</b> BAB HQP QBHW QPHW GB GHB
200			<b>R</b> GB GHB	<b>J</b> BAB HQP QBHW QPHW	<b>T</b> BAB HQP QBHW QPHW	
400	<b>J</b> BAB HQP QBHW QPHW	<b>T</b> BAB HQP QBHW QPHW		<b>J</b> GB GHB	<b>T</b> GB GHB	



Main devices shown in shaded area, respective branch devices shown directly below.

**Table 22.9-22. 240 Vac—Fuse/Breaker Series Ratings**

For single- and two-pole 120/240 V rated breakers (BA, BAB, HQP, QBHW, QPHW), see **Table 22.9-14**.

Main fuse class shown centered at top, in shaded area. Respective branch devices shown directly below.

Main Fuse Maximum Amperes	Series Equipment Rating – kA Symmetrical					
	100				200	
100						<b>R</b> BAB_H HQP_H QBHW_H QPHW_H GB GHB
200			<b>R</b> GB GHB	<b>J</b> BAB_H HQP_H QBHW_H QPHW_H	<b>T</b> BAB_H HQP_H QBHW_H QPHW_H	<b>R</b> GB ① GHB ①
400	<b>J</b> BAB_H HQP_H QBHW_H QPHW_H	<b>T</b> BAB_H HQP_H QBHW_H QPHW_H		<b>J</b> GB GHB	<b>T</b> GB GHB	
600			<b>L</b> PDG2xF PDG2xG, PDG3xG* PDD2xG JDB PDD3xGy, PDG3xG*			

① Valid on two- and three-pole breakers only. See **Table 22.9-21 on Page 22.1-24** for single-pole.

**Table 22.9-23. 277 Vac Fuse/Breaker Series Ratings**

Main fuse class are shown centered at top, in shaded area. Respective branch devices shown directly below. All ratings in this table apply to single-pole branch breakers only. For two- and three-pole branch breakers, consult other tables.

Main Fuse Maximum Amperes	Series Equipment Rating – kA Symmetrical					
	65		100		200	
100			<b>J</b> GHQ GHQRSP	<b>T</b> GHQ GHQRSP		<b>R</b> GHB
200	<b>J</b> GHQ GHQRSP	<b>T</b> GHQ GHQRSP	<b>J</b> PDG2xF PDG2xG PDG2xM	<b>T</b> PDG2xF PDG2xG PDG2xM	<b>R</b> GHB	
400						<b>J</b> GHB
						<b>T</b> GHB

**Table 22.9-24. 480Y/277 Vac—Fuse/Breaker Series Ratings**

Main fuse class shown centered at top, in shaded area. Respective branch devices shown directly below. All ratings in this table apply to two- and three-pole branch breakers only. For single-pole branch breakers, see **Table 22.9-23**.

Main Fuse Maximum Amperes	Series Equipment Rating — kA Symmetrical					
	65		100		200	
100						R GHB
200				R GHB		
400					J GHB	T GHB
600			J PDG2xF PDG2xG PDG2xM PDG2xP	T GHB PDG2xF PDG3xG* PDG2xG PDG3xG* PDG2xM PDG2xP		

**Table 22.9-25. 480 Vac—Fuse/Breaker Series Ratings**

Main fuse class shown centered at top, in shaded area. Respective branch devices shown directly below. All ratings in this table apply to two- and three-pole branch breakers only. Not valid for single-pole branch breakers.

Main Fuse Maximum Amperes	Series Equipment Rating — kA Symmetrical					
	100			200		
100				R PDG2xF		
200	J PDG2xF PDG2xG PDG2xM PDG2xP	T PDG2xF PDG2xG PDG2xM PDG2xP				

**Table 22.9-26. 600 Vac—Fuse/Breaker Series Ratings**

Main fuse class shown centered at top, in shaded area. Respective branch devices shown directly below. All ratings in this table apply to two- and three-pole branch breakers only. Not valid for single-pole branch breakers.

Main Fuse Maximum Amperes	Series Equipment Rating — kA Symmetrical					
	100			200		
100				R PDG2xG PDG3xG* PDG2xM PDG2xP		
200	J PDG2xG PDG3xG* PDG2xM PDG2xP	T PDG2xM PDG2xP		R PDG3xG* PDG2xM		
400	J	T		R PDG3xG* PDG3xM* PDG3xP*		
600				J PDG3xG PDG3xM PDG3xP	T PDG3xG* PDG3xM* PDG3xP*	

**Table 22.9-27. Triple Series Ratings**

Main Fuse Class and Maximum Amperes	Tenant Main Type	Branch Type	System Voltage	Short-Circuit Series Rating (kA, Sym.)
L-6000	PDD3xGy, PDG3xGBGB	K, GDHB, PDG2xF <sup>Ⓞ</sup>	240	100
L-6000	PDD3xGy, PDG3xGGB	K, GDHBB	120/240	100
L-6000	PDD3xGy, PDG3xPG	FD <sup>Ⓞ</sup> , FDB	240	100
L-6000	PDD3xGy, PDG3xG*		240	100
L-6000	JDB	GB, GHB	240	100
L-6000	JDB	GB, GHB	120/240	100
L-6000	PDG2xG	GB, GHB	240	100
L-6000	PDG2xG	GB, GHB	120/240	100
L-6000	PDG2xG	BAB_H, HQP_H, QBHW_H, QPHW_H	240	100
L-6000	PDG2xG	BA, BAB, HQP (15–70 A)	120/240	100
L-6000	PDG2xF	BAB_H, HQP_H	240	100
L-6000	PDG2xF	BA, BAB, HQP	120/240	100

<sup>Ⓞ</sup> Valid on two- and three-pole breakers only. Not valid for single-pole.

## Panelboard Selection Guide

Table 22.9-28. Product Types

Type PRL1X	Fusible Lighting Panelboard PRL1XF	Type PRL1X-LX Column Type	Type PRL2X	Fusible Lighting Panelboard PRL2XF	Type PRL2X-LX Column Type
Bolt-on or plug-on circuit breakers 240Vac maximum	240Vac maximum	Bolt-on circuit breakers 240 Vac maximum	Bolt-on or plug-on circuit breakers 240 or 480Y/277 Vac 125/250Vdc maximum	240 and 480Y/277 Vac maximum	Bolt-on or plug-on circuit breakers 240 or 480Y/277 Vac 125/250 Vdc maximum
Main lugs only 600 A maximum	Main lugs only 400 A maximum	Main lugs only 225 A maximum	Main lugs only 600 A maximum	Main lugs only 400 A maximum	Main lugs only 225 A maximum
Main circuit breaker 600 A maximum		Main circuit breaker 225 A maximum	Main circuit breaker 600 A maximum		Main circuit breaker 225 A maximum
Branch circuit breakers 100 A maximum Single, two- and three-pole	Branch overcurrent protective devices 30 A maximum, Single-, two- and three-pole utilizing Class CC fuses	Branch circuit breakers 100 A maximum Single-, two- and three-pole	Branch circuit breakers 100 A maximum Single-, two- and three-pole	Branch overcurrent protective devices 30 A maximum, Single-, two- and three-pole utilizing Class CC fuses	Branch circuit breakers 100 A maximum Single-, two-, and three-pole

Table 22.9-28. Product Types (Continued)

Retrofit Panelboard PRL-1RX and PRL-2RX	Type PRL3X	Type PRL3E	Type PRL4X
Bolt-on or plug-on circuit breakers 240 or 480Y/277 Vac	Bolt-on circuit breakers 240, 480 or 600 Vac; 250 Vdc maximum	Bolt-on circuit breakers 240 Vac maximum	Circuit breakers or fusible switches; 240, 480 or 600 Vac; 600Vdc maximum
Main lugs only 225 A maximum	Main lugs only 800 A maximum	Main lugs only 600 A maximum	Main lugs only 1200 A maximum
Main circuit breaker 225 A maximum	Main circuit breaker 600 A maximum	Main circuit breaker 600 A maximum	Main circuit breaker 1200 A maximum
Branch circuit breakers 100 A maximum Single-, two- and three-pole	Branch circuit breakers 225 A maximum Single-, two- and three-pole	Branch circuit breakers 125 A maximum Single-, two- and three-pole	Branch circuit breakers 1200 A maximum, Single-, two- and three-pole

Table 22.9-28. Product Types (Continued)

Pow-R-Command	Multipoint Metering Distribution Panelboard	Elevator Control Panelboard
Bolt-on or plug-on circuit breakers 240 or 480Y/277 Vac	Bolt-on circuit breakers 600 Vac or 600 Vdc maximum	Bolt-on fusible switches 600 Vac maximum
Main lugs only 400 A maximum	Type PRL4X panelboard specially formatted to provide a compact and flexible multipoint metering solution for 250–1200 A applications	Controls for up to four elevators in a single panelboard
Main circuit breaker 400 A maximum		Main lugs only 800 A maximum
Branch circuit breakers 225 A maximum Single-, two- and three-pole		Branch overcurrent devices 15–200 A fusible switches with Class J fuse clips maximum
Single- and two-pole remote operated circuit breakers		
Integral load switching and dimming controls		Designed to meet specific sections various codes impacting elevators

Table 22.9-29. Panelboard Selection Guide

Panelboard Type	Page Reference	Device Type	Maximum Voltage Rating		Maximum Main Rating, Amperes		Branch Circuits Ampere Range	Short-Circuit Current Ratings rms Symmetrical Amperes, AC	
			AC	DC	Main Lugs Only	Main Device		Fully Rated (kA)	Series Rated (kA)
Pow-R-Line 1X ①	22.1-1	Breaker	240	—	600	600	15–100	10–22	22–200
Pow-R-Line 2X ①	22.2-1	Breaker	240 480Y/277	250	600 400 ②	600 400 ②	15–100 15–100	65 14	65–200 22–150
Pow-R-Line 3X ①	22.3-1	Breaker	240 480 600	250	800 800 800	600 600 600	15–225 15–225 15–225	10–200 14–100 14–35	22–200 22–150 —
Pow-R-Line 3E ①	22.3-5	Breaker	480	250	600	600	15–125	35–65	35–100
Pow-R-Line 4X ①	22.4-1	Breaker	240 480 600	600	1200 1200 1200	1200 1200 1200	15–1200 15–1200 15–1200	10–200 14–200 14–200	22–200 22–150 —
Pow-R-Line 4F ①	22.4-8	Fusible switch	240 600	250	1200 1200	1200 1200	30–1200 30–1200	100–200 100–200	— —
Pow-R-Line 4DX	22.4-11	Breaker	240 480	— —	1200 1200	1200 1200	20–600 Drawout 15–1200 Fixed	100 65	— —
Pow-R-Line 1XF	22.6-5	Fusible switch	240	—	400	400	15–30	200	200
Pow-R-Line 2XF	22.6-7	Fusible switch	480Y/277	—	400	400	15–30	200	200
Pow-R-Line 1X-LX	22.5-1	Breaker	240	—	225	225	15–30	10–22	18–200
Pow-R-Line 2X-LX	22.5-4	Breaker	480Y/277	125/250	225	225	15–30	14	25–150
Pow-R-Line 1RX	22.6-1	Breaker	240	—	225	225	15–100	10–22	22–100
Pow-R-Line 2RX	22.6-3	Breaker	480Y/277	—	225	225	15–100	14	22–150
Elevator control panelboard ①	22.6-11	Fusible	480	—	800	800	15–200	10–200	14–100

① Available with surge protective device (SPD) and metering.

② Amperage rating for DC voltage.

**Eaton**  
1000 Eaton Boulevard  
Cleveland, OH 44122  
United States  
Eaton.com

© 2020 Eaton  
All Rights Reserved  
Printed in USA  
Publication No. DG014009EN / Z23483  
February 2020



Eaton is a registered trademark.

All other trademarks are property of their respective owners.