





Power
Defense™

Circuit Breaker
Accessory

For PDG1
Frame

PDG1 Screw Terminal / End Cap Kit, 125 amps, 1 poles
Cat. No. PDG1X1TS125
Style No. 66A1592G35
Quantity - 1

Package Content:
1 - End cap
1 - Terminal Screw
1 - Lock Washer
1 - Flat Washer
1 - Nut

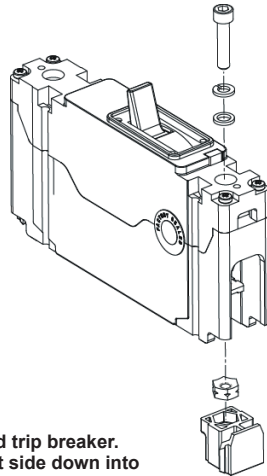

Installation:

1. Disconnect voltage and trip breaker.
2. To install, place nut flat side down into End Cap, as shown and slide onto breaker base.
3. Mount breaker to panel.
4. Place wire terminations on top of breaker terminals.
5. Insert Terminal Screw through Washers, in order shown, and torque to 34-38 In-Lbs (4.0-4.4 N-m).

IL012161EN H01




Power
Defense™

Circuit Breaker
Accessory

For PDG1
Frame

PDG1 Screw Terminal / End Cap Kit, 125 amps, 1 poles
Cat. No. PDG1X1TS125
Style No. 66A1592G35
Quantity - 1

Package Content:
1 - End cap
1 - Terminal Screw
1 - Lock Washer
1 - Flat Washer
1 - Nut

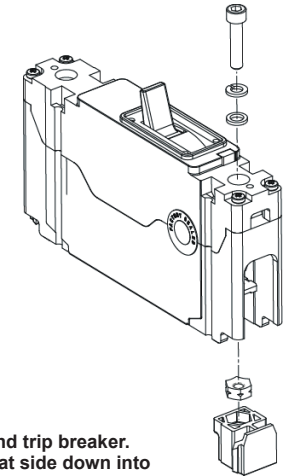

Installation:

1. Disconnect voltage and trip breaker.
2. To install, place nut flat side down into End Cap, as shown and slide onto breaker base.
3. Mount breaker to panel.
4. Place wire terminations on top of breaker terminals.
5. Insert Terminal Screw through Washers, in order shown, and torque to 34-38 In-Lbs (4.0-4.4 N-m).

IL012161EN H01





Power
Defense™

Circuit Breaker
Accessory

For PDG1
Frame

PDG1 Screw Terminal / End Cap Kit, 125 amps, 1 poles
Cat. No. PDG1X1TS125
Style No. 66A1592G35
Quantity - 1

Package Content:
1 - End cap
1 - Terminal Screw
1 - Lock Washer
1 - Flat Washer
1 - Nut

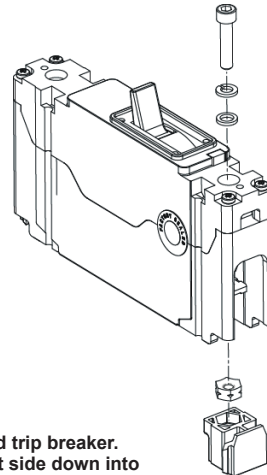

Installation:

1. Disconnect voltage and trip breaker.
2. To install, place nut flat side down into End Cap, as shown and slide onto breaker base.
3. Mount breaker to panel.
4. Place wire terminations on top of breaker terminals.
5. Insert Terminal Screw through Washers, in order shown, and torque to 34-38 In-Lbs (4.0-4.4 N-m).

IL012161EN H01




Power
Defense™

Circuit Breaker
Accessory

For PDG1
Frame

PDG1 Screw Terminal / End Cap Kit, 125 amps, 1 poles
Cat. No. PDG1X1TS125
Style No. 66A1592G35
Quantity - 1

Package Content:
1 - End cap
1 - Terminal Screw
1 - Lock Washer
1 - Flat Washer
1 - Nut

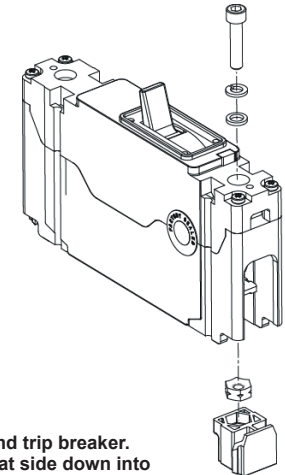

Installation:

1. Disconnect voltage and trip breaker.
2. To install, place nut flat side down into End Cap, as shown and slide onto breaker base.
3. Mount breaker to panel.
4. Place wire terminations on top of breaker terminals.
5. Insert Terminal Screw through Washers, in order shown, and torque to 34-38 In-Lbs (4.0-4.4 N-m).

IL012161EN H01