

INSTALLATION INSTRUCTIONS FOR G FRAME BREAKER TERMINAL SHIELD GTSK3




WARNING

DO NOT ATTEMPT TO INSTALL OR PERFORM MAINTENANCE ON EQUIPMENT WHILE IT IS ENERGIZED. SEVERE PERSONAL INJURY, DEATH, OR SUBSTANTIAL PROPERTY DAMAGE CAN RESULT FROM CONTACT WITH ENERGIZED EQUIPMENT. ALWAYS VERIFY THAT NO VOLTAGE IS PRESENT BEFORE PROCEEDING WITH THE TASK, AND ALWAYS FOLLOW GENERALLY ACCEPTED SAFETY PROCEDURES.

CUTLER-HAMMER IS NOT LIABLE FOR THE MISAPPLICATION OF MISINSTALLATION OF ITS PRODUCTS.

TO INSTALL:

- 1) Position terminal shield into load or line of breaker as shown. For installation on the line end of GD devices, the flapper shields must be moved to clear the terminal shield.
- 2) Insert lexan screw and tighten.

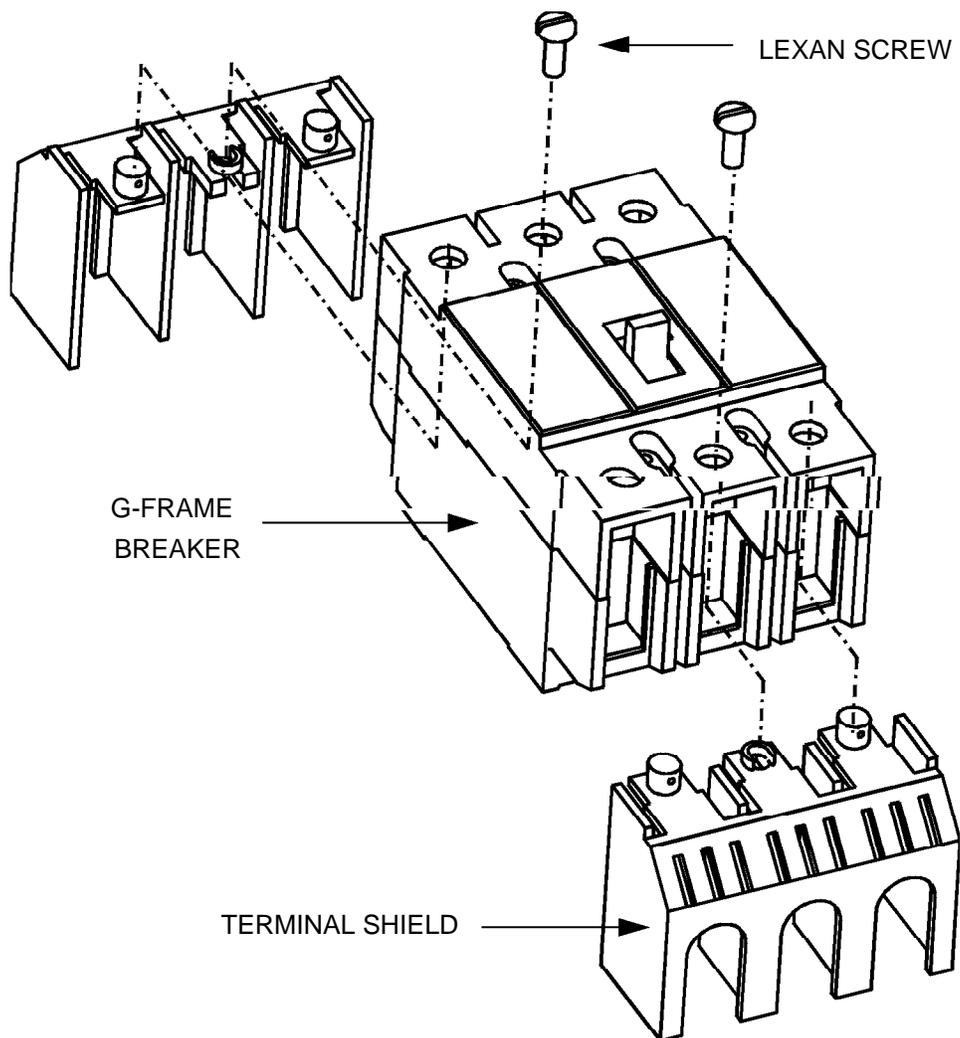

NOTES

Eaton Corporation
Eaton Electrical
1000 Cherrington Parkway
Moon Township, PA
USA
tel: 1-800-525-2000

©2001 Eaton Corporation
All Rights Reserved
Printed USA/TQC
Publication #8790C47H03
Effective October 2005

EAT•N | **Cutler-Hammer**