




SPECIAL SEISMIC CERTIFICATE OF COMPLIANCE

Product Line: Eaton 600V, 5kV, and 15kV Metal Enclosed Bus Duct

Qualified to UBC-1997, IBC-2021, CBC 2022 (OSP-0222-10), ASCE7-16, and IEEE693-2018

$S_{DS} = 2.0g$, $S_s = 3.0g$, Site Class D, $I_p = 1.5$, for $z/h = 1$ in accordance with ICC-ES AC156

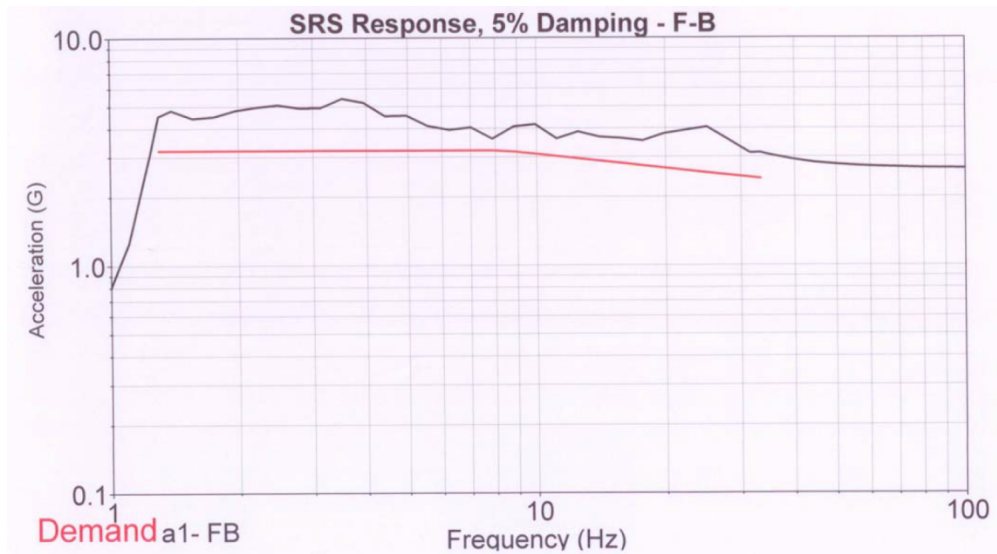

Qualified by Shake-Table Testing at Clark Laboratories, Inc. Jefferson Hills, PA, June 2011

(WEGAI Seismic Report No. 1245-01-R2)

(Clark Test Report No. 9738)

See HCAI OSP-0222 and WEGAI Report for a list of certified models and seismic installation requirements.

Certification:

This document certifies the above-mentioned metal enclosed bus duct manufactured by Eaton meets the requirements of UBC-1997/IBC-2021/CBC-2022/ASCE7-16 with an Importance Factor of 1.5 and the requirements of IEEE-693-2018 High Level.