



# Seismic qualified

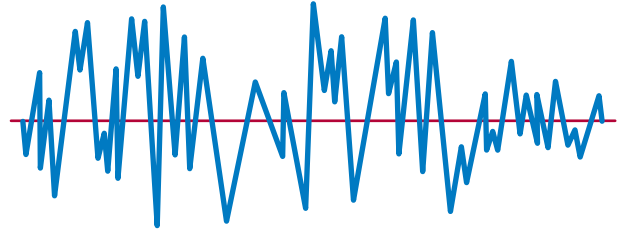

Eaton Corporation's equipment identified below was tested for seismic withstand capability and tested in accordance with the combined requirements specified in the International Building Code, the California Building Code, and the Uniform Building Code.

As required by the codes, the equipment demonstrated its ability to function after the seismic tests. The seismic capability of the equipment exceeds the worst-case required levels, as illustrated in the figure below.

## Metal-Enclosed Low Voltage Switchgear – Type DSII

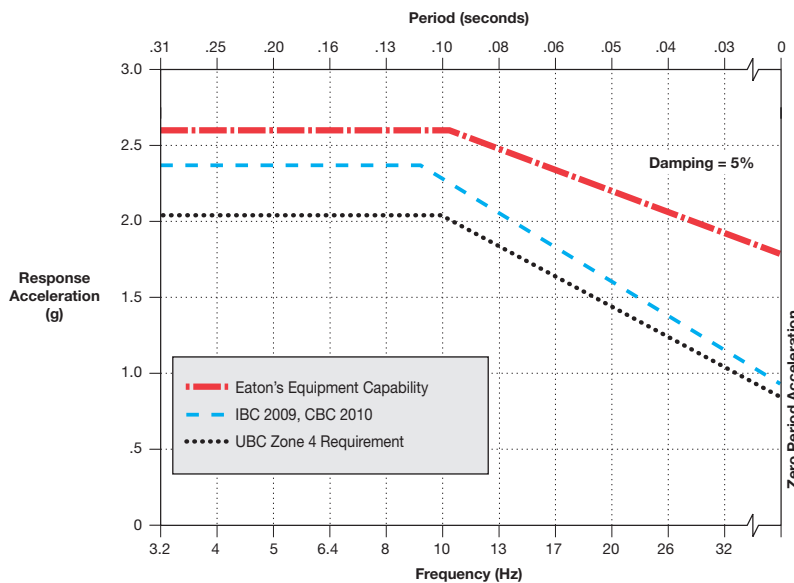

The frequency sweep tests revealed that the lowest equipment natural frequency is:

**5.9 Hz Indoor**  
**5.5 Hz Outdoor**

Drawing Number  
5676B26H01

Mostafa A. Ahmed  
Westinghouse Electric Company, LLC

*Mostafa A. Ahmed*

3RD PARTY TEST ENGINEER IN CHARGE

TESTED BY  
Wyle Laboratories  
December 1994 – 44377-1

For interpretation of testing data,  
refer to Eaton  
Publication SA12501SE