
 <p>COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT</p>		TIME-CURRENT CHARACTERISTIC CURVES	
		MINIMUM MELT 15.5KV X-LIMITER "E" RATED FUSE (BUSSMANN)	
DRAWN BY DG	CHK'D NRH	Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load	
DATE 11-8-06	DATE 11-16-06	Standards used as basis for data: ANSI C37.46-1981 (R1992)	
REPLACES /	REV 00	REQ NO. 23753	MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS
DWG NO. CT TCC205 B 00	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.		

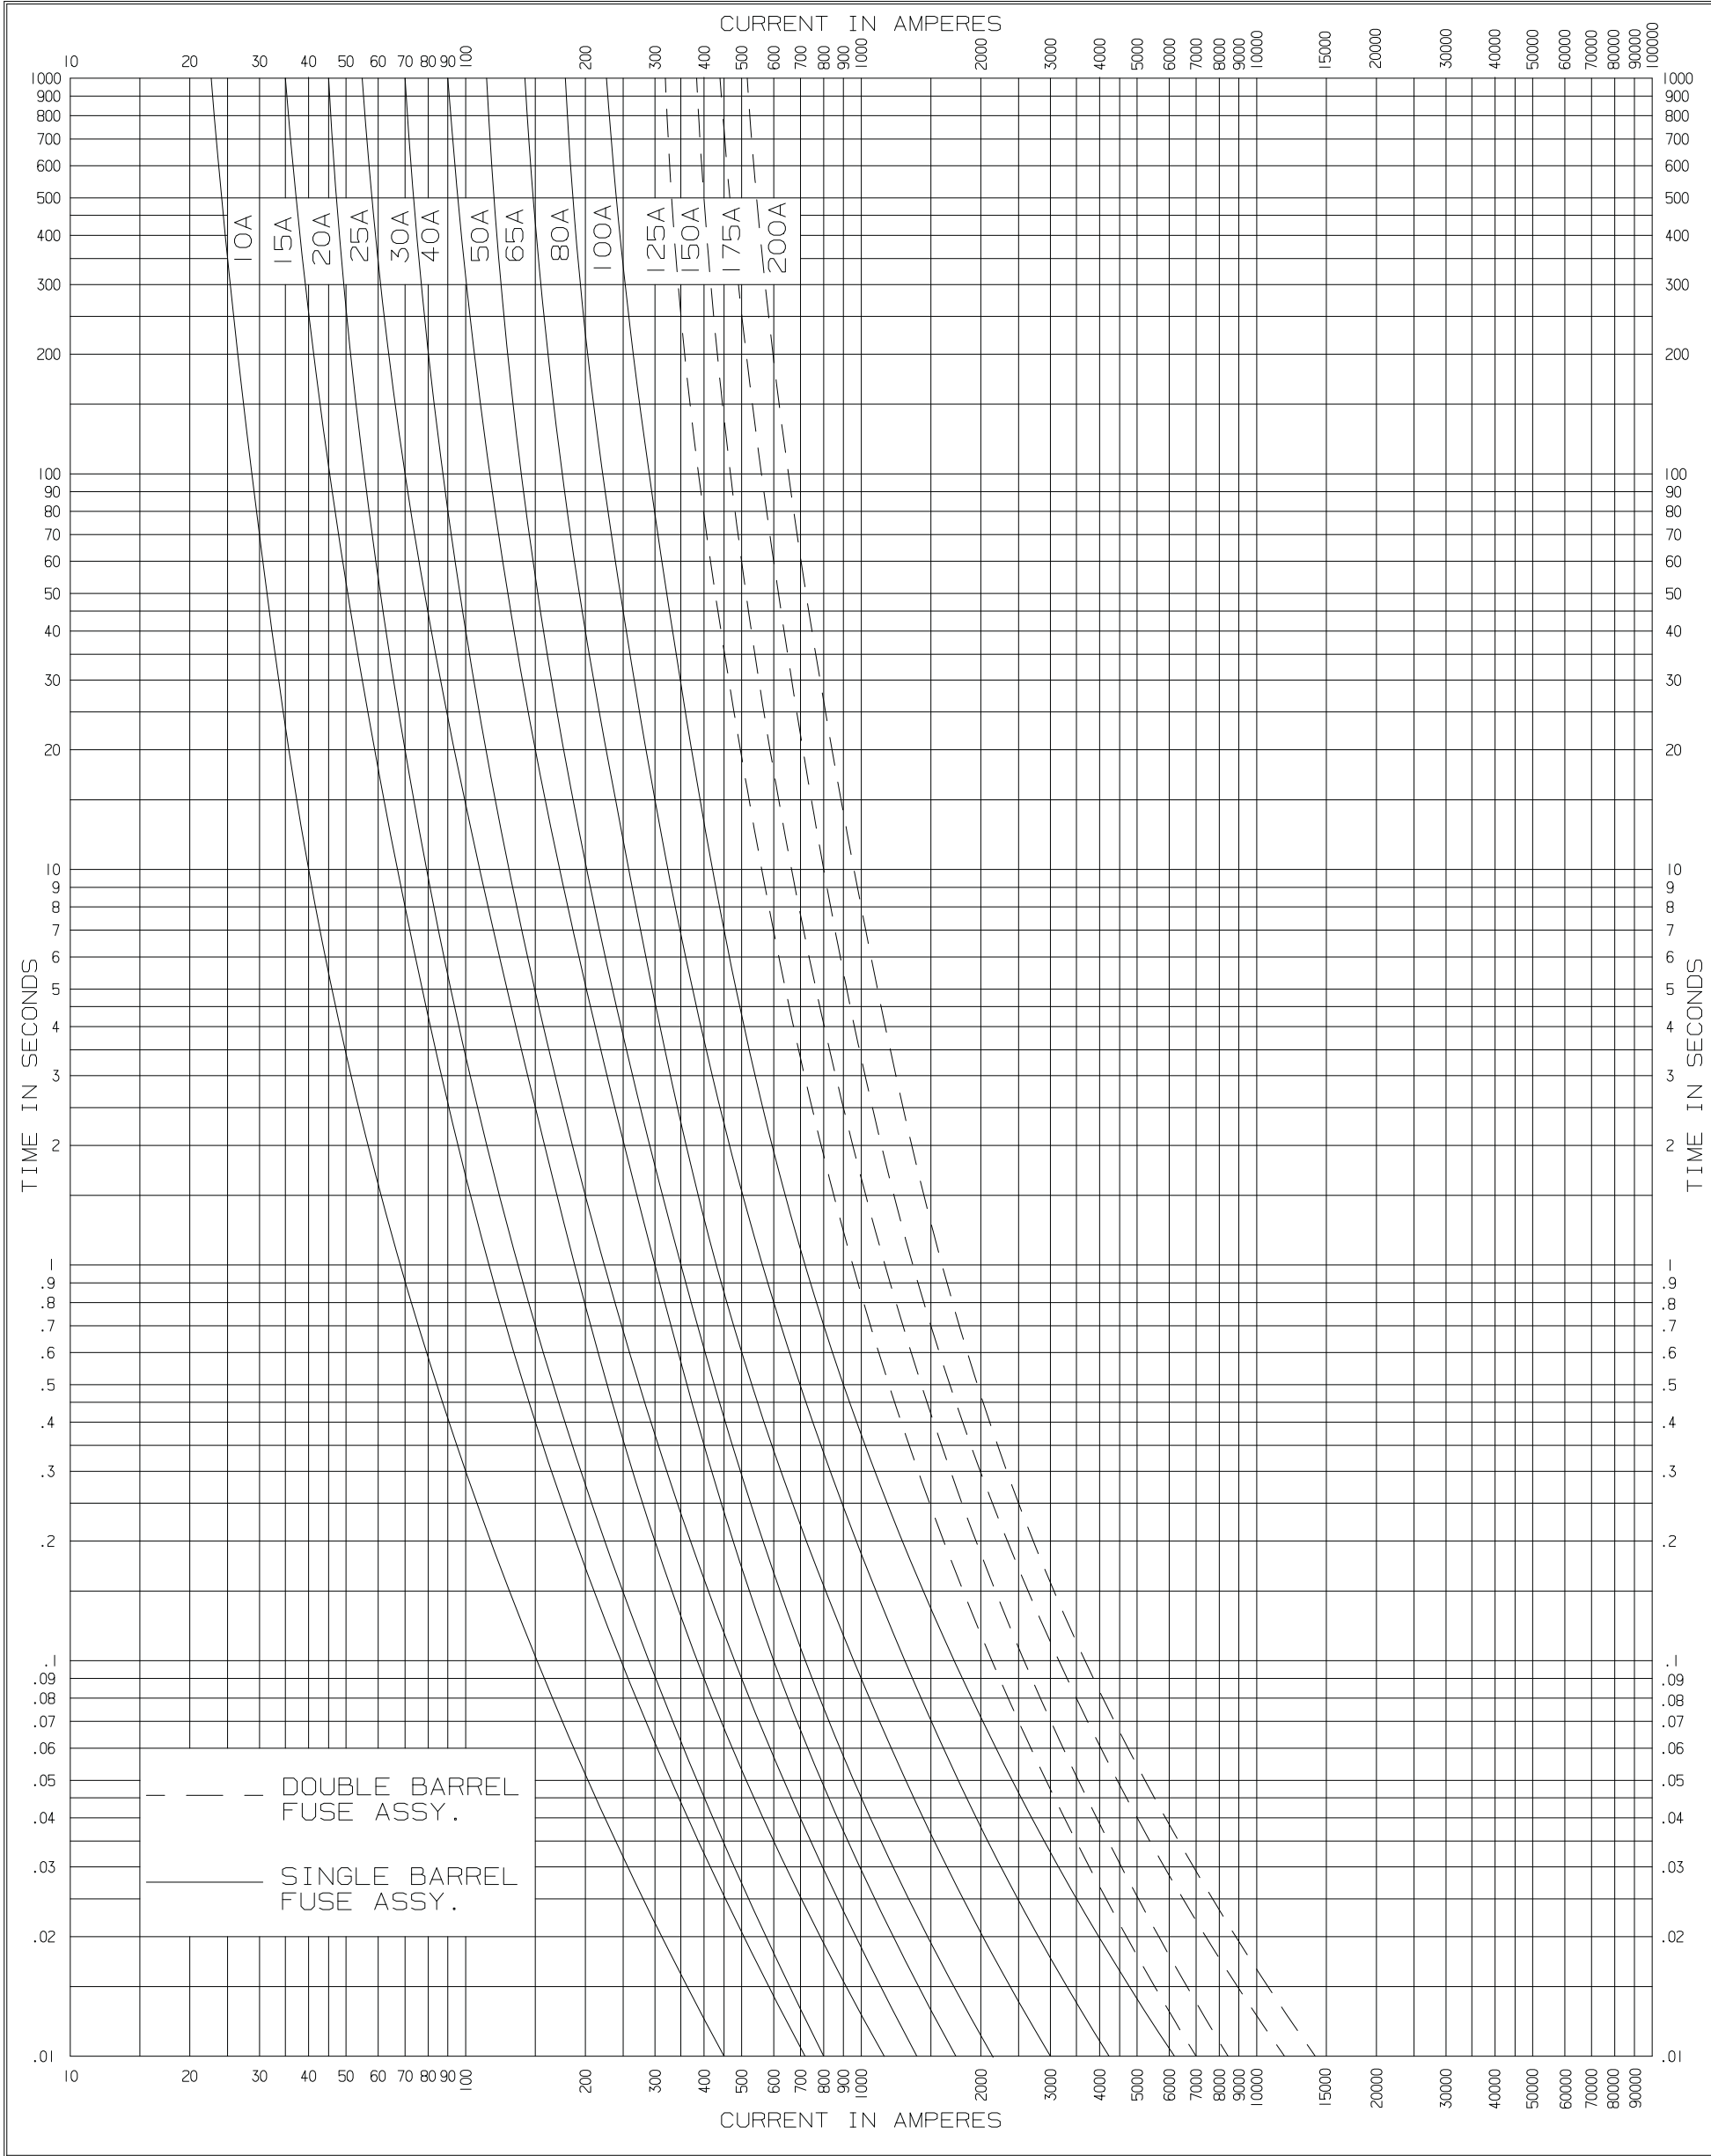

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR  
15.5KV X-LIMITER "E" RATED FUSE (BUSSMANN)

DRAWN BY	DG	CHK'D	NRH
DATE	11-8-06	DATE	11-16-06
REPLACES	/	REV	00
		REQ NO.	23753
DWG NO.	CT TCC205 B 00		

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.46-1981 (R1992)

MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.