

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT 15,5KV ELS  
FULL RANGE OIL IMMERSIBLE FUSE

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load  
Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS


THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY WJK: CMC/D  
DATE 6-03-99 DATE  
REPLACES 01/92/REV 01 REG NO. 18907  
DWG NO. 42 38286 B 00

80 AMP - 2 - 40 AMP FUSES IN PARALLEL

Reference Data  
R240-91-76  
Page 1 of 2

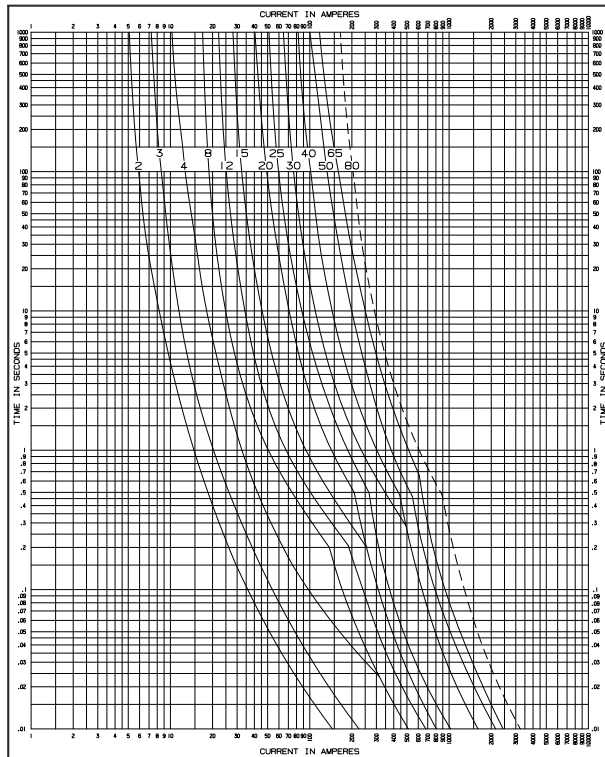

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR 15,5KV ELS  
FULL RANGE OIL IMMERSIBLE FUSE

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load  
Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY WJK: CMC/D  
DATE 6-03-99 DATE  
REPLACES 01/92 01 REG NO. 18907  
DWG NO. 42 38286 B 00

80 AMP - 2 - 40 AMP FUSES IN PARALLEL

Reference Data  
R240-91-76  
Page 2 of 2