

* PARALLEL FUSES

COOPER
 COOPER POWER SYSTEMS DIVISION
 COMPONENTS & PROTECTIVE EQUIPMENT
 DRAWN BY: SJS [CKW]
 DATE: 07-18-97
 REPLACES: 1/93/REV 03/REG NO. 17661
 DWG NO.: 42 39045 B 00


TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT 15.5kV MID-RANGE ELP
 BACKUP OIL IMMERSIBLE CURRENT LIMITING FUSE

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load
 Standards used as basis for data: ANSI C37.47-1991 (R1992)
 MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
 R240-91-83
 Page 1 of 2

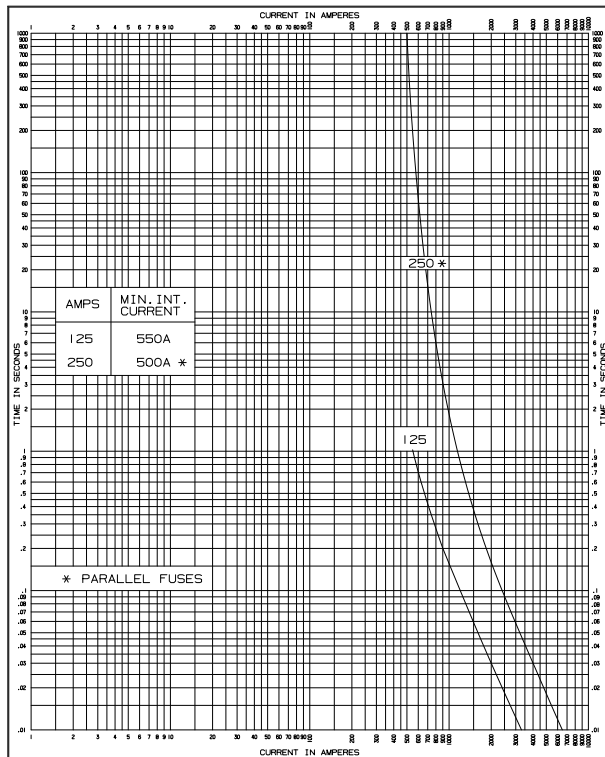

* PARALLEL FUSES

COOPER
 COOPER POWER SYSTEMS DIVISION
 COMPONENTS & PROTECTIVE EQUIPMENT
 DRAWN BY: SJS [CKW]
 DATE: 07-18-97
 REPLACES: 1/93/REV 03/REG NO. 17661
 DWG NO.: 42 39045 B 00

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR 15.5kV MID-RANGE ELP
 BACKUP OIL IMMERSIBLE CURRENT LIMITING FUSE

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
 Standards used as basis for data: ANSI C37.47-1991 (R1992)
 MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
 R240-91-83
 Page 2 of 2