


 COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT	TIME-CURRENT CHARACTERISTIC CURVES MINIMUM MELT 15.5kV MINI-ELSP BACKUP TYPE OIL IMMERSIBLE LIMITING FUSE	
	DRAWN BY: EKS DATE: 07-17-97 REPLACES: 08/91/REV 04 DWG NO.: 42 38613 B 00	CWD Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1991 (R1992) MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
 R240-91-63
 Page 1 of 2

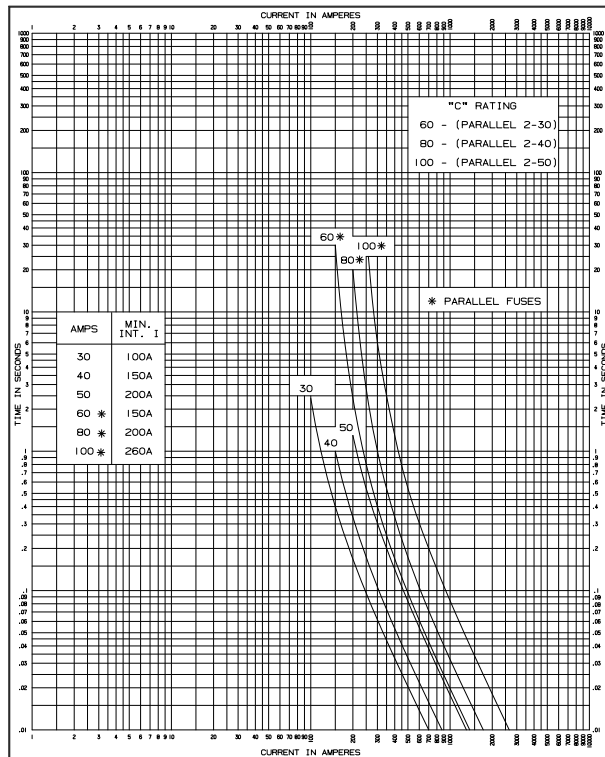

 COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT	TIME-CURRENT CHARACTERISTIC CURVES MAXIMUM CLEAR 15.5kV MINI-ELSP BACKUP TYPE OIL IMMERSIBLE LIMITING FUSE	
	DRAWN BY: EKS DATE: 07-17-97 REPLACES: 08/91/REV 04 DWG NO.: 42 38613 B 00	CWD Tests made at RATED Volts ac at LOW pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1991 (R1992) MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
 R240-91-63
 Page 2 of 2