


COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES	
		MINIMUM MELT 15.0 KV ELF™ DROPOUT FUSE	
DRAWN BY: RKH DATE: 3-2-00 REPLACES: 5/96 REV 04 DWG NO.: 42 3921 B 00	[CHKD] DATE: 19586 REG NO. 19586	Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1991 (R1992) MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	

NOTE: 95KV BIL MOUNTED FUSES AVAILABLE IN 6 THROUGH 20AMP.
125KV BIL MOUNTED FUSES AVAILABLE IN 6 THROUGH 50AMP.

Reference Data
R240-91-43
Page 1 of 2

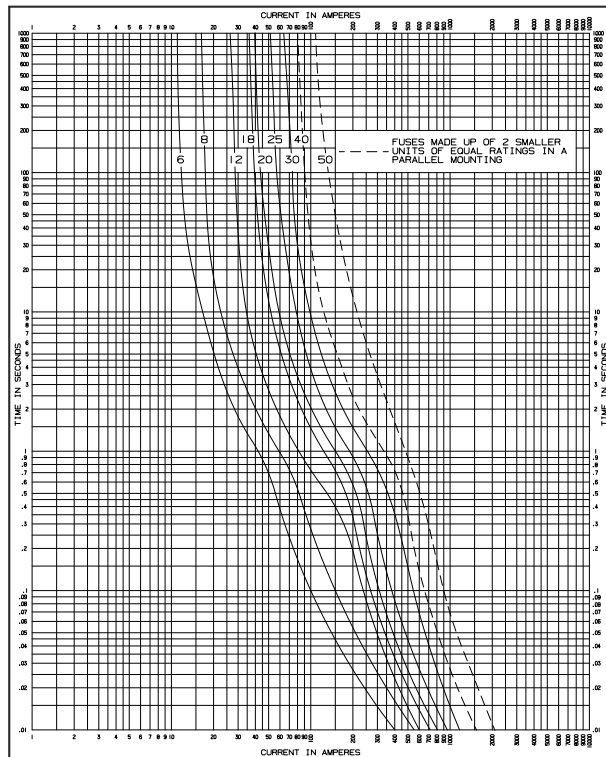

COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES	
		MAXIMUM CLEAR 15.0 KV ELF™ DROPOUT FUSE	
DRAWN BY: RKH DATE: 3-2-00 REPLACES: 5/96 REV 04 DWG NO.: 42 3921 B 00	[CHKD] DATE: 19586 REG NO. 19586	Tests made at HIGH Volts ac at LOW pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1991 (R1992) MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	

NOTE: 95KV BIL MOUNTED FUSES AVAILABLE IN 6 THROUGH 20AMP.
125KV BIL MOUNTED FUSES AVAILABLE IN 6 THROUGH 50AMP.

Reference Data
R240-91-43
Page 2 of 2