


 COMPONENTS AND PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES	
		MINIMUM MELT 8.3, & 15.5 KV ELSG FULL RANGE OIL IMMERSIBLE FUSE 2.0 DIA.	
DRAWN BY: ALJ		DATE: 3-2-00	
REPLACES: B/98		DATE: REV 03	
DWG NO.: 42 3905		REV NO.: 19586	
AVAILABLE FUSE RATINGS: 8.3KV - 4 THRU 50 AMP (3593---M02M) 15.5KV - 4 THRU 150 AMP (3594---M83M) 15.5KV - 4 THRU 60, 120, & 150 AMP (3594---M02M)		MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	
Reference Data R240-91-95 Page 1 of 2			

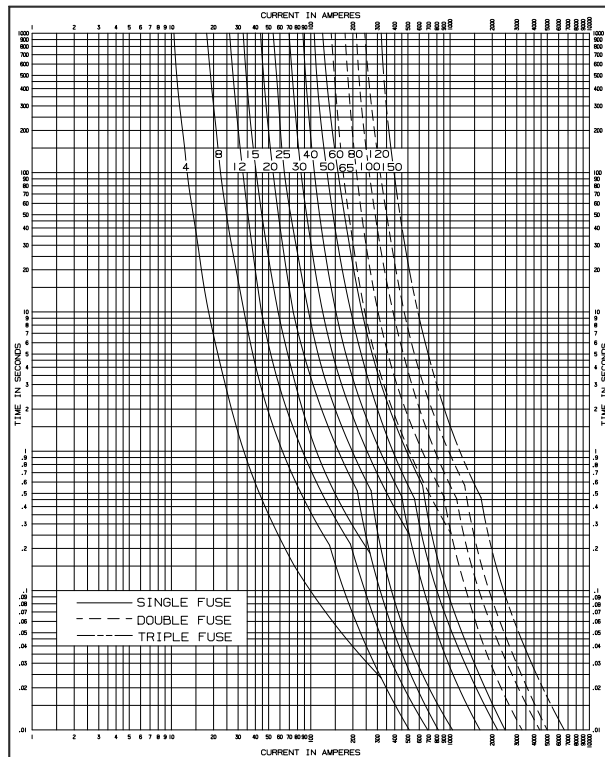

 COMPONENTS AND PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES	
		MAXIMUM CLEAR 8.3, & 15.5 KV ELSG FULL RANGE OIL IMMERSIBLE FUSE 2.0 DIA.	
DRAWN BY: ALJ		DATE: 3-2-00	
REPLACES: B/98		DATE: REV 03	
DWG NO.: 42 3905		REV NO.: 19586	
AVAILABLE FUSE RATINGS: 8.3KV - 4 THRU 50 AMP (3593---M02M) 15.5KV - 4 THRU 150 AMP (3594---M83M) 15.5KV - 4 THRU 60, 120, & 150 AMP (3594---M02M)		MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	
Reference Data R240-91-95 Page 2 of 2			