

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT  
23.0/25.8 KV ELG POWER FUSE

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load  
Standards used as basis for data: ANSI C37.47-1981 (R1992)  
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS


THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY **DS** CHECKED  
DATE **3-7-00** DATE  
REPLACES **5/95** REV **02** REG NO. **19586**  
DWG NO. **42 39240 B | 00**

THE 20 THRU 100 AMP SIZES ARE RATED FOR USE AT 25.8 KV  
THE 120 AMP SIZE IS RATED AT 23.0 KV

Reference Data  
R240-91-91  
Page 1 of 2

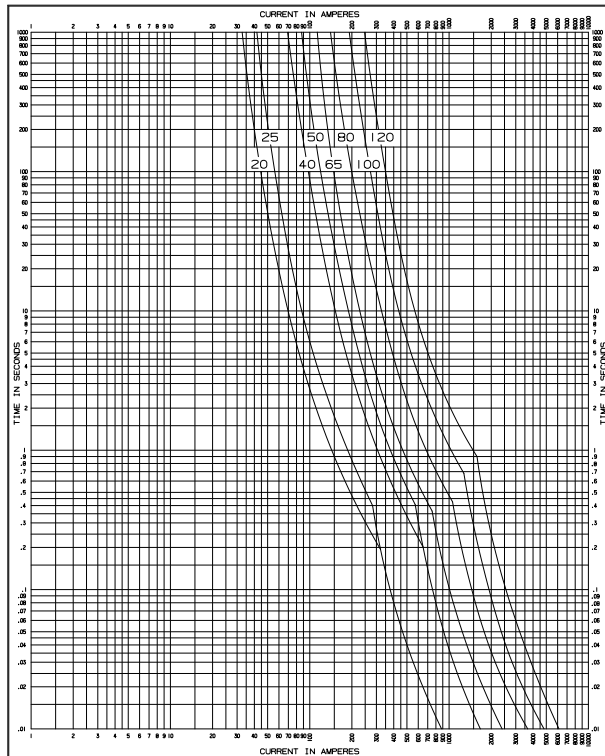

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR  
23.0/25.8 KV ELG POWER FUSE

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load  
Standards used as basis for data: ANSI C37.47-1981 (R1992)  
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY **DS** CHECKED  
DATE **3-7-00** DATE  
REPLACES **5/95** REV **02** REG NO. **19586**  
DWG NO. **42 39240 B | 00**

THE 20 THRU 100 AMP SIZES ARE RATED FOR USE AT 25.8 KV  
THE 120 AMP SIZE IS RATED AT 23.0 KV

Reference Data  
R240-91-91  
Page 2 of 2