

----- FUSES MADE UP OF 2 SMALLER UNITS OF EQUAL RATINGS IN A PARALLEL MOUNTING

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

**TIME-CURRENT CHARACTERISTIC CURVES**

MINIMUM MELT  
23.0 KV ELF™ DROPOUT FUSE

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load


Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

DRAWN BY: ALJ [CHKD]  
DATE: 3-7-00  
REPLACES: 9/95 REV 01 REG NO. 19586  
DWG NO.: 42 39278 B | 00

Reference Data  
R240-91-44  
Page 1 of 2

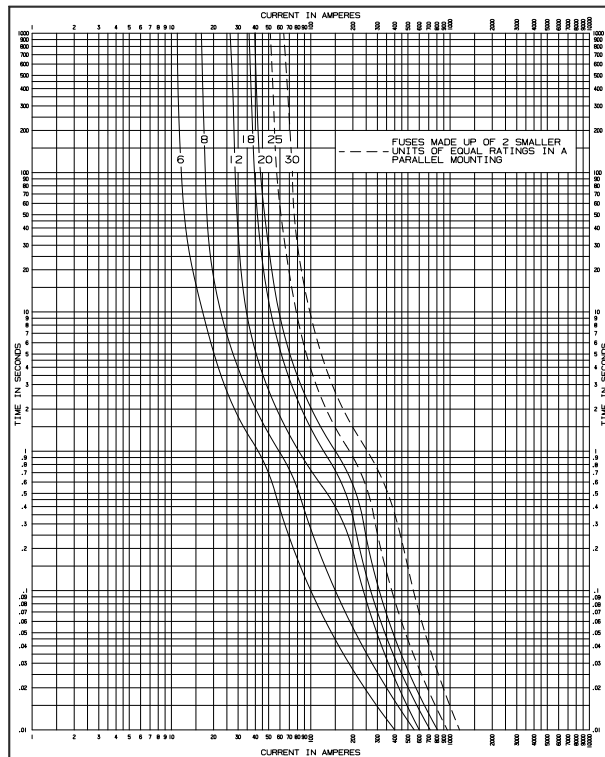

----- FUSES MADE UP OF 2 SMALLER UNITS OF EQUAL RATINGS IN A PARALLEL MOUNTING

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

**TIME-CURRENT CHARACTERISTIC CURVES**

MAXIMUM CLEAR  
23.0 KV ELF™ DROPOUT FUSE

Tests made at HIGH Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

DRAWN BY: ALJ [CHKD]  
DATE: 3-7-00  
REPLACES: 9/95 REV 01 REG NO. 19586  
DWG NO.: 42 39278 B | 00

Reference Data  
R240-91-44  
Page 2 of 2