

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT 23.0KV ELS  
FULL RANGE OIL IMMERSIBLE FUSE

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS


THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY: WJK | CHK'D: GHW  
DATE: 6-03-99 | DATE: |  
REPLACES: 05/92 | REV 01 | REG NO. | 8907  
DWG NO.: 42 | 38288 | B | 00

50 AMP - 2 - 25 AMP FUSES IN PARALLEL

Reference Data  
R240-91-77  
Page 1 of 2

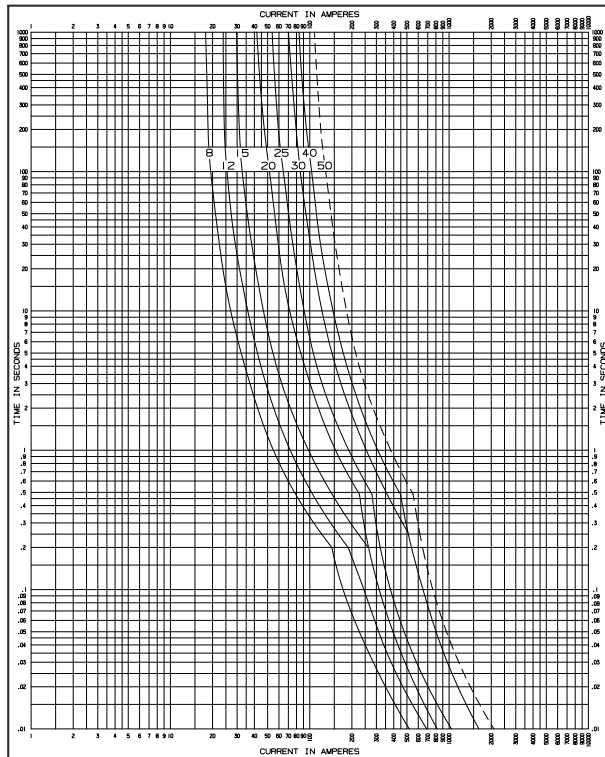

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR 23.0 KV ELS  
FULL RANGE OIL IMMERSIBLE FUSE

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY: WJK | CHK'D: GHW  
DATE: 6-03-99 | DATE: |  
REPLACES: 05/92 | REV 01 | REG NO. | 8907  
DWG NO.: 42 | 38288 | B | 00

50 AMP - 2 - 25 AMP FUSES IN PARALLEL

Reference Data  
R240-91-77  
Page 2 of 2