


		TIME-CURRENT CHARACTERISTIC CURVES MINIMUM MELT 23.0 KV ELSS UNDER-OIL POWER FUSE	
DRAWN BY WJK DATE 6-07-99 REPLACES 07/92 REV 01 DWG NO. 42 38452 B 00	CHW'D DATE REV 01 REG NO. 18907	Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1981 (R1992) MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	

Reference Data
 R240-91-87
 Page 1 of 2

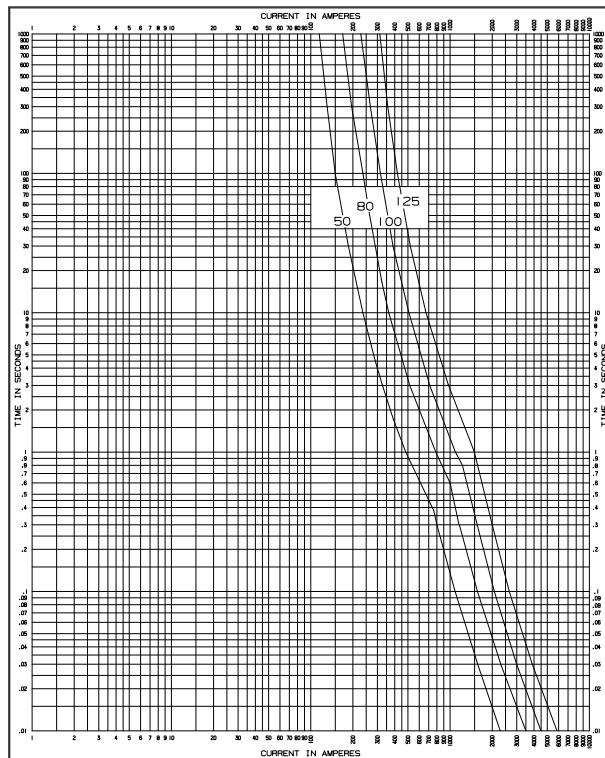

		TIME-CURRENT CHARACTERISTIC CURVES MAXIMUM CLEAR 23.0 KV ELSS UNDER-OIL POWER FUSE	
DRAWN BY WJK DATE 6-07-99 REPLACES 07/92 REV 01 DWG NO. 42 38452 B 00	CHW'D DATE REV 01 REG NO. 18907	Tests made at RATED Volts ac at LOW pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1981 (R1992) MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	

Reference Data
 R240-91-87
 Page 2 of 2