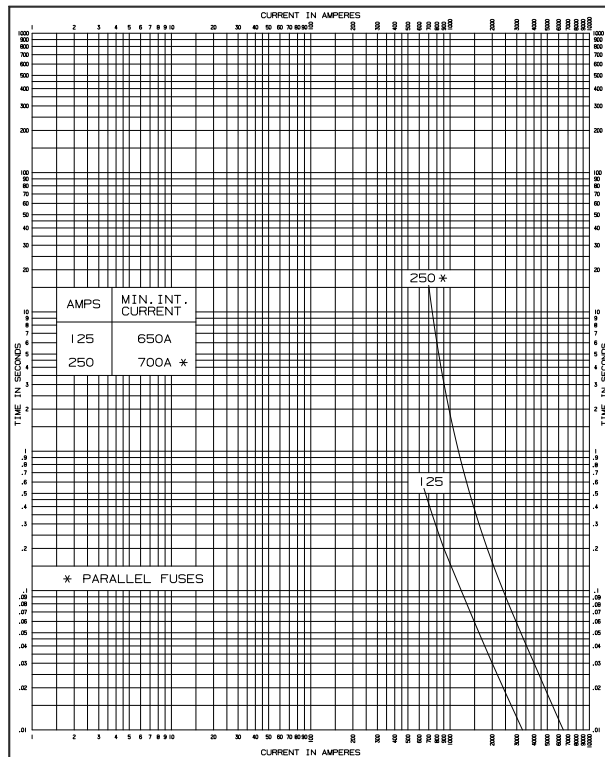

 COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT	TIME-CURRENT CHARACTERISTIC CURVES MINIMUM MELT 23.0kV MID-RANGE ELSF BACKUP OIL IMMERSIBLE CURRENT LIMITING FUSE	
	DRAWN BY: EKS DATE: 07-21-97 REPLACES: 11/93/REV 03/REG NO. 17661 DWG NO.: 42 39047 B 00	CWD Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1991 (R1992) MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-84
Page 1 of 2



 COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT	TIME-CURRENT CHARACTERISTIC CURVES MAXIMUM CLEAR 23.0kV MID-RANGE ELSF BACKUP OIL IMMERSIBLE CURRENT LIMITING FUSE	
	DRAWN BY: EKS DATE: 07-21-97 REPLACES: 11/93/REV 03/REG NO. 17661 DWG NO.: 42 39047 B 00	CWD Tests made at RATED Volts ac at LOW pf at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1991 (R1992) MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-84
Page 2 of 2