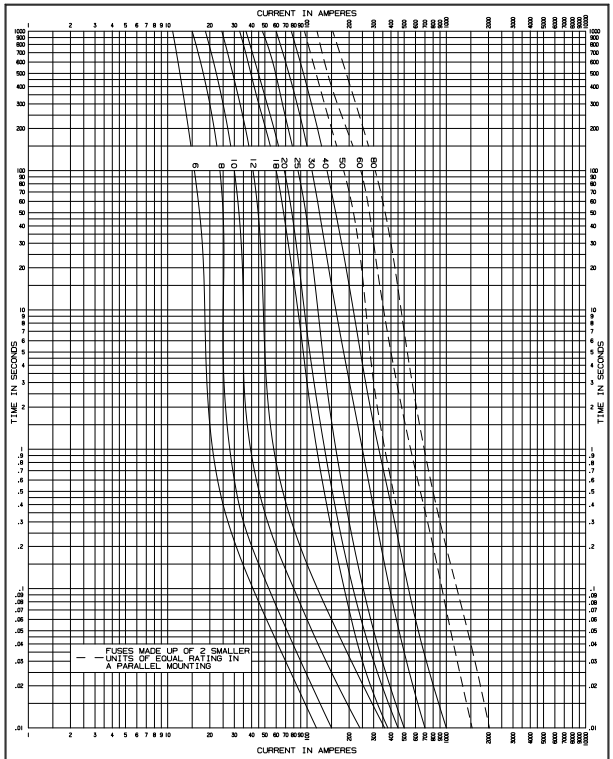

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT
23KV NX (C-RATED)

DRAWN BY	JFR	CHK'D	
DATE	12-6-00	DATE	
REPLACES	02/75	REV 00	REQ NO. 19892
DWG NO.	42	39648	B 00

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-34
Page 1 of 2

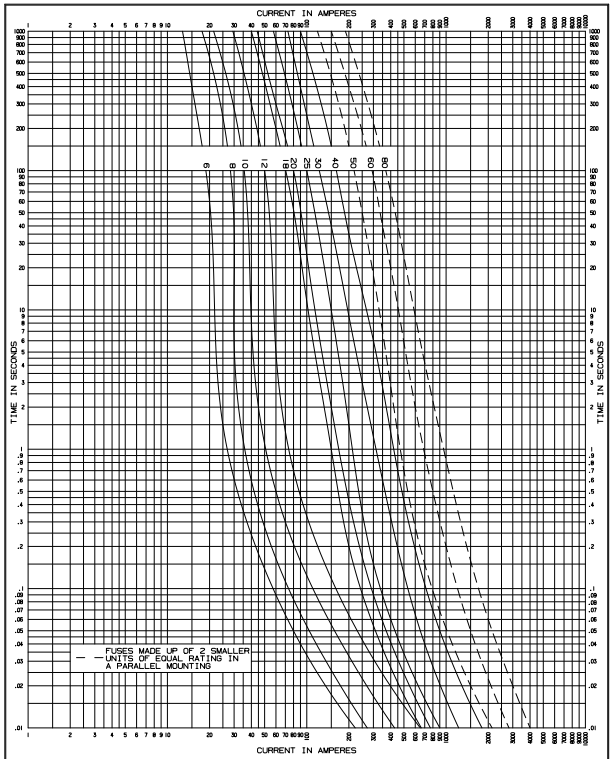

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR
23KV NX (C-RATED)

DRAWN BY	JFR	CHK'D	
DATE	12-6-00	DATE	
REPLACES	02/75	REV 00	REQ NO. 19892
DWG NO.	42	39648	B 00

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981 (R1992)

MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-34
Page 2 of 2