

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT
23 KV NXC (CAPACITOR) FUSE

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)


MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-39
Page 1 of 2

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY SES [CWD]
DATE 3-7-00 DATE
REPLACES 7/95 REV 02 REG NO. 19586
DWG NO. 42 3925 | B | 00

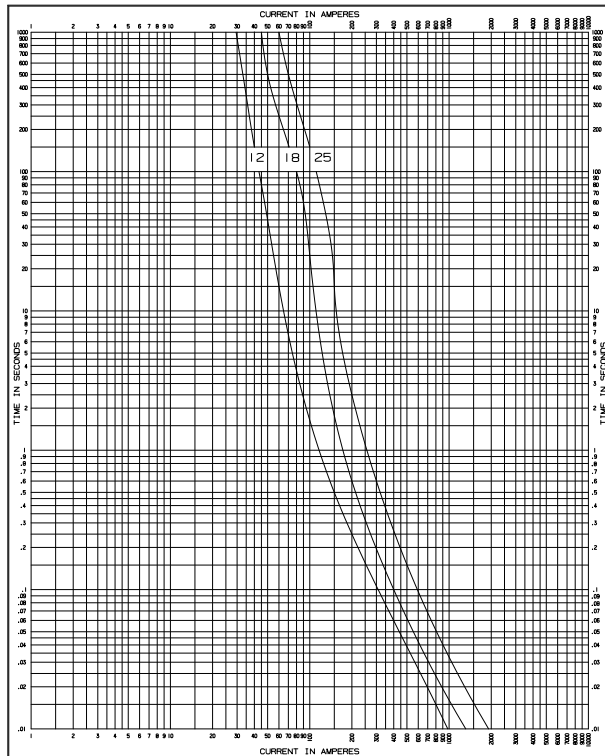

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR
23 KV NXC (CAPACITOR) FUSE

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-39
Page 2 of 2

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY SES [CWD]
DATE 3-7-00 DATE
REPLACES 7/95 REV 02 REG NO. 19586
DWG NO. 42 3925 | B | 00