

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT
27 AND 38 KV NX (C-RATED)

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load


Standards used as basis for data: ANSI C37.47-1981 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91 -35
Page 1 of 2

DRAWN BY JFR [CHKD] DATE 12-8-00
REPLACES 06/71 [REV 00] REG NO. 19892
DWG NO. 42 39649 B 00

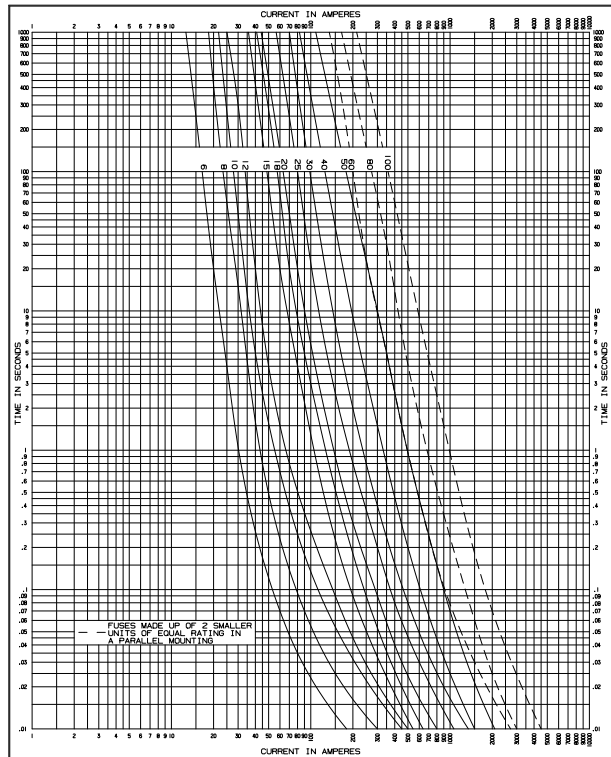

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR
27 AND 38 KV NX (C-RATED)

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91 -35
Page 2 of 2

DRAWN BY JFR [CHKD] DATE 12-8-00
REPLACES 06/71 [REV 00] REG NO. 19892
DWG NO. 42 39649 B 00