


COOPER		TIME-CURRENT CHARACTERISTIC CURVES	
COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT		MINIMUM MELT TIME-CURRENT CHARACTERISTIC CURVES 4.3 & 5.5 kV X-LIMITER FULL RANGE PARALLEL MOUNTED FUSE	
DRAWN BY	RJC	CHK'D	Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
DATE	1-10-96	DATE	Standards used as basis for data: ANSI C37.47-1981
REPLACES	5 / 89 REV 01	REQ. NO.	MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS
DWG NO.	TCC303 M	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	

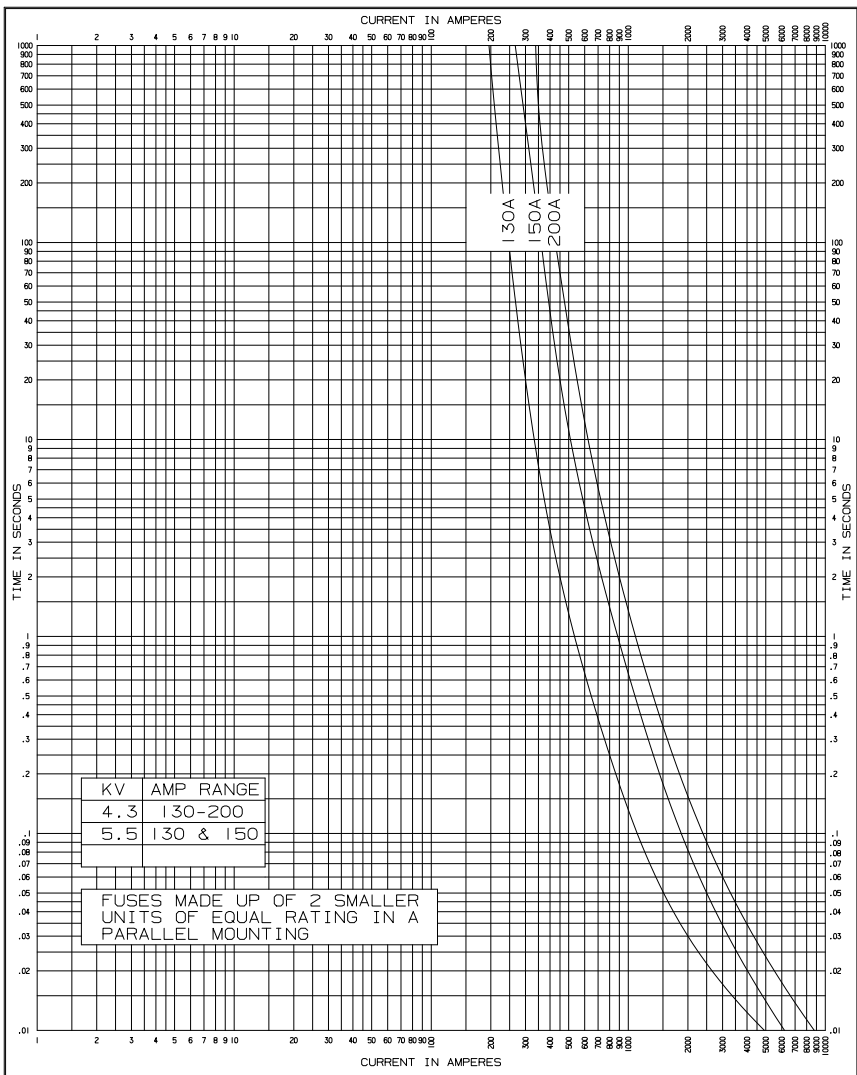

KV	AMP RANGE
4.3	130-200
5.5	130 & 150

FUSES MADE UP OF 2 SMALLER UNITS OF EQUAL RATING IN A PARALLEL MOUNTING

COOPER		TIME-CURRENT CHARACTERISTIC CURVES	
COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT		MAXIMUM CLEAR TIME-CURRENT CHARACTERISTIC CURVES 4.3 & 5.5 kV X-LIMITER FULL RANGE PARALLEL MOUNTED FUSE	
DRAWN BY	RJC	CHK'D	
DATE	1-10-96	DATE	
REPLACES	5/89 REV 01	REQ. NO.	
DWG NO.	TCC303 C	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	

Reference Data
 R240-91-106
 Page 2