

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY JFR [CWD] DATE 11-14-00
REPLACES 06/71 [REV 00] REG. NO. 19892
DWG NO. 42 39645 B 00

TIME-CURRENT CHARACTERISTIC CURVES


MINIMUM MELT
4.3KV NK (C-RATED)

Tests made at LOW Volts or at HIGH pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-50
Page 1 of 2

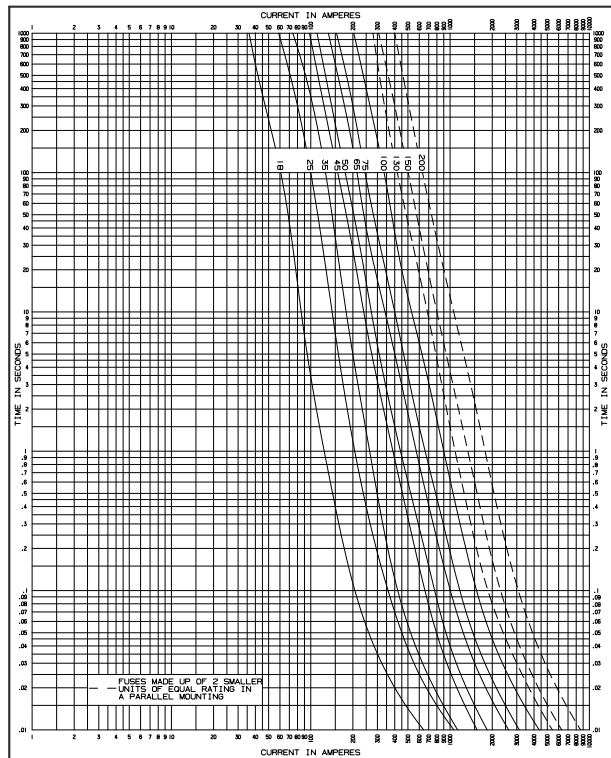

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY JFR [CWD] DATE 11-14-00
REPLACES 06/71 [REV 00] REG. NO. 19892
DWG NO. 42 39645 B 00

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR
4.3KV (C-RATED)

Tests made at RATED Volts or at LOW pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-50
Page 2 of 2