

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT TCC ON THE 5.5, 8.3, 15.5kV EL6 POWER FUSE

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.


Reference Data
R240-91-96
Page 1 of 2



COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY RJC [CWD] DATE 3-3-00
 REPLACES 11/95 REV 02 REG NO. 19586
 DWG NO. 42 38046 B 00

FUSE RATINGS:
 5.5kV (8 THRU 150 AMPS)
 8.3kV (8 THRU 125 AMPS)
 15.5kV (8 THRU 100 AMPS)
 •CONSULT FACTORY

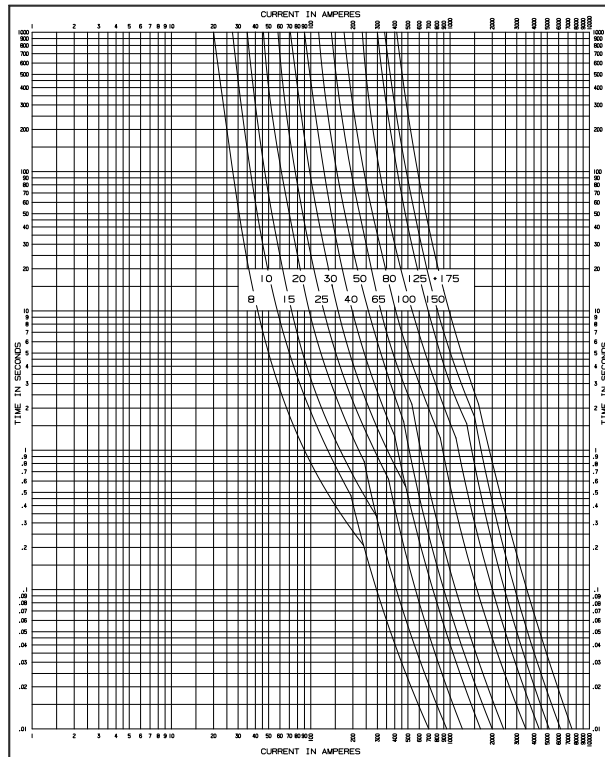

TIME-CURRENT CHARACTERISTIC CURVES

TOTAL CLEARING TCC ON THE 5.5, 8.3, 15.5kV EL6 POWER FUSE

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-96
Page 2 of 2



COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY RJC [CWD] DATE 3-3-00
 REPLACES 11/95 REV 02 REG NO. 19586
 DWG NO. 42 38046 B 00

FUSE RATINGS:
 5.5kV (8 THRU 150 AMPS)
 8.3kV (8 THRU 125 AMPS)
 15.5kV (8 THRU 100 AMPS)
 •CONSULT FACTORY