


COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES		
		MINIMUM MELT 5.5KV X-LIMITER "E" RATED 3.0 DIA (BUSSMANN)		
DRAWN BY	DG	CHK'D	NRH	Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load
DATE	11-8-06	DATE	11-16-06	Standards used as basis for data: ANSI C37.46-1981 (R1992)
REPLACES	/	REV	00	REQ NO. 23753
DWG NO.	CT TCC208 B		00	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

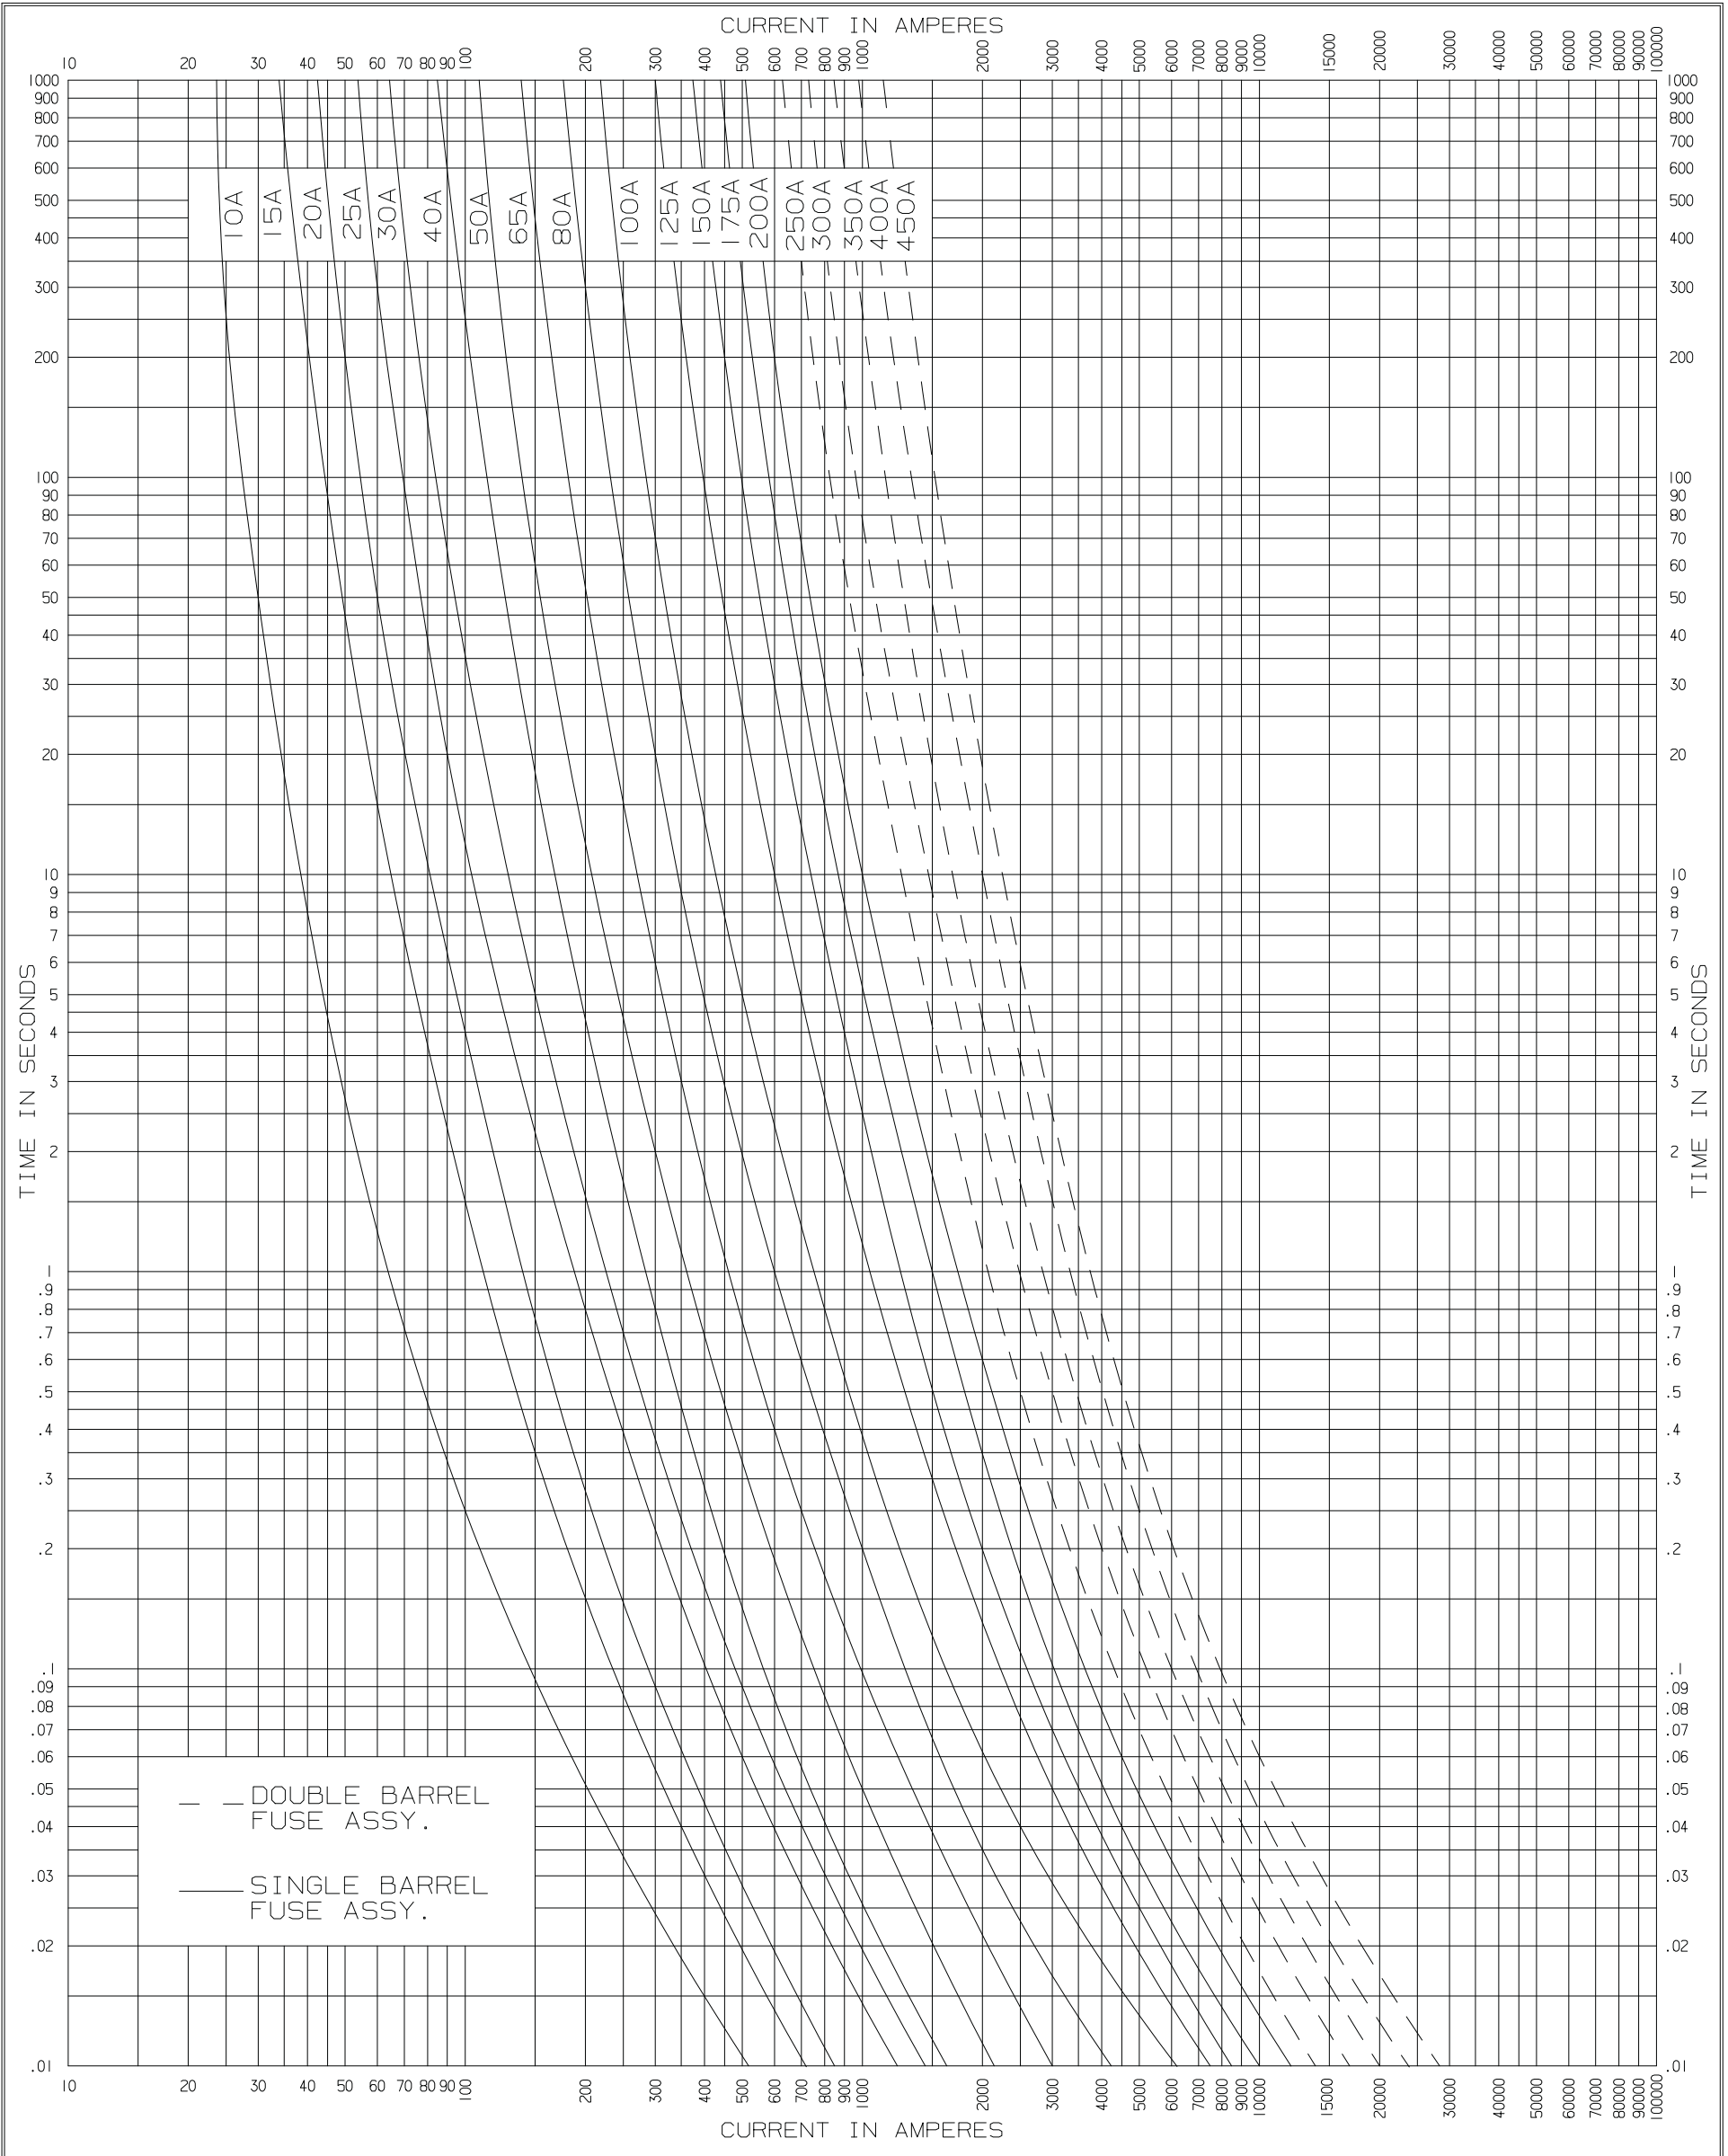

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR
5.5KV X-LIMITER "E" RATED 3.0 DIA (BUSSMANN)

DRAWN BY	DG	CHK'D	NRH
DATE	11-8-06	DATE	11-16-06
REPLACES	/	REV	00
		REQ NO.	23753
DWG NO.	CT	TCC208	B 00

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.46-1981 (R1992)
MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.